
INSTRUCTOR SOLUTIONS SEPT 28 / 2016.

MSYS 3386 HEATING SYSTEMS

LAB SOLUTION: GAS SYSTEM.

Q26/

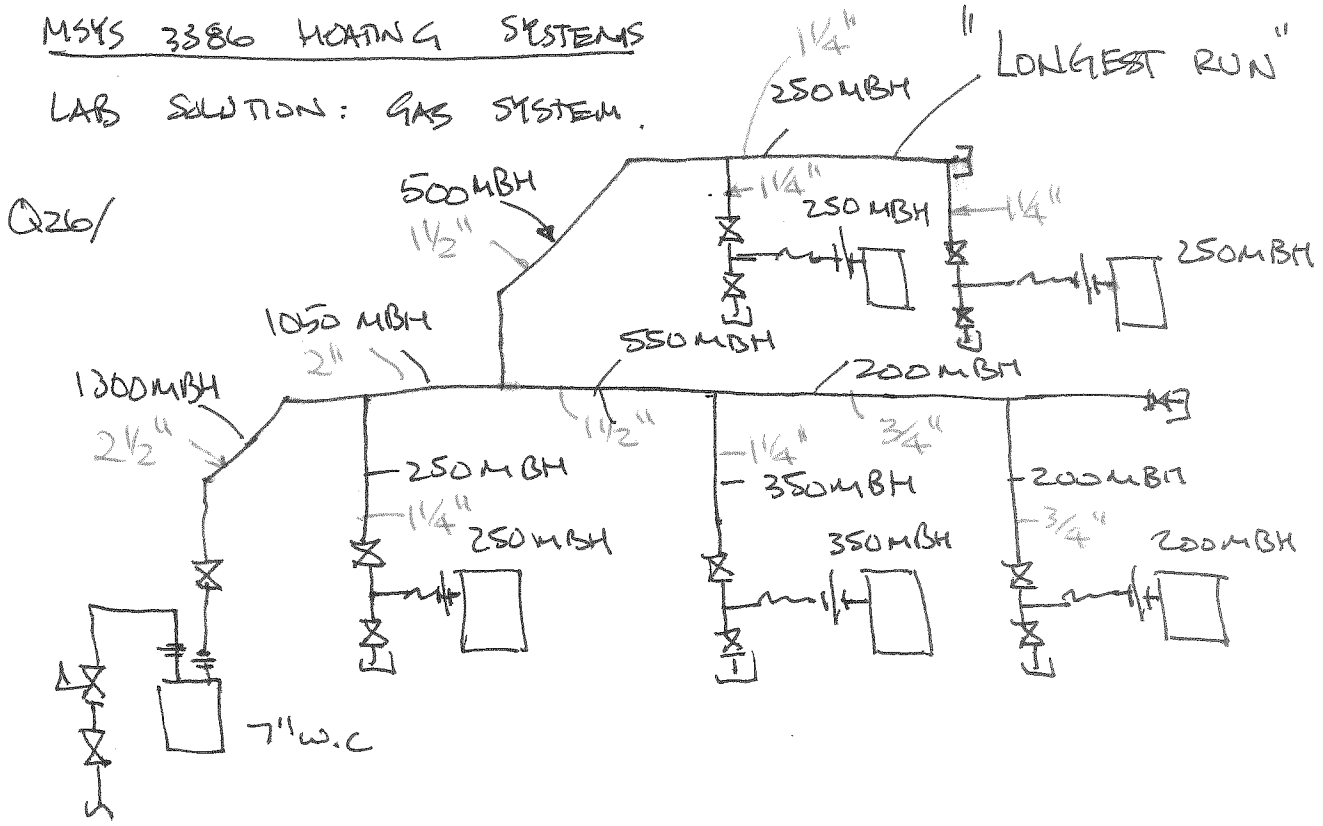

LONGEST RUN BETWEEN GAS METER TO THE MOST REMOTE GAS APPLIANCE: L = 143 ft


TOTAL GAS HEATING INPUT = 1300 MBH

REFER TO GAS TABLE 2A.

PIPE SIZES AS NOTED IN RED.

MSAS 3386 HEATING SYSTEMS.

Q27

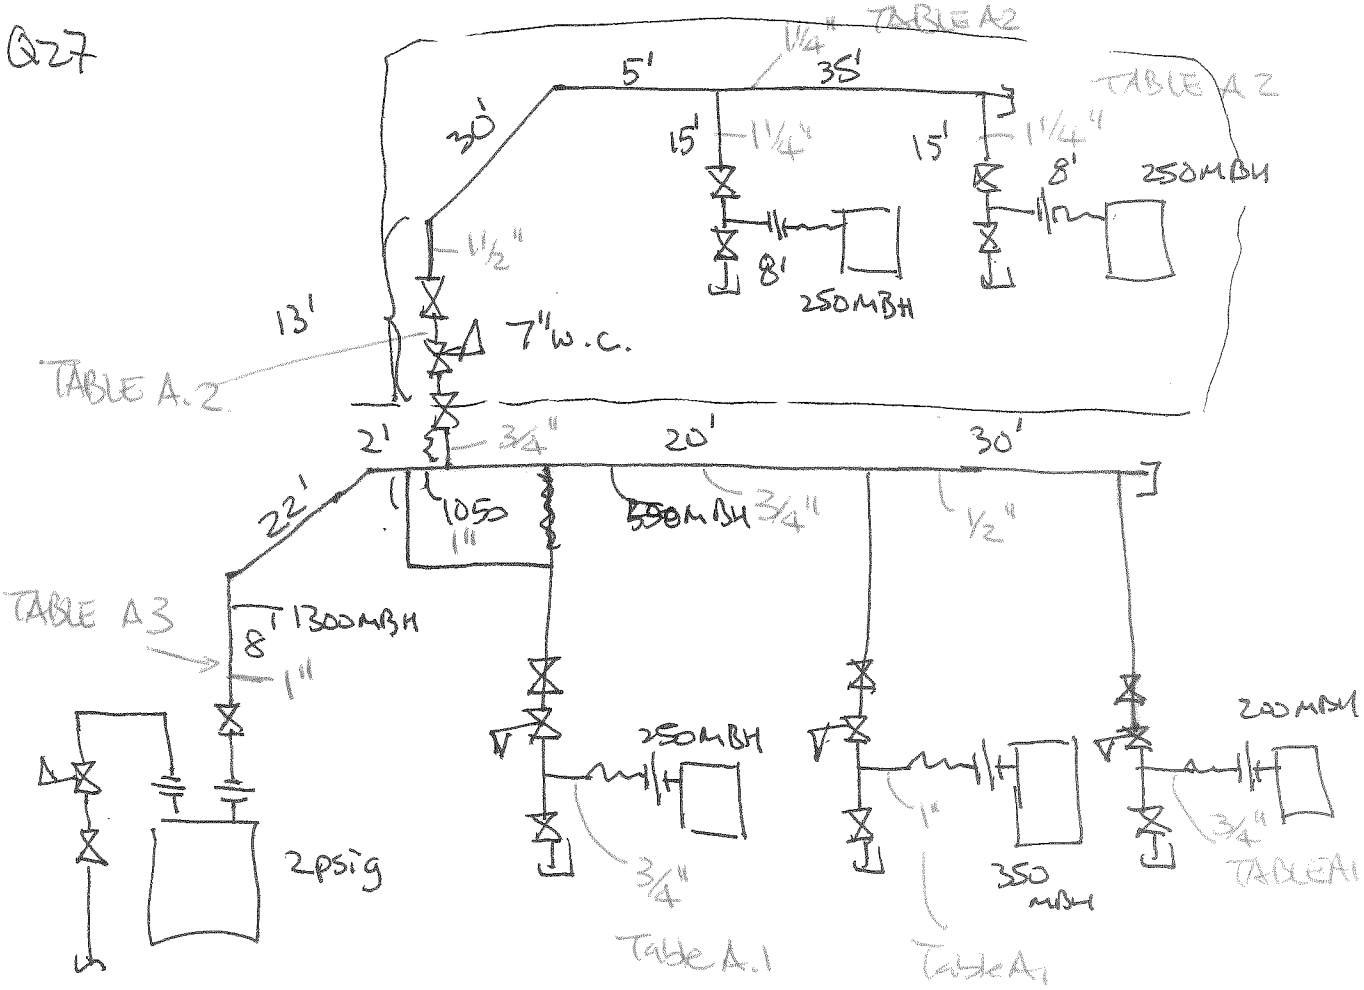

LONGEST RUN FOR 2psig between GAS METER AND THE MOST REMOTE GAS METER:

$L = \underbrace{8' + 22'}_{30'} + 5' + \underbrace{20' + 30'}_{50'} + \cancel{15'} + 13' = \cancel{\text{43 ft}}$

98ft

TOTAL HEATING INPUT = 1300 MBH.

TABLE 3A.

FROM PRU TO GAS METER AT 7"w.c.

TOTAL LENGTH FROM 7"w.c. TO 250 MBH APPLIANCE:

$= \underbrace{13' + 30'}_{43'} + \underbrace{5' + 35'}_{40} + \underbrace{15' + 8'}_{23'} = 106' \approx$ 110ft