Lesson 5:

Creating a New Configuration



IGSS

Interactive Graphical
SCADA System

YouTube
Broadcast Yourself™

Contents of this lesson




Topics:

- Create a new configuration
- Create servers
- Create operator stations
- Choose PLC drivers


New configuration – first steps



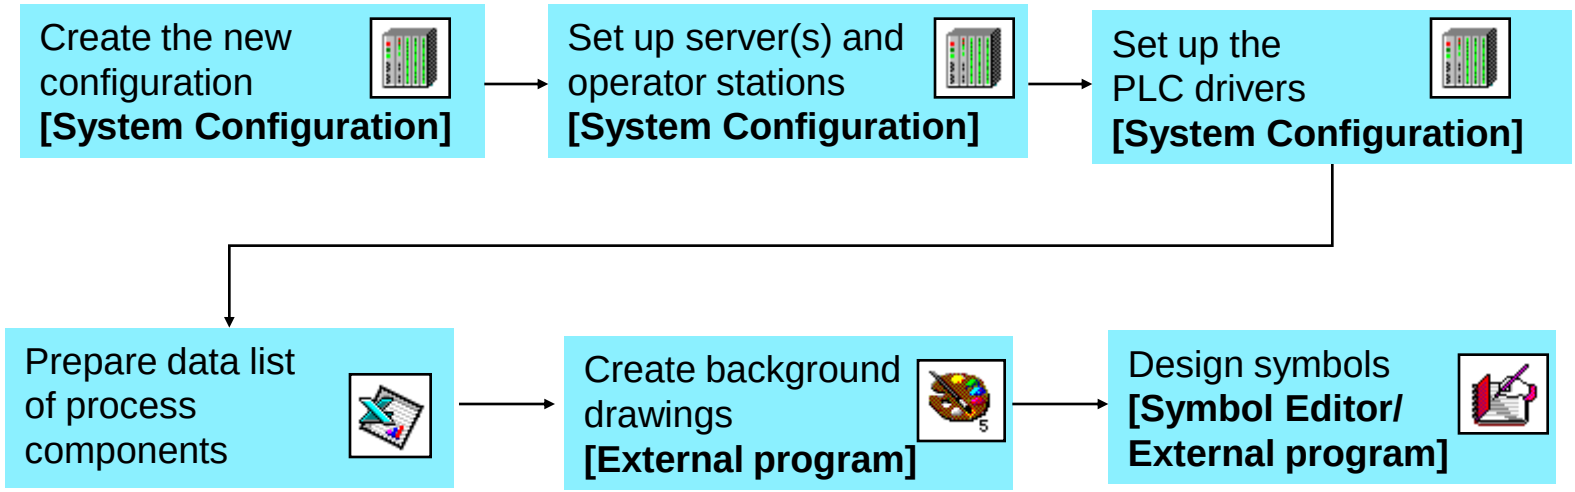


System Configuration

1. Start System Configuration.
2. In the **File** menu, choose **New Configuration Wizard**.

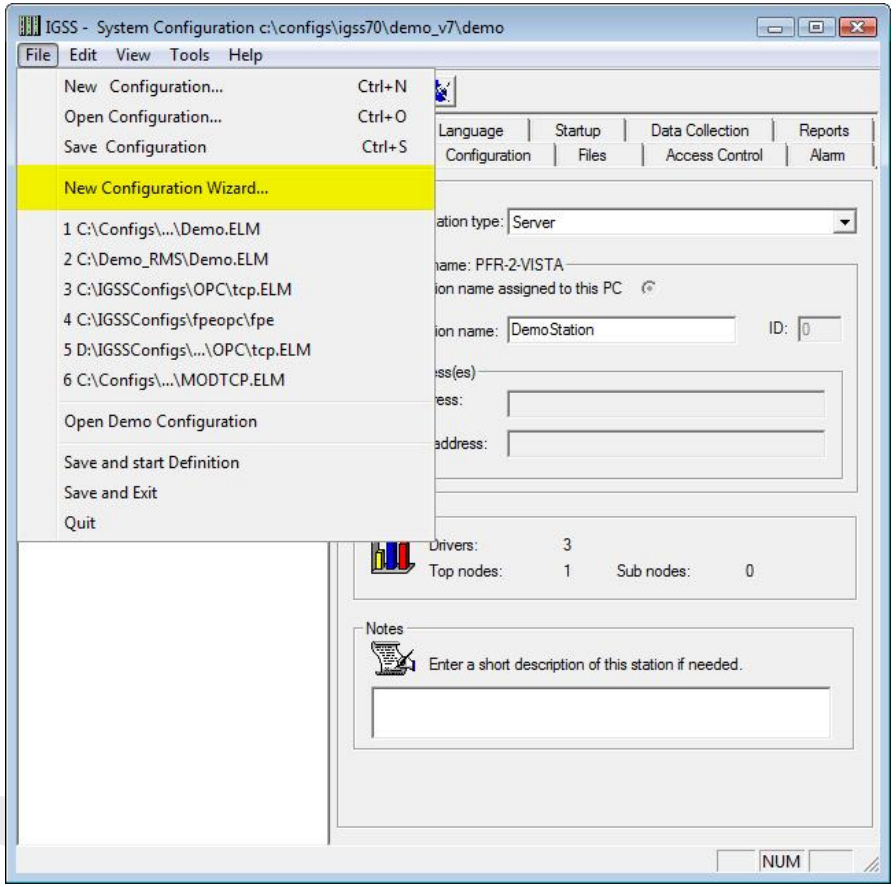


Create project using wizard

1. Specify configuration name.
2. Specify configuration location.

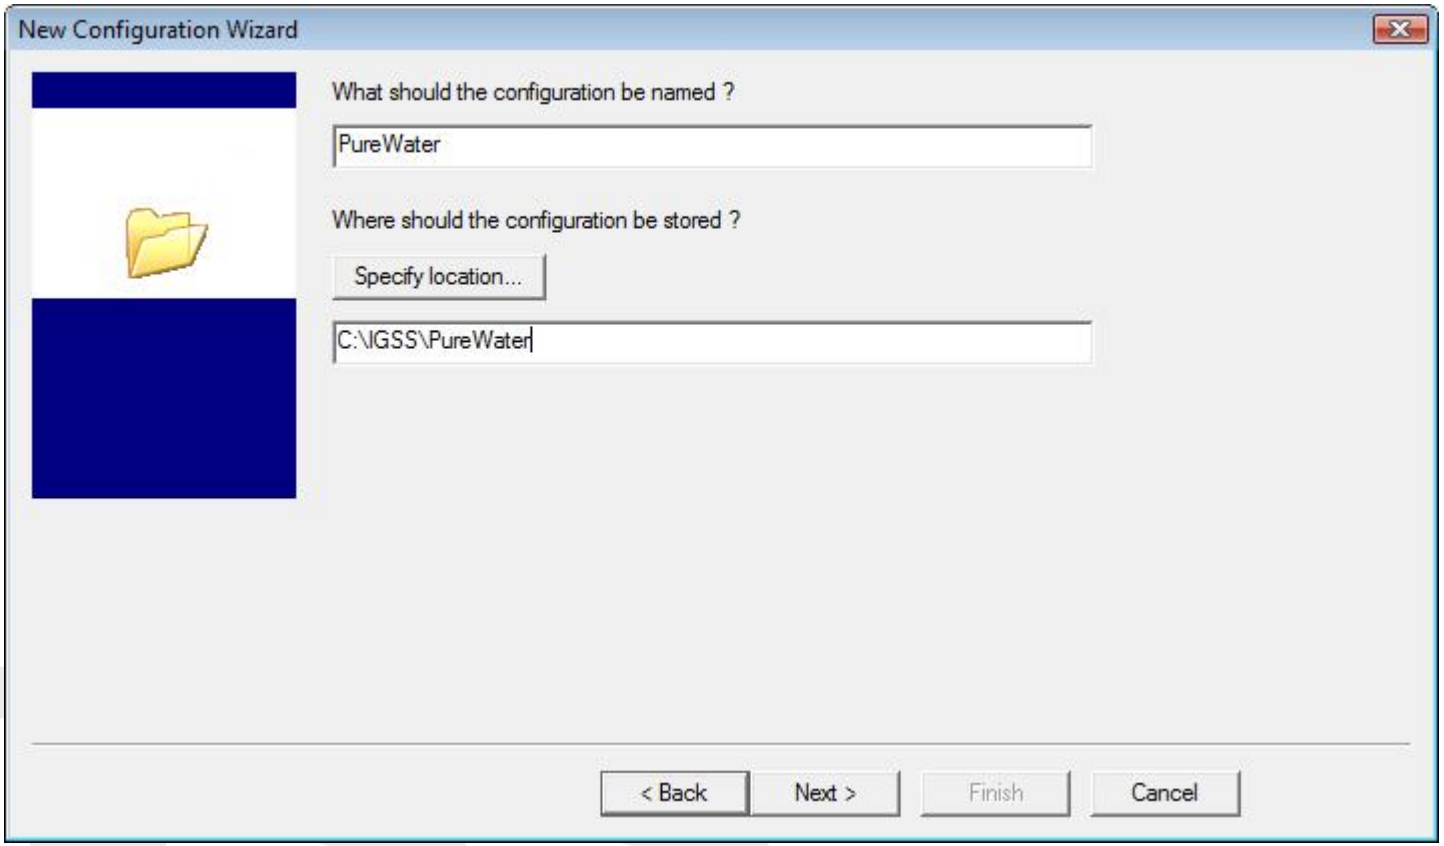


Add the IGSS server

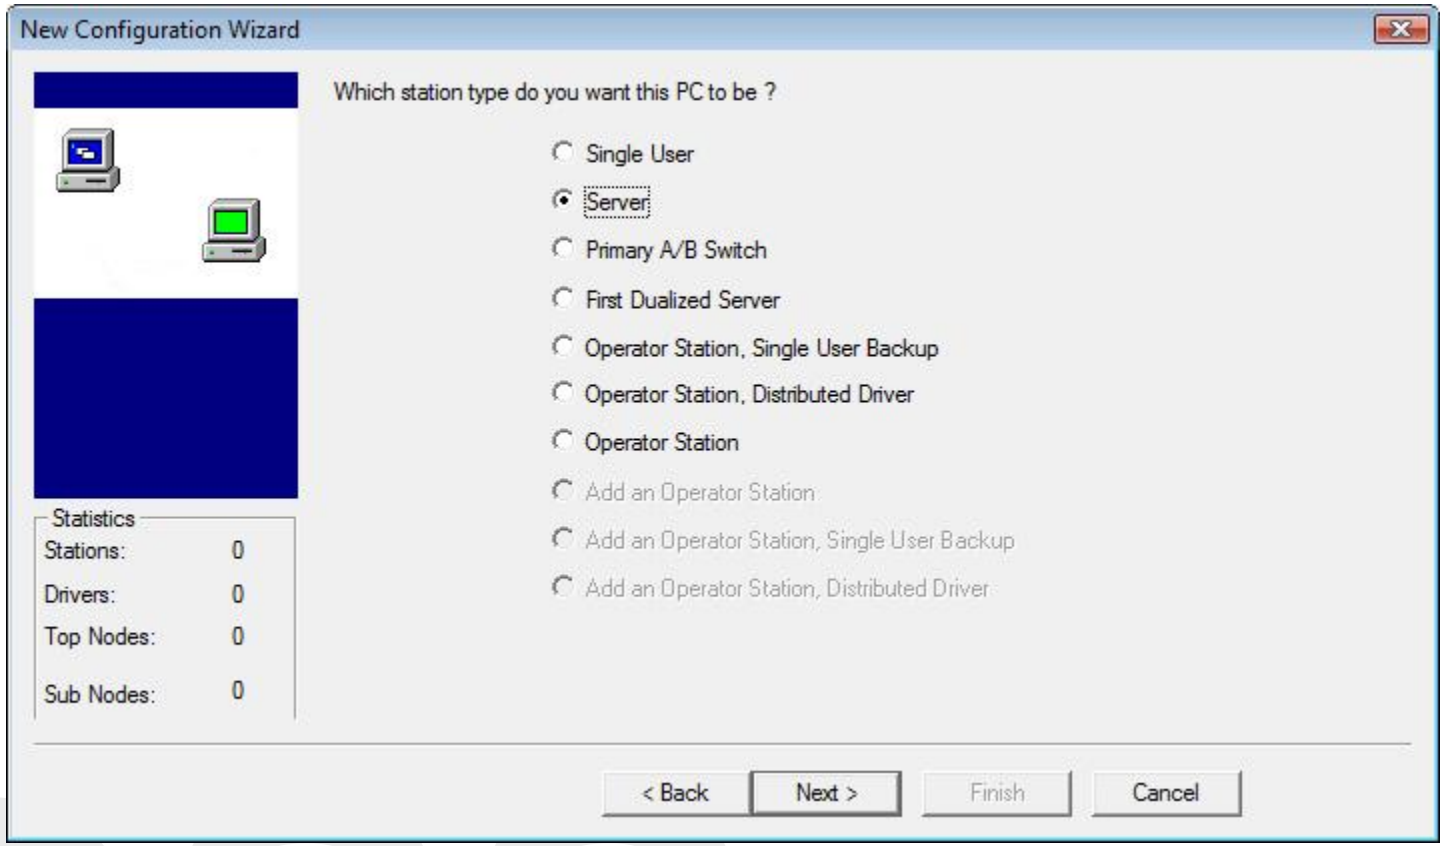

More than 80 PLC drivers available


- Many different drivers (80+)
- 7T develops specific drivers
- OPC client-side driver

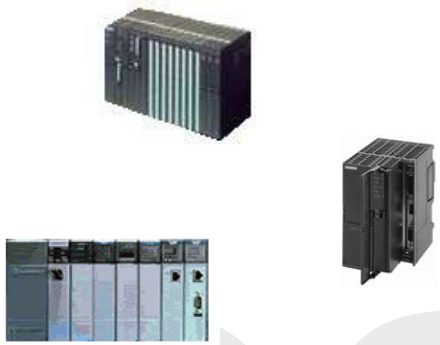


Internal Simulation driver
ABB Procontic T200, Hitachi H Series & Sprecher+Schue
ABB RCOM Extended Protocol Driver
AEG Modicon Modbus & Milltronics Enviroranger ERS 500
AI800 AlarmNet Driver
Alfa Laval SattBus
Allen Bradley RS-linx
B&K 1301 IEEE 488 Interface Driver
BOSCH BÜEP19 / BÜEP19E
Brodersen System 2000 interface driver
CMM 7000
Data file driver
Data file interface driver
DDE Supermax
Dupline Modem Interface D 9091
FPC Link
FT2000 (AlarmNet driver)
Gascromatograph file interface driver
Generic TCP/IP Driver
IDEC Izumi FA-Series
KOYO DirectNet Driver
Mitsubishi Melsec-A (Serial RS232)
Mitsubishi Melsec-A (TCP/IP)
MJK Data Transmitter 795
MODBUS/TCP Driver
NewLog Data Logger Driver
ODBC Interface Driver
Omron FinsGateway Driver
Omron SysMac Link Driver
Omron Sysmac Way
OPC (OLE for Process Control) Client-Side Driver
Phoenix Fernwirk protocol driver
P-NET Fieldbus
Sabroe&Soeby COMSAB II
Saia S-Bus
SAIA-P8
SattControl Comli 31
Siemens L2-FMS
Siemens PROFIBUS/MPI & Siemens Industrial Ethernet S7
Siemens S7 HMI Adapter (S7 protocol)
Siemens S7 Netlink driver
Siemens S7 PCA adapter interface driver
Siemens S7 PPI adapter interface driver
Siemens S7 TeleService interface
Siemens S7 using SICOS protocol and S7 functions
Siemens Simatic / TI500 Series & Texas Instruments 500 Series
Siemens Simatic S5 AS511
Siemens Sinec H1 (SICOS protocol)
Siemens Sinec L2 (FDL protocol)
Siemens Sinec L2 (SICOS protocol)
SQUARE-D Multidrop COM port protocol driver
Square-D SY/MAX SY/LINK
Stella Primary Net Driver
Stella Secondary Net Driver
TCP/IP driver for MJK Equipment with GPRS interface
Telemechanique Xway (Uni-Telway, Fipway and Ethway)
Teletronic Telelog
TP 5-Tone Radio Driver
VIPA TCP/IP driver
Ørum & Jensen PS4


Add the driver(s)

1. Click **New Driver**.
2. Choose driver.

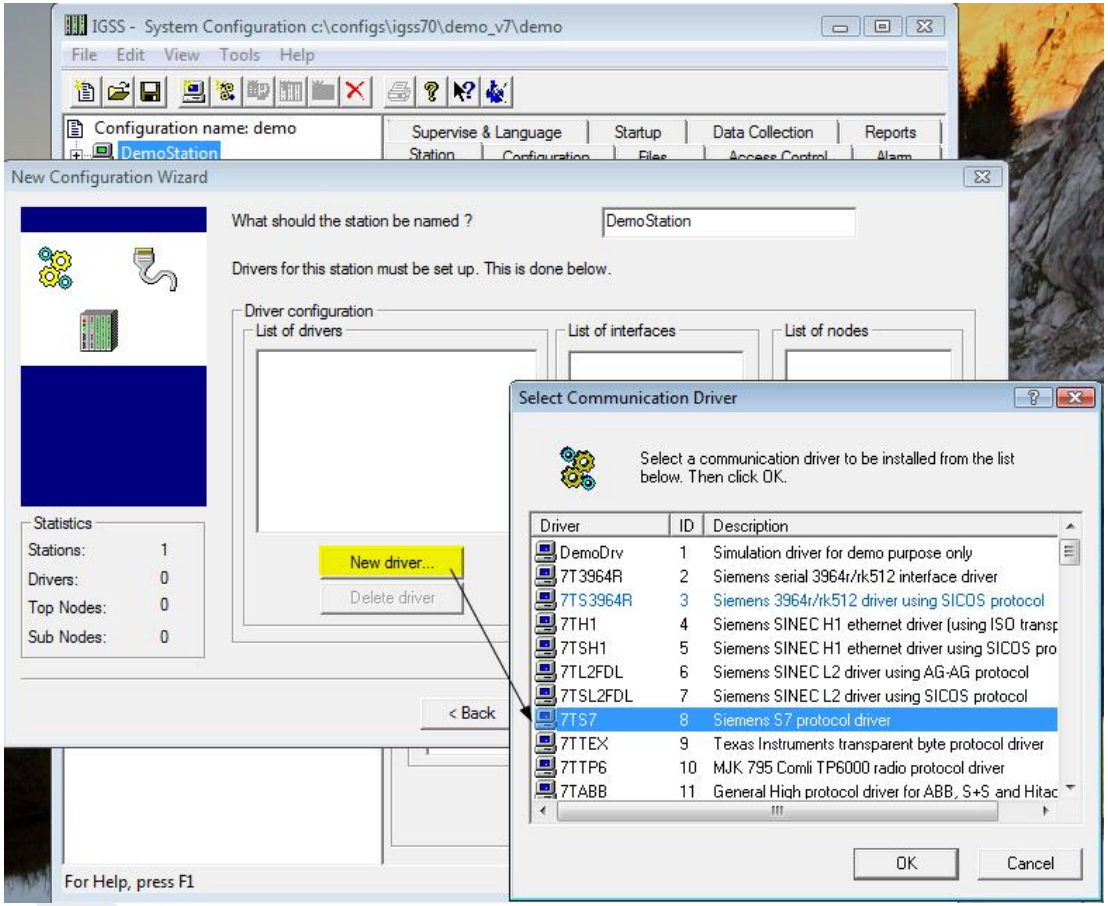

Add operator stations

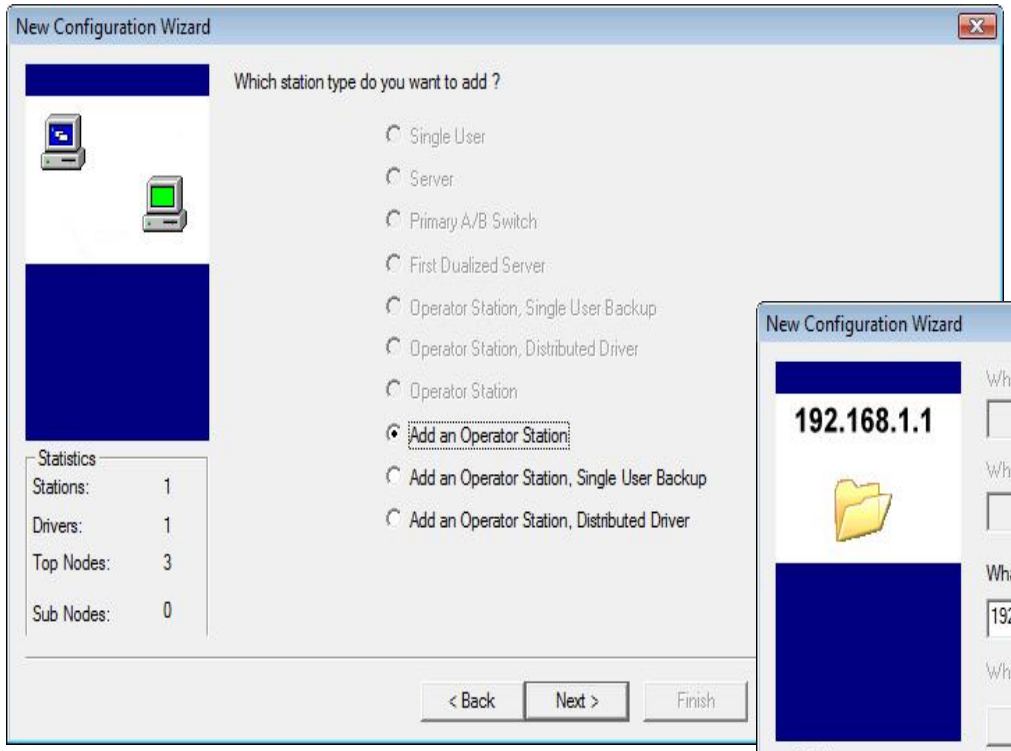


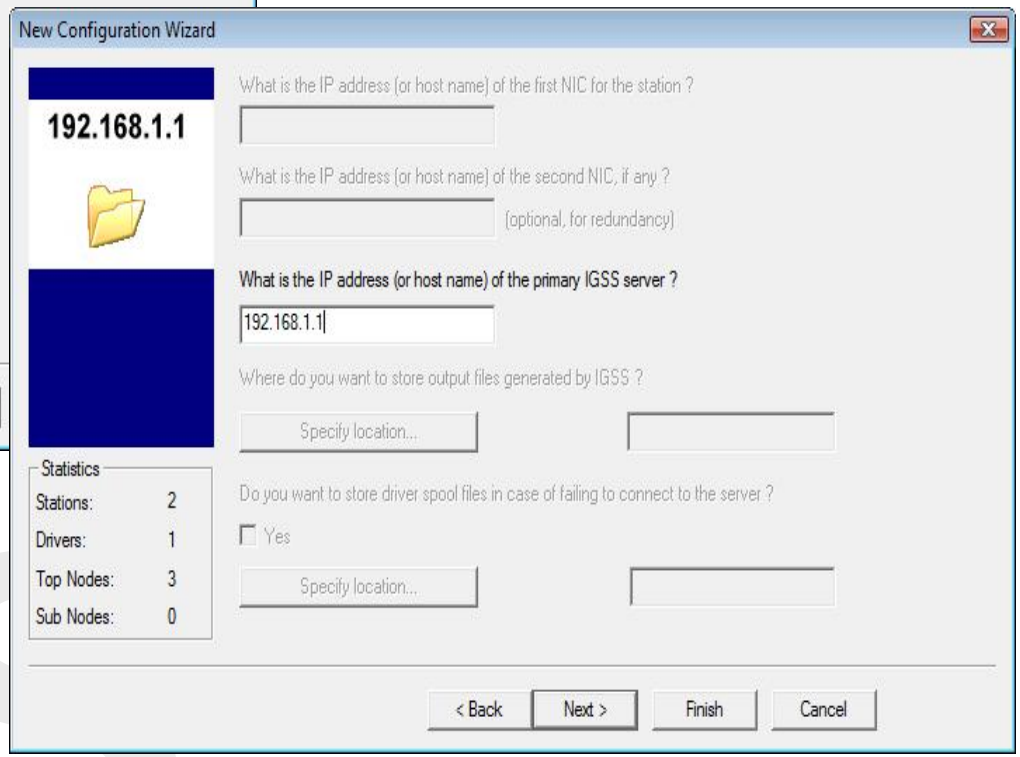


1. Click Add an Operator Station.
2. Specify IP address of IGSS Server.

Final setup in System Configuration

1. Verify that the setup is correct.
2. In the **File** menu, select **Save and Start Definition**.

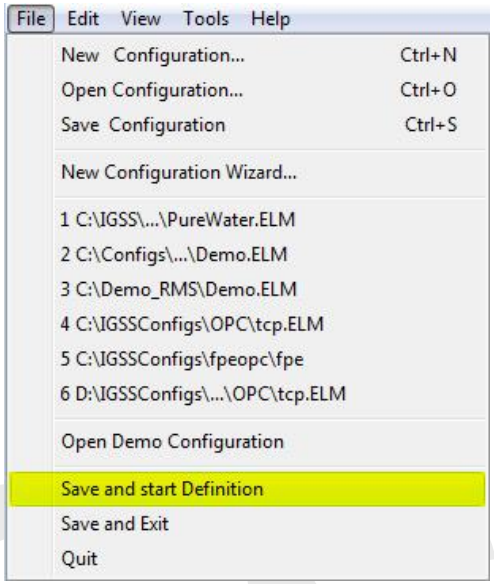

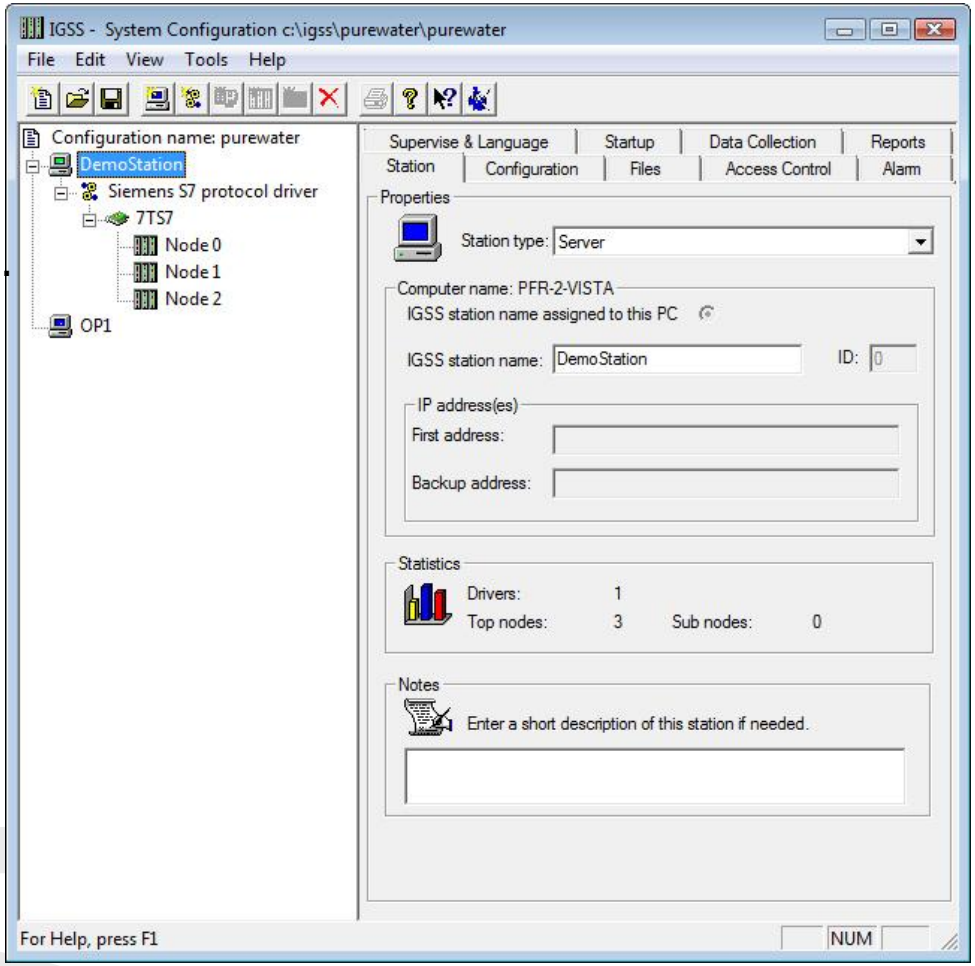

Try it yourself ...



Exercise: Creating a new configuration

Find presentations and exercises on www.7t.dk/igss