

INSTALLATION AND MAINTENANCE INSTRUCTIONS

IM-2-300-US JULY 2011

Float & Thermostatic Steam Traps FT, FTB, FTI, OK, FTS-150, FTS-300

Description and Operation

Spirax Sarco Float & Thermostatic Steam Traps are ideally suited for most HVAC and process applications. The spherical stainless steel float automatically adjusts the position of the main valve so that condensate is discharged continuously at the same rate as it enters the trap. Air and other non-condensible gases which are present at start up or which enter the trap during operation are discharged through the integral balanced pressure thermostatic air vent (some high pressure F & T traps have a bimetal air vent). The traps will operate against any back-pressure lower than the inlet pressure. (The differential pressure—inlet pressure minus outlet pressure—determines the trap's capacity). All Spirax Sarco F & T traps will tolerate at least 450°F of temperature. The superheat tolerance of some models is higher; refer to the appropriate Technical Information Sheet or call Spirax Sarco for further information.

Limiting Operating Conditions

The maximum operating pressure (PMO) is shown on the nameplate. The PMO depends on the valve mechanism; if the pressure at the trap inlet is higher than the PMO, the excess pressure may lock the valve closed. In some cases (for example, if there is a permanent back-pressure in the return line) in may be permissible to exceed the PMO. Please consult Spirax Sarco for details.

The maximum operating temperature depends on the superheat tolerance of the air vent. This is always at least 450°F as the TMA (see below) is not exceeded.

The maximum allowable pressure and temperature (PMA and TMA) are determined by the pressure shell design conditions, and must not be permanently exceeded. The trap may be subjected to a temporary cold hydraulic test pressure of 1-1/2 times the cold PMA, provided that the air vent is first removed. If the test pressure will exceed 600 psi, the float must also be removed.


Installation -

- Before installation, inspection or maintenance, the trap must be isolated from both supply and return line pressure.
- 2. The trap should be installed below the drainage point of the equipment or steam main so that condensate can flow by gravity into the trap. A vertical drop to the trap is advantageous, but long horizontal runs should be avoided because of the possibility of steam locking. If a long horizontal run to the trap is unavoidable, a trap with a steam lock release should be used.
- 3. If possible, a drop leg and dirt pocket should be installed ahead of the trap. The trap should be protected by a Spirax Sarco y-pattern stainer, preferably fitted with a blow down valve. Full-port isolating valves should be installed to permit servicing.
- 4. The trap must be installed in an upright position with the orientation arrow on the body or on the nameplate pointing straight down. The flow direction markings on the body or cover must be observed.
- Before installing the trap, the inlet piping should be carefully blown down to remove any existing debris.
- 6. A Spira-tec® sensor chamber facilitates checking the trap's operation. A check valve downstream of the trap will prevent backflow from the return line.

- 7. If the condensate must be lifted to the return main, the trap, followed by a check valve, should be installed at the bottom of the lift. Sufficient pressure to lift the condensate (approximately 1 psi for each 2 ft. of lift) must be present at the trap inlet at all times.
 - Note that a temperature control valve on the inlet steam may at times reduce the pressure below the amount required to lift the condensate. When the inlet steam is controlled and condensate must be lifted after the trap, a Spirax Sarco Pressure Powered Pump™ should be considered.
- 8. Bypass piping is not recommended because of the possibility of misuse. If continuous service is required, a second trap could be piped in parallel with suitable valving to allow one trap to be serviced while the other remains in operation. If a bypass line must be used, it should be at least one pipe size smaller than the trap.
- 9. Because condensate cannot drain completely from the body, an F & T trap installed outdoors can freeze up if it is not in continuous operation. If there is a possibility of an interruption in the steam supply, provisions should be made for draining or tracing the trap body.
- **10.**The trap can be put into service by slowly opening the isolating valves. No priming is necessary.

Horizontal Inline Type Bypass if required Str. C.V.

Parallel Trap Installation (No Bypass)

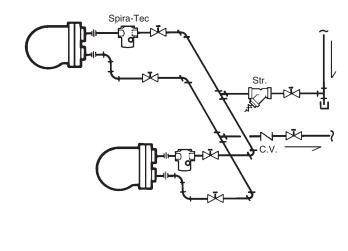

Maintenance

- After isolation from supply and return line pressure, all Spirax Sarco F & T traps can be serviced without disturbing the piping connections. On some models the cover with mechanism attached can be removed for servicing while the body remains in the pipeline.
- On most models, dirt and sludge which may accumulate in the trap can be removed by "blowing down" through the drain plug in the bottom of the body.
- The trap should be disassembled periodically for inspection and replacement if necessary of the valve mechanism and air vent.
- 4. Ensure that the trap is properly isolated, and that any pressure which may remain in the trap is relieved before the trap is opened. This can be accomplished by opening the blowdown valve on the upstream strainer and waiting until the trap has cooled. Some condensate will remain in the trap body. This can be drained by removing the drain plug or by cracking the body-cover joint.
- 5. Remove and save the cover bolts, and remove the body or cover. Using a suitable solvent, clean all dirt and incrustation from the body, cover and mechanism. Inspect the body and cover for condensate corrosion.

- 6. Inspect the valve head and seat for damage, wear or wiredrawing. Replace the mechanism if necessary, using a complete valve mechanism kit and following the instructions included with the kit.
- 7. Inspect the float for leakage or damage, and replace if necessary. A distorted or collapsed float is evidence of a severe and dangerous overpressure or waterhammer condition which must be corrected before the trap is returned to service.
- 8. The air vent should be removed, tested for proper operation, and replaced if necessary. Instructions are included with the air vent kit.
- 9. Remove all traces of the old gasket from the body and cover, and ensure that the gasket surfaces are clean and undamaged. Using a new cover gasket, reassemble the trap. Tighten the cover bolts to the torque shown on page 3.
- **10.**The trap can be returned to service by slowly opening the isolating valves. Priming is not required.

Note: Flash steam is formed when a portion of the hot condensate re-evaporates as it passes from a higher to a lower pressure (for example, as it flows through a steam trap). This flash steam is normal, and it should not be mistaken for live steam leakage when the operation of the trap is being observed.

Spare Parts

The following spare parts are available for Spirax Sarco Float & Thermostatic Steam traps:

Valve Mechanism Kit - Complete valve mechanism with gasket and mounting screws as required.

Gasket Kit - Three each of cover and mechanism gaskets.


Air Vent Kit - Air vent assembly.

Replacement Kit - Valve mechanism with gasket, float with screw and washer, air vent assembly, cover gasket.

Float Kit - Float with screw and lockwasher as required.

Note: In some models, the float is welded to the mechanism arm, and is included in the valve mechanism kit. A separate float kit is not available.

| | | Spare Parts Kits* | | | Torque Values ft•lb | | Τ | |
|----------------------------------|----------|----------------------------|---------------------------|------------------------------|---------------------|----------------|-------------------------------|---------------|
| Model | | Size(s) | Valve Mechanism Kit | Gasket Kit | Float Kit | Cover Bolts | Valve Seat or mounting screws | TIS Number |
| | | 3/4",1" | 54749 | 55475 | 55448 | 11-14 | 27-31 | <u> </u> |
| FT-15 | | , , , , | Replacement Module: 67908 | | | | |] |
| | | 1-1/4" | 54752 | 55475 | 55447 | 11-14 | 34-37 | |
| | | | | acement Module: 67 | | | | _ |
| | | 1-1/2" | 58131 | 58127 | 58129 | 17-21 | 90-95 | |
| | | 2 | 58135 | 58128 | 58130 | 4444 | 118-122 | - |
| | | 3/4", 1" | 54749 | 55475 lacement Module: 68 | 55447 | 11-14 | 27-31 | |
| FT-30 | | 1-1/4" | 58139 | 55475 | 55447 | 11-14 | 34-37 | - |
| | | 1-1/4 | Replacement Module: 68595 | | | 11-14 | 34-37 | 2.313 |
| | | 1-1/2" | 58132 | 58127 | 58129 | 17-21 | 90-95 | |
| | | 2 | 58136 | 58128 | 58130 | | 118-122 | |
| | | 3/4", 1" | 54750 | 55475 | 55447 | 11-14 | 27-31 | 1 |
| FT-75 | | | Rep | lacement Module: 68 | 593 | | | |
| | | 1-1/4', 1-1/2" | 58133 | 58127 | 58129 | 17-21 | 90-95 | |
| | | 2" | 58137 | 58128 | 58130 | | 118-122 | _ |
| FT-125 | | 3/4", 1" | 54751 | 55475 | 55447 | 11-14 | 27-31 | |
| | | 4 4/4" 4 4/0" | | acement Module: 68 | | 47.04 | 00.05 | |
| | | 1-1/4", 1-1/2" | 58134 59139 | 58127 | 58129 | 17-21 | 90-95 | |
| | 15 | 2 | 58138 54749 | 58128 | 58130 55448 | | 118-122 | 1 |
| FTI | 30 | | 54749 | | 55447 | | | |
| | 75 | 1/2", 3/4", 1" | 54750 | 67049 | 55447 | 17-21 | 27-31 | 2.321 |
| | 125 | 172,074,1 | 54751 | 07040 | 55447 | 17 21 | 27 01 | 2.021 |
| | 200 | | 67048 | | 55447 | | | |
| | 15 | | 74323 | | | | | |
| FTI | 30 | 1-1/2" | 74324 | 74327 | 74328 | 80-85 | 90-95 | 2.321 |
| | 75 | | 74325 | | | | | |
| | 125 | | 74326 | | | | | |
| | 200 | | 74326 | | | | | |
| FT-150 FT-200 | | 3/4", 1" | 80087 | 55481 | 55447 | 17-21 | 8-11 | 0.014 |
| | | 1-1/4", 1-1/2" | 80090 | 55482 | 58130 | 27-31 | 0.44 | 2.314 |
| | | 3/4", 1" 1-1/4", 1-1/2" | 81850 80091 | 55481 55482 | 55447 58130 | 17-21 27-31 | 8-11 | |
| FTB-20 | | 2" | 58152 | 55479 | 58159 | 17-21 | 150-155 | |
| FTB-30 | | 2" | 58177 | 58173 | 58160 | 85-90 | 53-55 | - |
| FTB-125 | | 2-1/2" | 58177 | CI 58173/CS 68806 | 58160 | 85-90 | 53-55 | 2.315 |
| FTB-200 | | 2-1/2" | 58158 | 68806 | 58160 | 85-90 | 16-19 | 2.322 |
| FTB-50 | | 1-1/2" | 58179 | 58180 | 58129 | 23-27 | 8-11 | |
| FTB-175 | | 2" | 61044 | 55479 | 58159 | 23-27 | 8-11 | |
| | | 2-1/2" | 58158 | 58173 | 58160 | 85-90 | 16-19 | |
| FTB-200 | | 1-1/2" | 58179 | 74122 | 74123 | 27-31 | 8-11 | 2.315 |
| OK 150, FTS150 OK 300, FTS300 | | 1/2" | 63353 | 66576 | 55447 | 15-17 | 17-19 | 2.312 |
| OK 300, F | | | 63354 | | | | | |
| FT450- | 4.5 | 3/4" | 66379 66380 | 66392 | N/A | 27-31 | 27-31 | |
| | 10 14 | | 66381 | | | | | |
| | 21 | | 66382 | | | | | |
| | 32 | | 66383 | | | | | |
| FT450- | 4.5 | 1" | 66384 | 66392 | N/A | 27-31 | 27-31 | 1 |
| | 10 | | 66385 | | | | | |
| | 14 | | 66386 | | | | | |
| | 21 | | 66387 | | | | | |
| | 32 | | 66388 | | | | | |
| FT450- | 4.5 | 1-1/2" | 66395 | 66393 | 62541 | 80-85 | 7-9 | 2.304 |
| | 10 | | 66396 | | | | | |
| | 32 | | 66397 | | | | |] |
| | 4.5 | | 66389 | | | | | |
| FT450- | 10 | 2" | 66390 | 66394 | 62541 | 93-97 | 15-18 | |
| | 32 | | 66391 | | | | | |

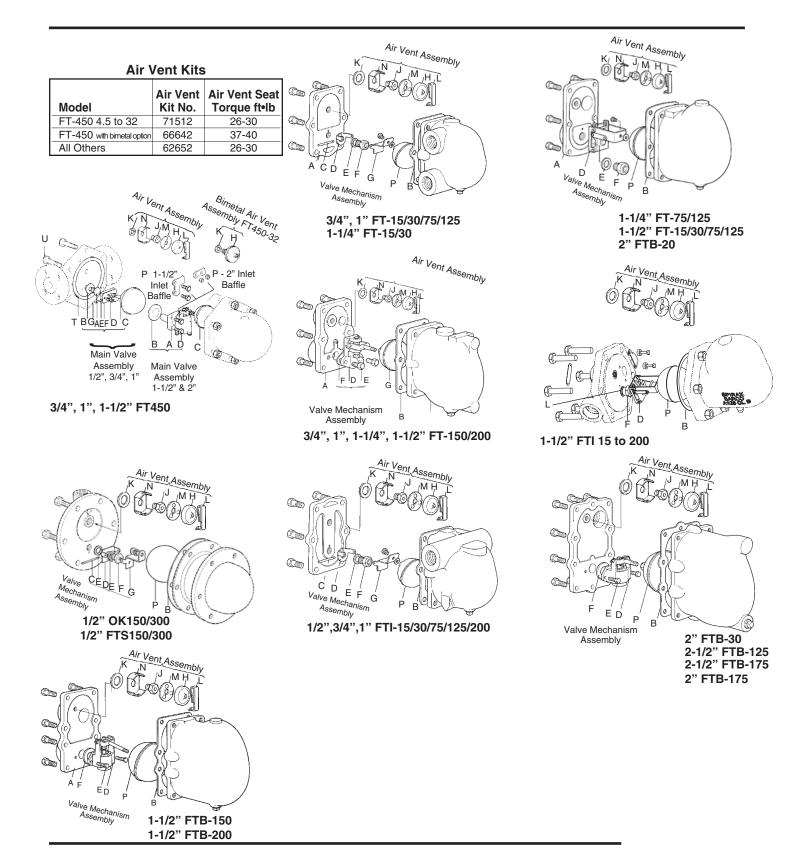

For any additional information you may require, contact: Spirax Sarco Applications Engineering Department Toll Free 1-800-833-3246

spirax sarco