

Sample Report 1 and Sample Report 2
provide examples of spirometry tests which meet these standards.

Practice Name: xx

ID: XXXYZZZ00/12 Age: 40 (30/06/1977)


| | | | | |
|-----------------|-------------------|-----------|---------------------|--------------|
| Gender | Male | Height | 158.0 cm | |
| Ethnicity | South-East Asian | Weight | 45 kg | BMI 18 |
| Test date | 24/4/18 9:28 | | | |
| Post Time | 24/4/18 9:43 | Reference | Quanjer (GLI), 2012 | BTPS (IN/EX) |
| Test Indication | Health assessment | | | |

Pre Best

Post Best

| Parameter | Pred | LLN | Trial 3 | Trial 2 | Trial 1 | %Pred | Trial 2 | Trial 1 | Trial 3 | %Pred | %change |
|-----------------|-------|-------|---------|---------|---------|-------|---------|---------|---------|-------|---------|
| FVC [L] | 3.5 | 2.76 | 3.89 | 3.89 | 3.8 | 111 | 3.82 | 3.82 | 3.76 | 109 | -2 |
| FEV1 [L] | 2.96 | 2.32 | 2.29* | 2.28* | 2.24* | 77 | 2.35 | 2.32* | 2.31 | 79 | 3 |
| FEV1/FVC | 0.844 | 0.751 | 0.589* | 0.586* | 0.590* | 70 | 0.615* | 0.608* | 0.614* | 71 | 1 |
| FEF25-75% [L/s] | 3.3 | 2.03 | 1.25* | 1.27* | 1.31* | 38 | 1.36* | 1.36* | 1.40* | 41 | 9 |
| PEF [L/s] | - | - | 5.07 | 4.77 | 4.68 | - | 5.02 | 4.75 | 4.61 | - | -1 |
| FET [s] | - | - | 6.2 | 6 | 6.1 | - | 6.4 | 6 | 6.1 | - | 3 |

* Indicates value is outside the normal range

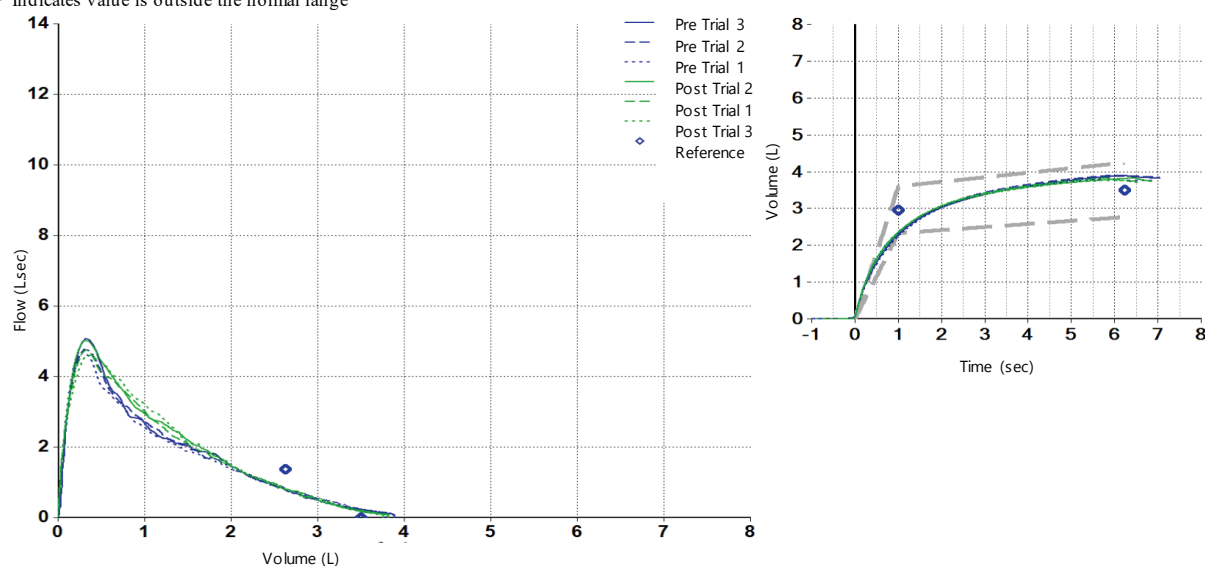

Operator comments: Test performed well. The worker did not take bronchodilator today.

Sample 2: Bronchodilator Responsiveness spirometry report