


PULSAR P&ID rev.11

PR	Pressurant Loop	100-199
OX	Oxidizer Loop	200-299
FU	Fuel Loop	300-399
S	Supply Loop	400-499

TUBING MATERIAL	
—	1/2" Hardline Stainless
—	1/4" Flex Nylon
—	Flex DymePSI
—	Ambient

LINE MEDIUM	
—	Argon Gas
—	Liquid Nitrous, Argon Gas
—	Liquid Ethanol, Argon Gas
—	Liquid Nitrous

	Pressure Regulator REG
	Manual Valve MV
	Pneumatic Valve PV
	Solenoid Valve SV
	Pressure Relief PRV
	Visual Gauge VG
	Press Transducer PT
	Thermocouple TC
	Check Valve CV
	Filter FIL

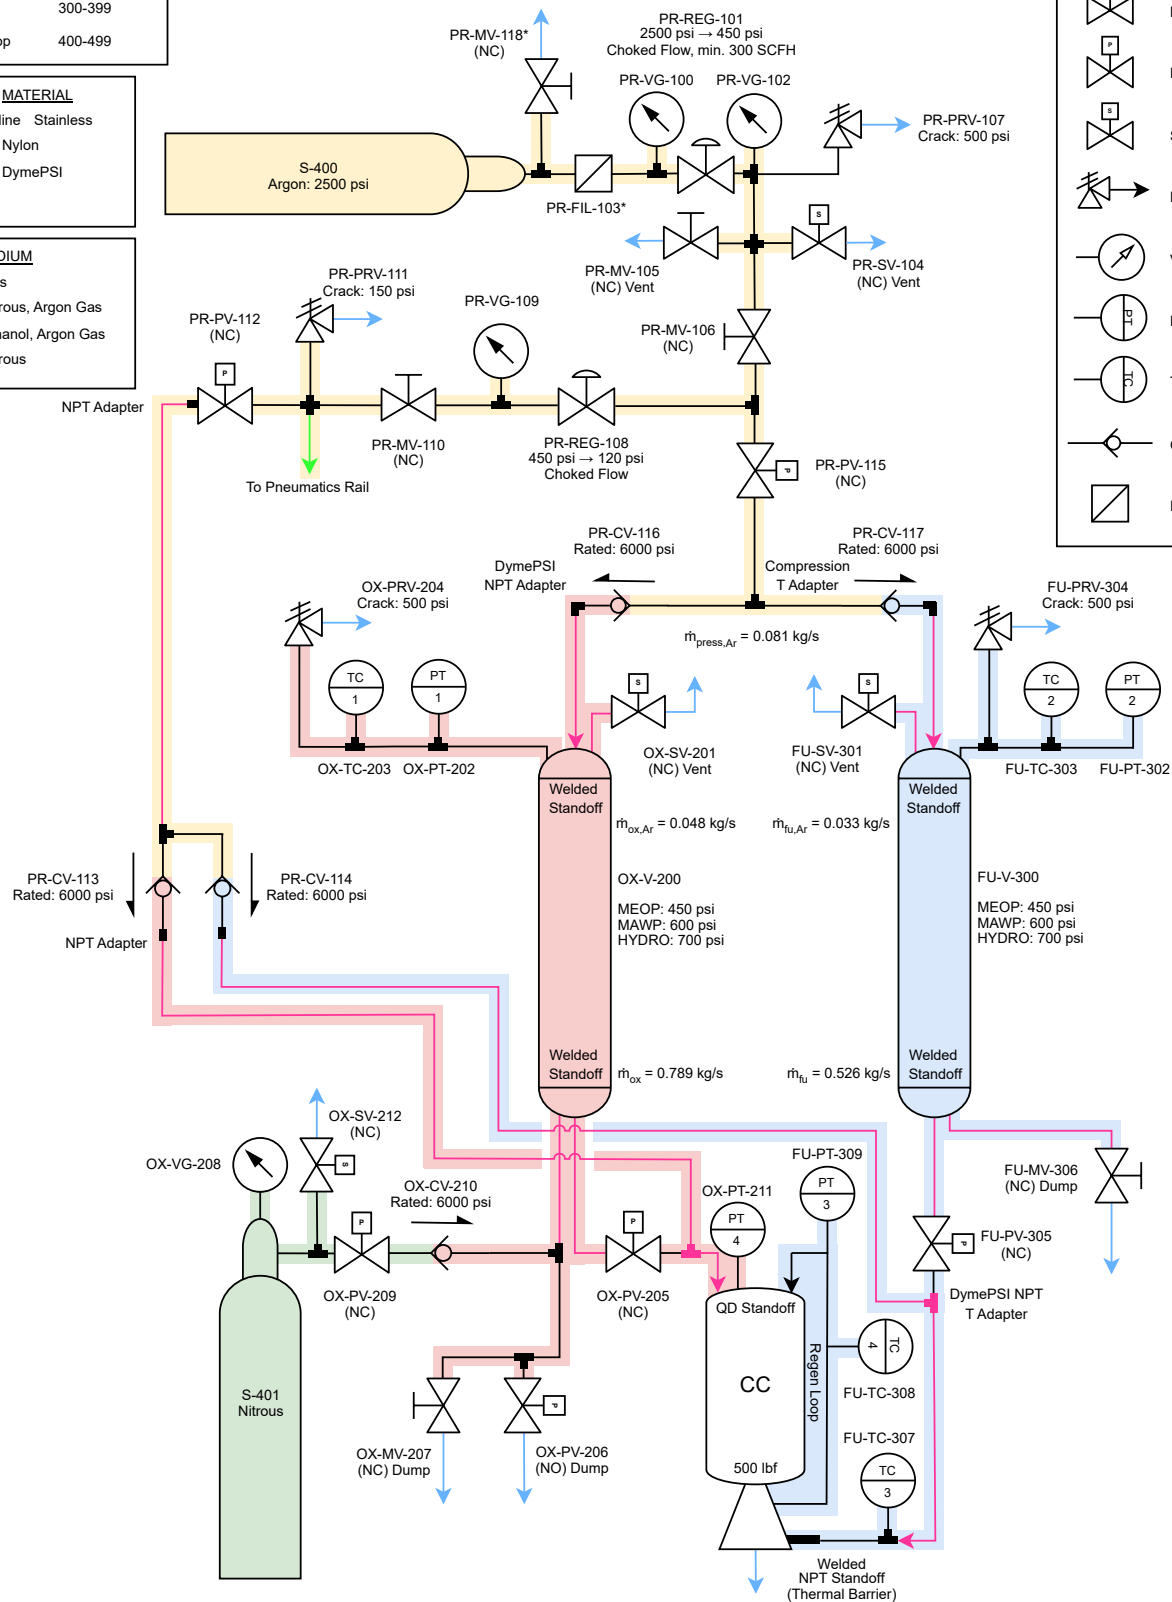

Note:

PR-MV-118* may not be necessary only if PR-REG-101 is self venting.

PR-FIL-103* may not be necessary only if PR-REG-101 has an internal filter