

NOTE:  
IT IS THE OWNERS RESPONSIBILITY TO  
PROVIDE ADEQUATE HEAT (40 DEGREES F)  
AND FOR MAINTAINING THE SPRINKLER  
SYSTEM PER NFPA 25


[illegible]

SEAL:



**Professional Fire Systems Inc.**  
**200 Stonewall Blvd. Suite 2A**  
**Wrentham, Ma. 02093**

**P=(508)384-2001    F=(508)384-2551**

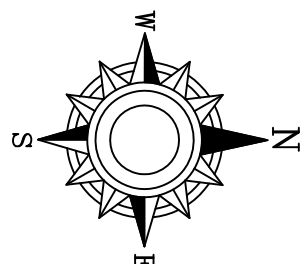


DATE: 8/21/14  
SCALE: 3/32" = 1'-0"  
DRAWN BY: J.LAWTON  
CONTRACTOR: TOCCI BUILDING COMPANIES

111 Boylston Street  
Brookline, MA



DRAWING 4 OF 7

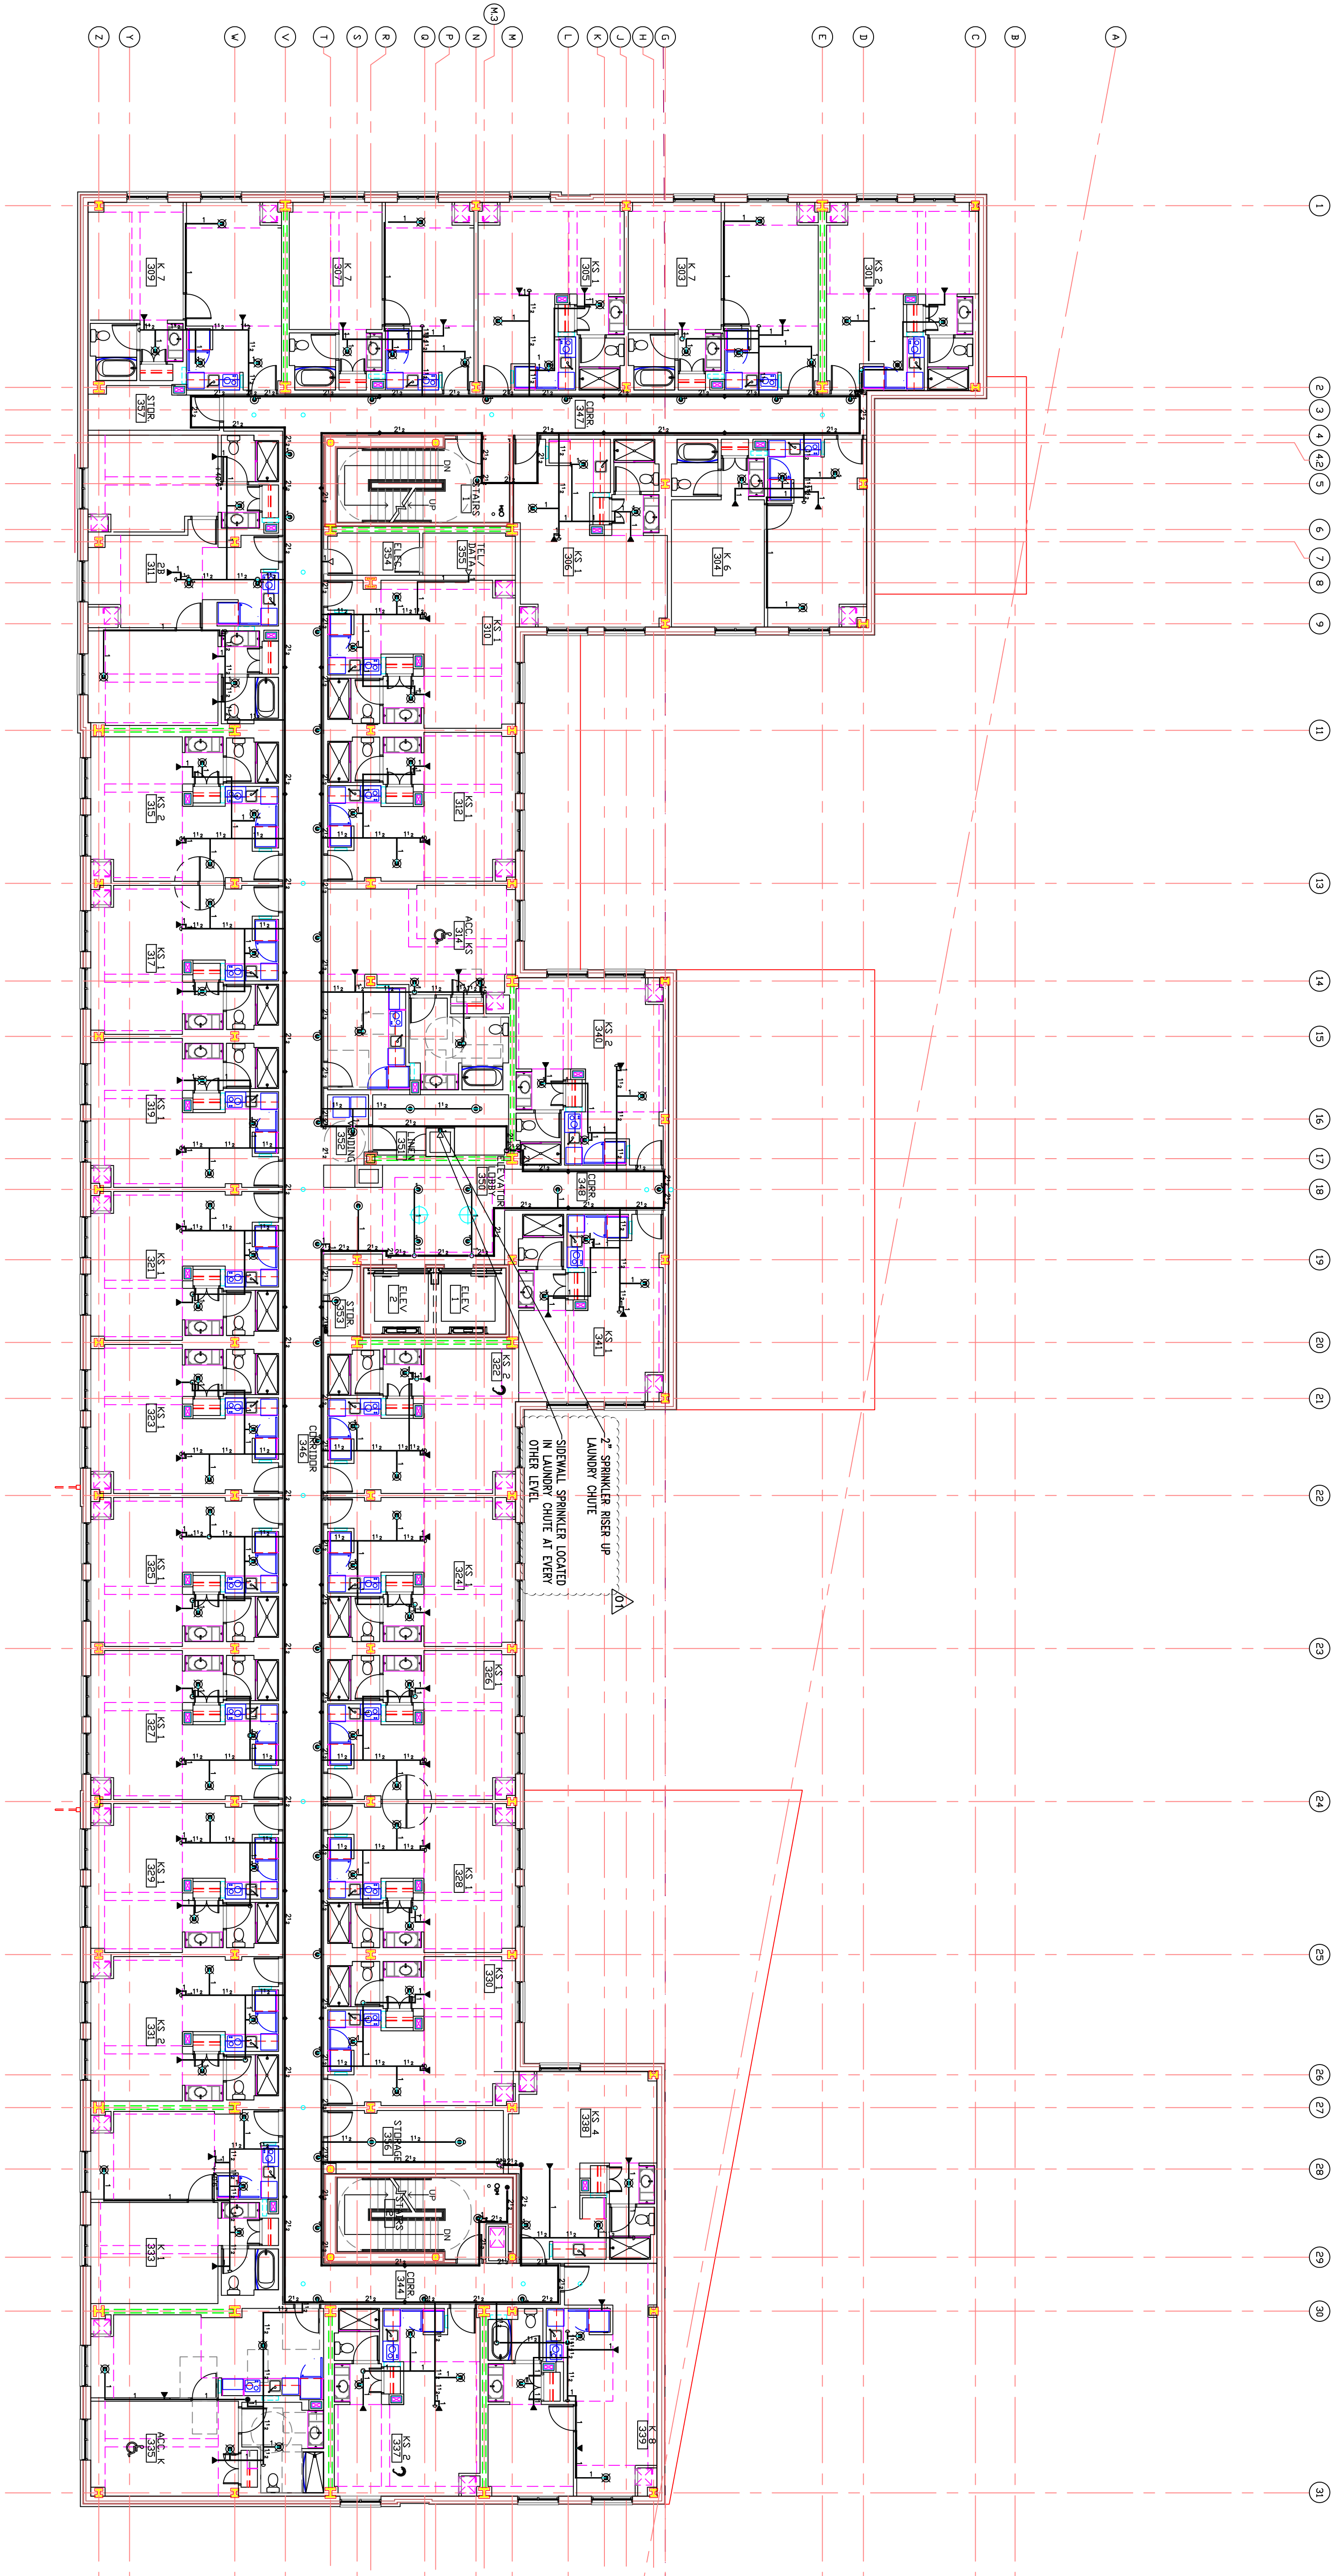

THIRD FLOOR SPRINKLER PLAN  
SCALE: 3/32" = 1'-0"