


NOTE:
IT IS THE OWNERS RESPONSIBILITY TO
PROVIDE ADEQUATE HEAT (40 DEGREES F)
AND FOR MAINTAINING THE SPRINKLER
SYSTEM PER NFPA 25

[illegible]


Professional Fire Systems Inc.
107 South St
Hopkinton, MA 01748
P=(508)625-1840 F=(508)625-1831

P:\ENGINEERING\ProFire Logo.jpg

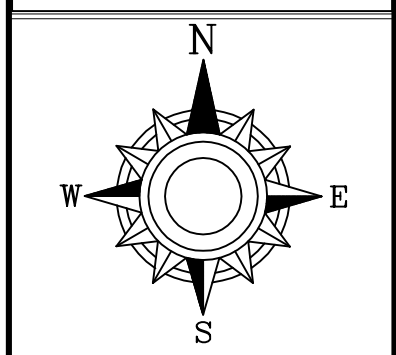

SEAL	
DATE:	1/7/15
DRAWN BY:	JLAWTON
CONTRACTOR:	TOCCI

PROJECT: **HOMEWOOD SUITES
PARKING GARAGE
COORDINATION DRAWING**

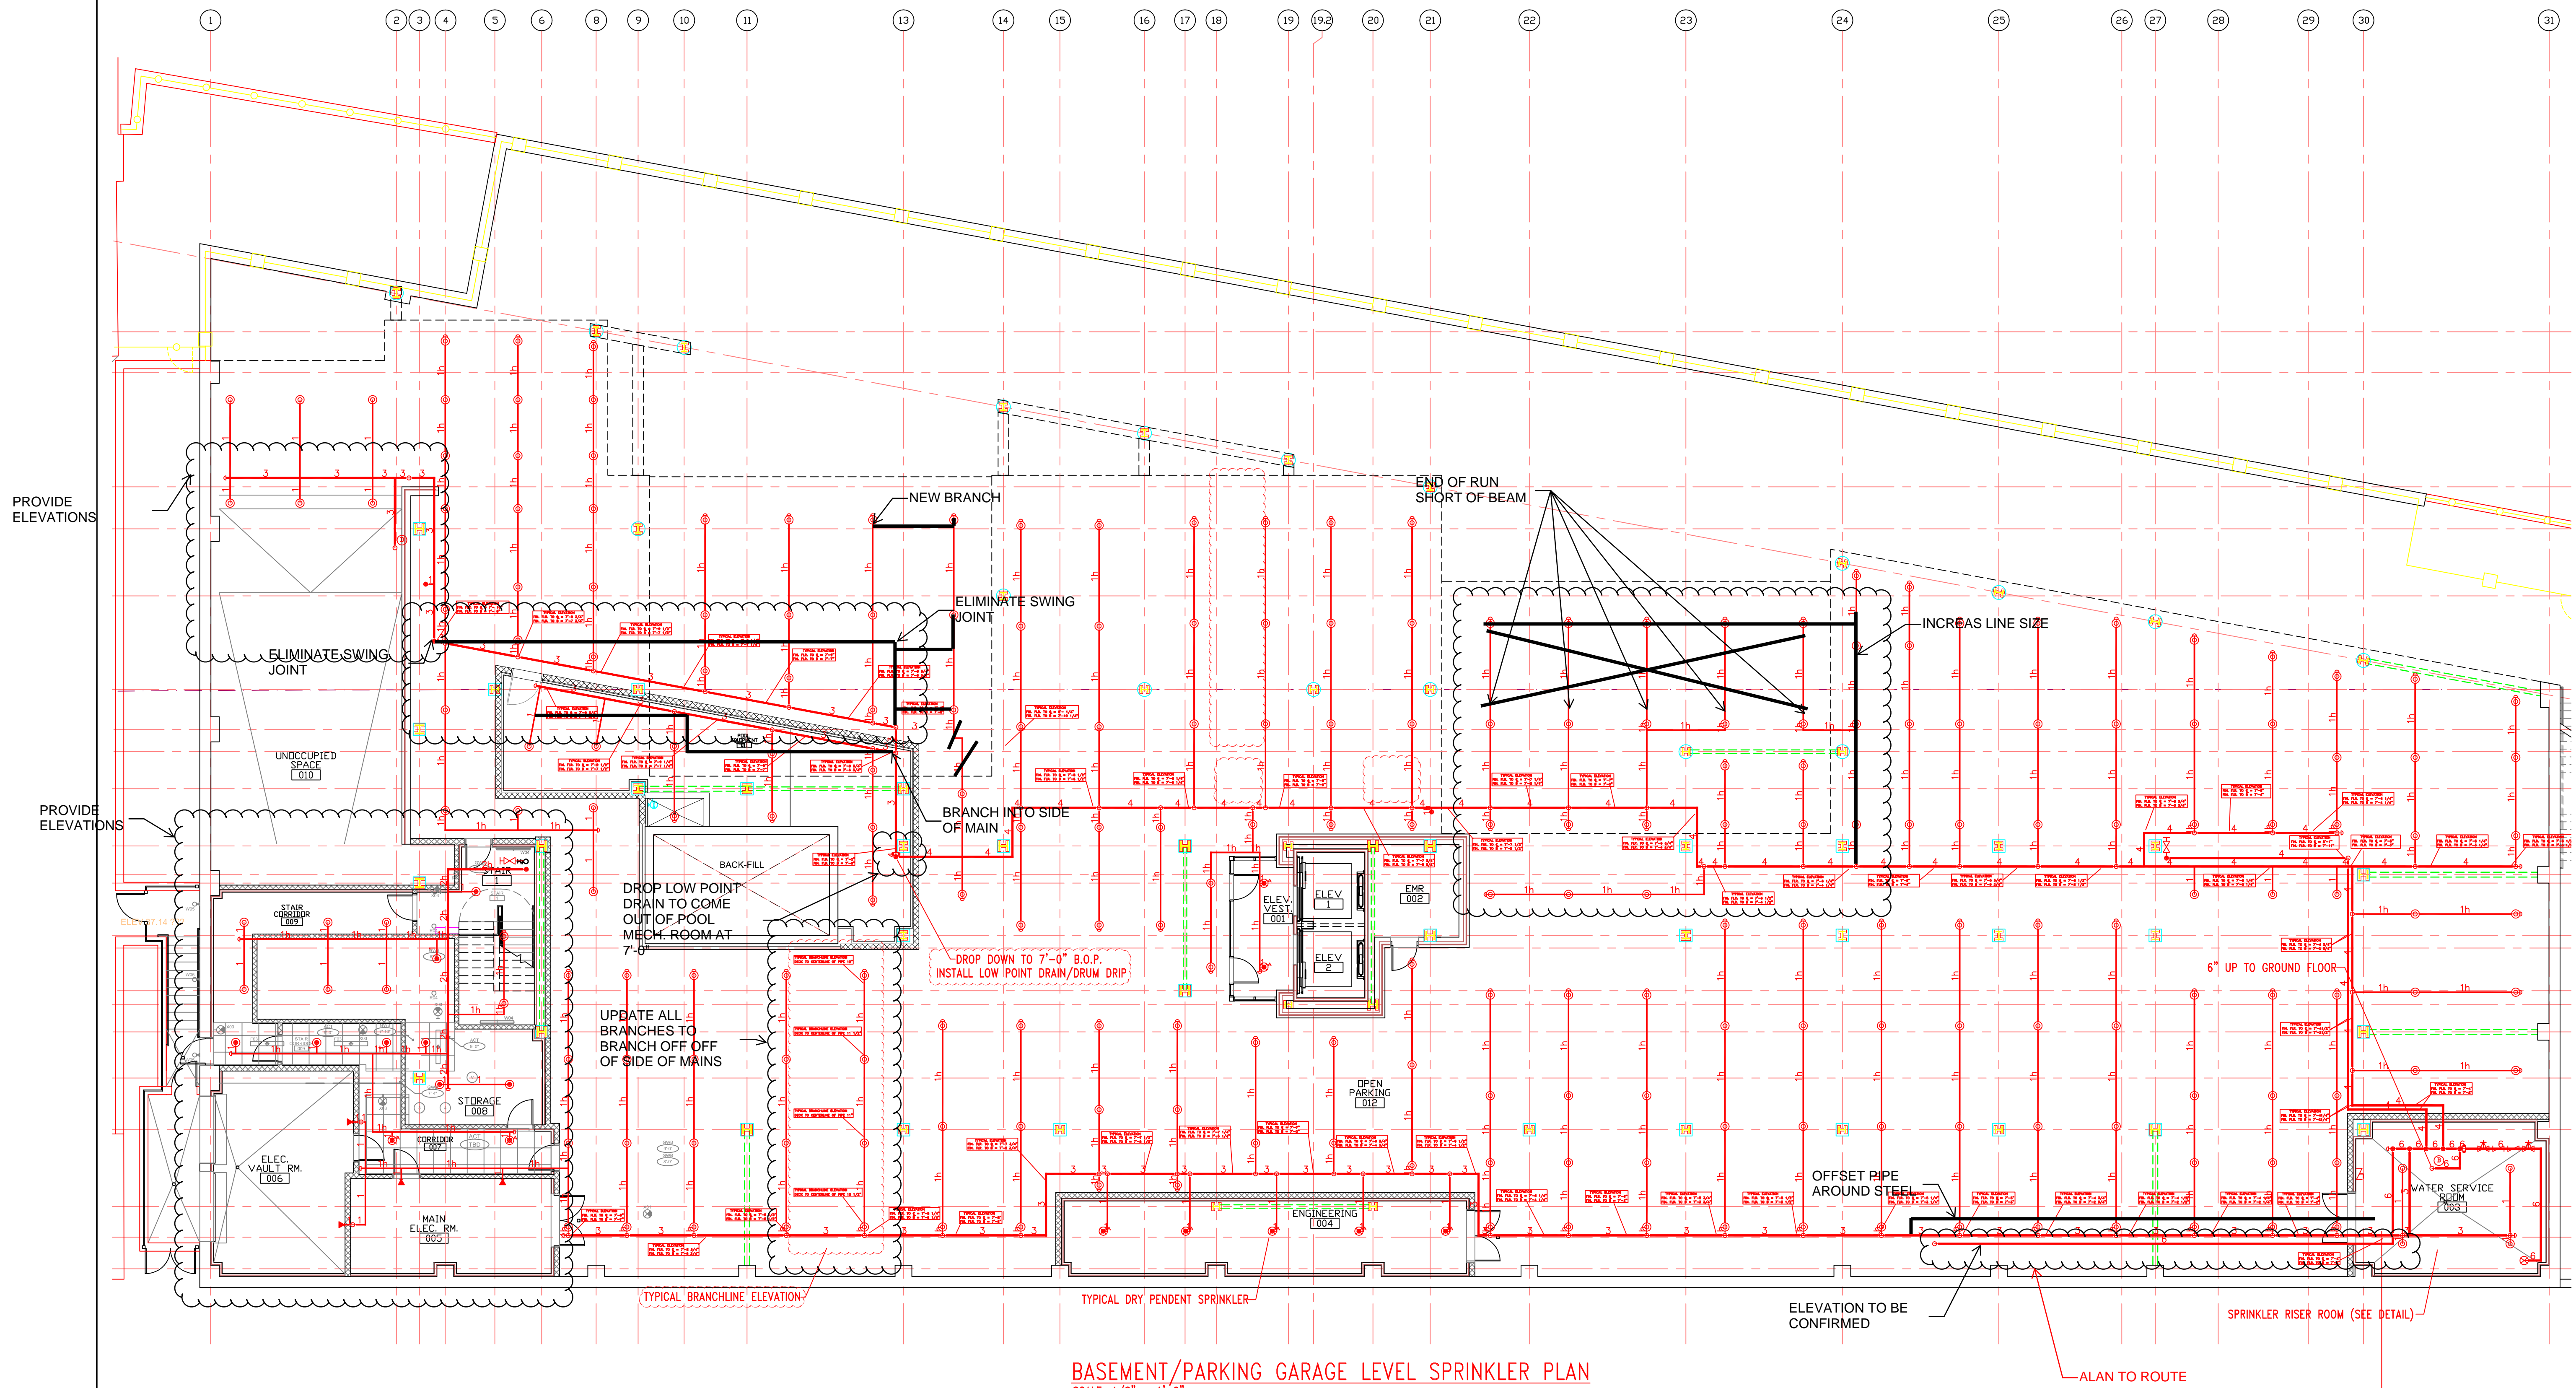

BASEMENT/PARKING GARAGE LEVEL SPRINKLER PLAN
SCALE: 1/8" = 1'-0"