


NOTE:
IT IS THE OWNERS RESPONSIBILITY TO
PROVIDE ADEQUATE HEAT (40 DEGREES F)
AND FOR MAINTAINING THE SPRINKLER
SYSTEM PER NFPA 25

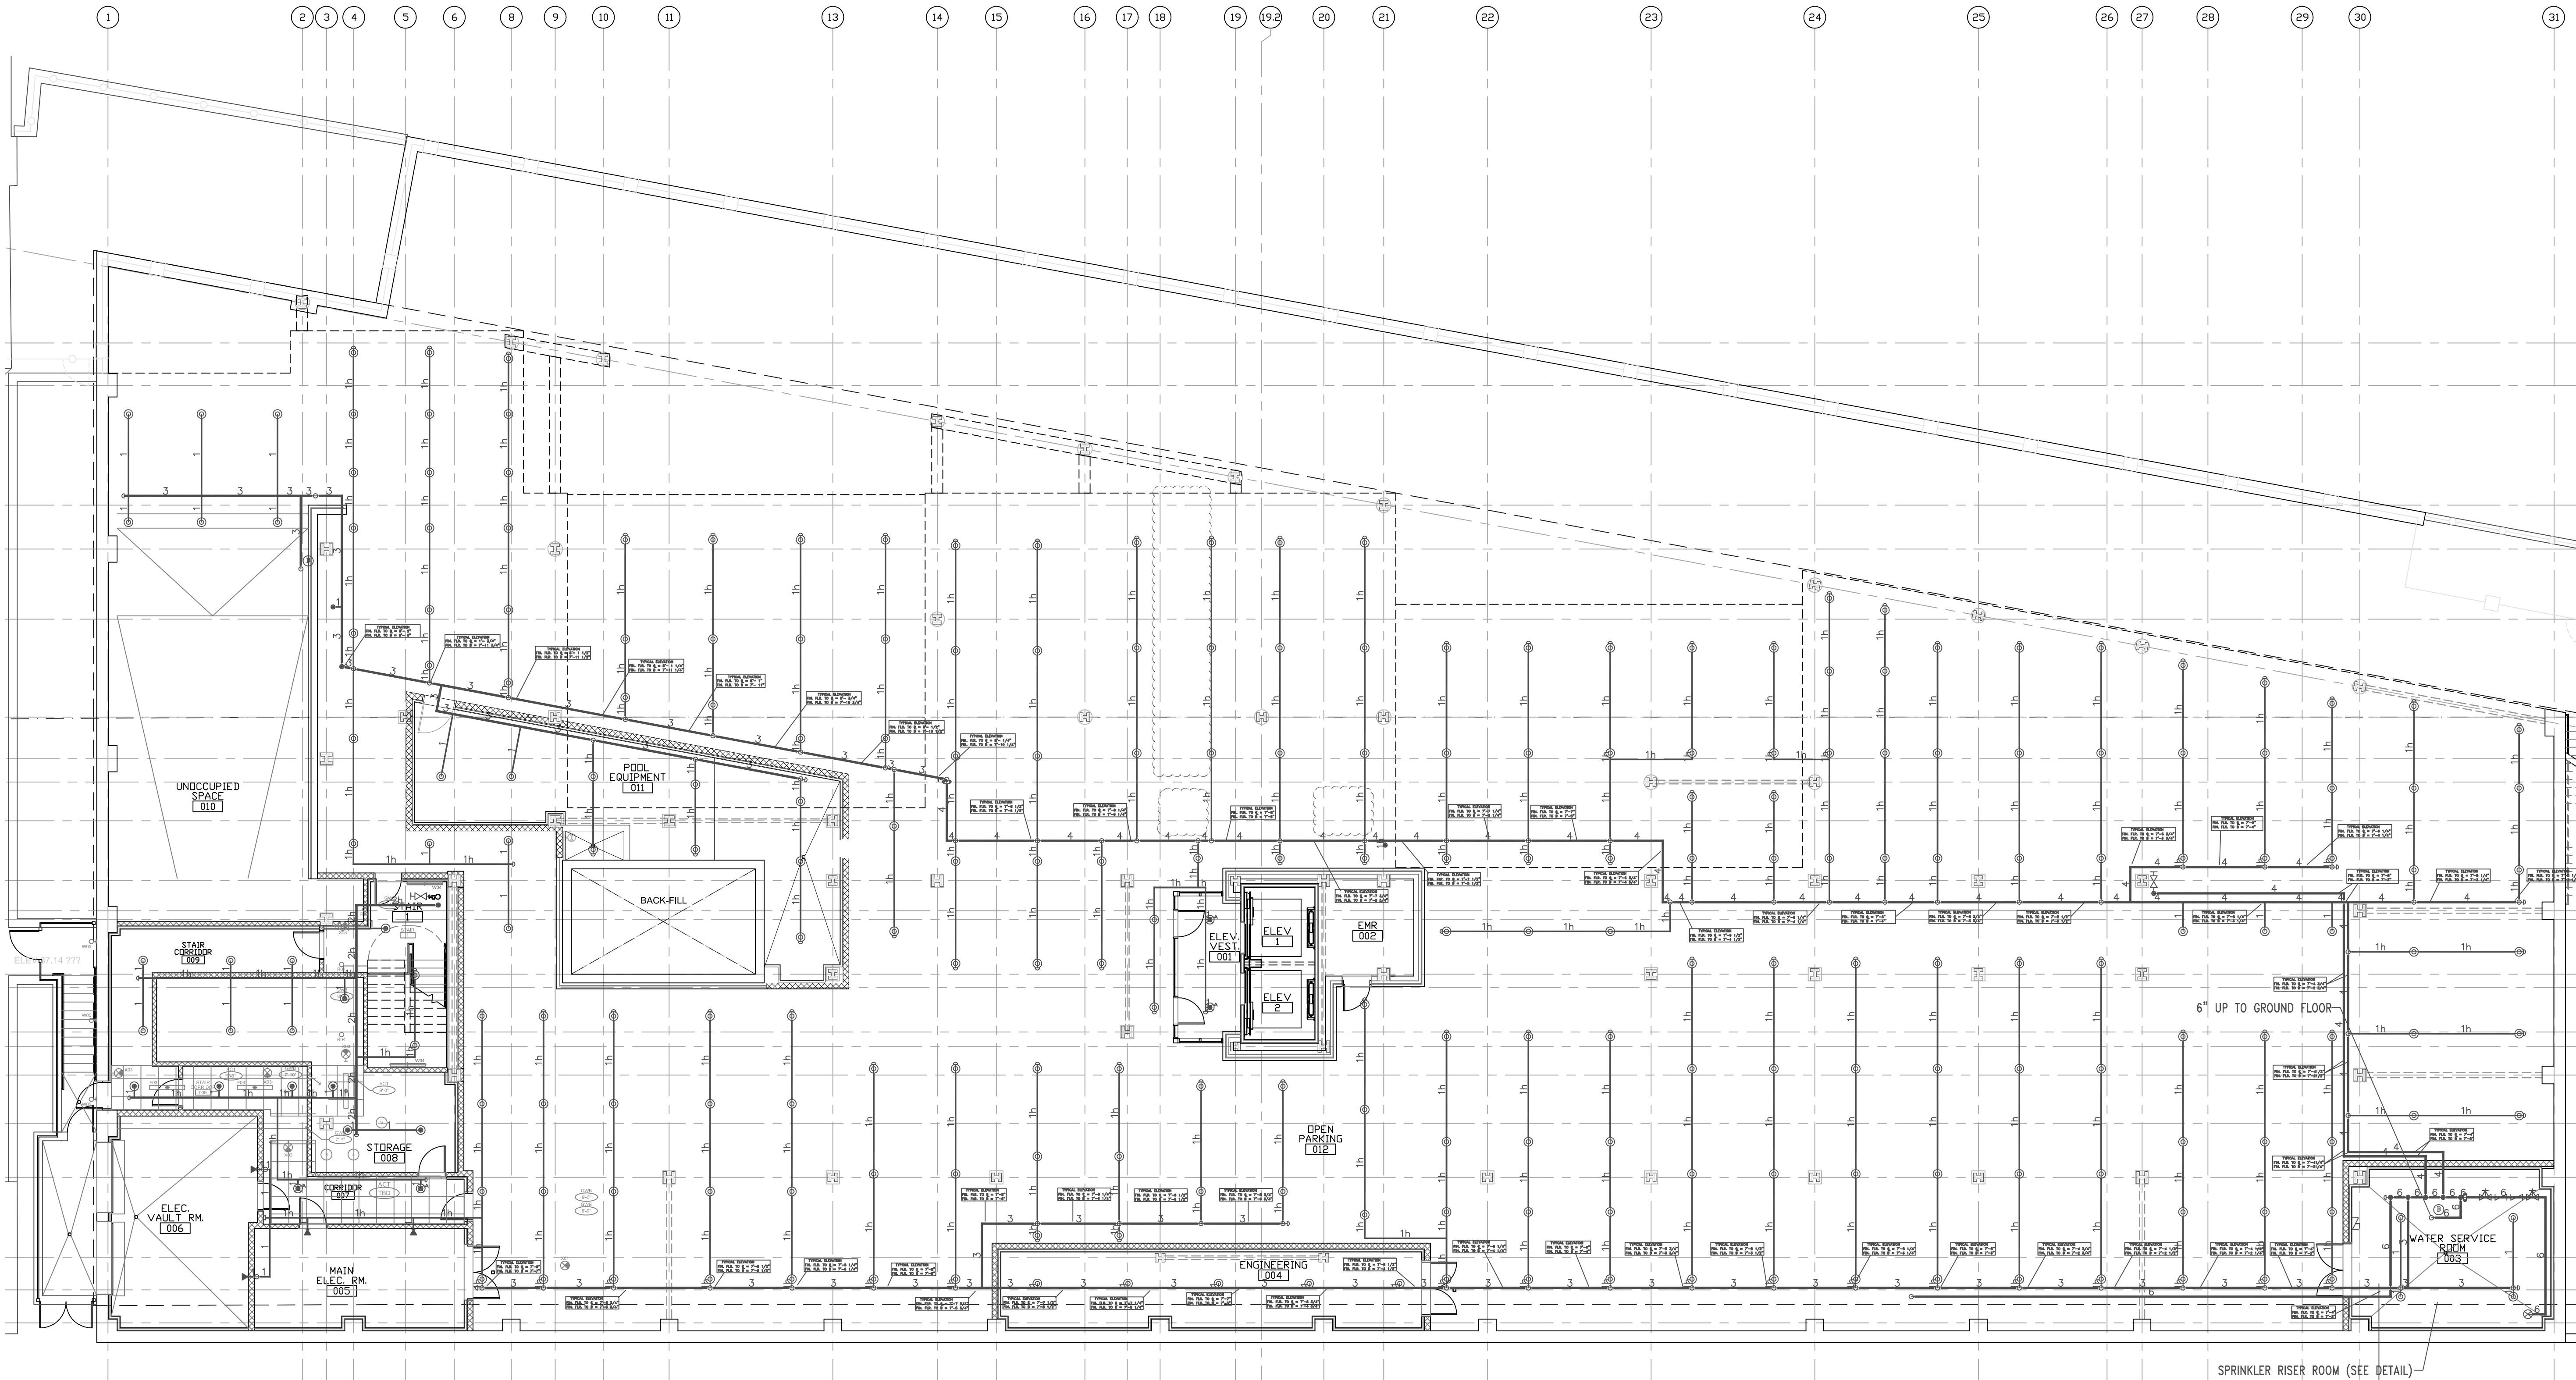

BASEMENT/PARKING GARAGE LEVEL SPRINKLER PLAN
SCALE: 1/8" = 1'-0"

REVISIONS

DESCRIPTION

DATE


Professional Fire Systems Inc.

107 South St

Hopkinton, MA 01748

P=(508)625-1840 F=(508)625-1831

P:\ENGINEERING\ProFire Logo.jpg

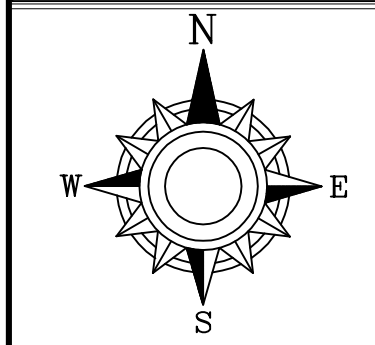

SEAL

DATE:

1/7/15

DRAWN BY:

JLAWTON

CONTRACTOR:

TOCCI

PROJECT:

HOMWOOD SUITES

PARKING GARAGE

COORDINATION DRAWING