


NOTE:  
IT IS THE OWNERS RESPONSIBILITY TO  
PROVIDE ADEQUATE HEAT (40 DEGREES F)  
AND FOR MAINTAINING THE SPRINKLER  
SYSTEM PER NFPA 25

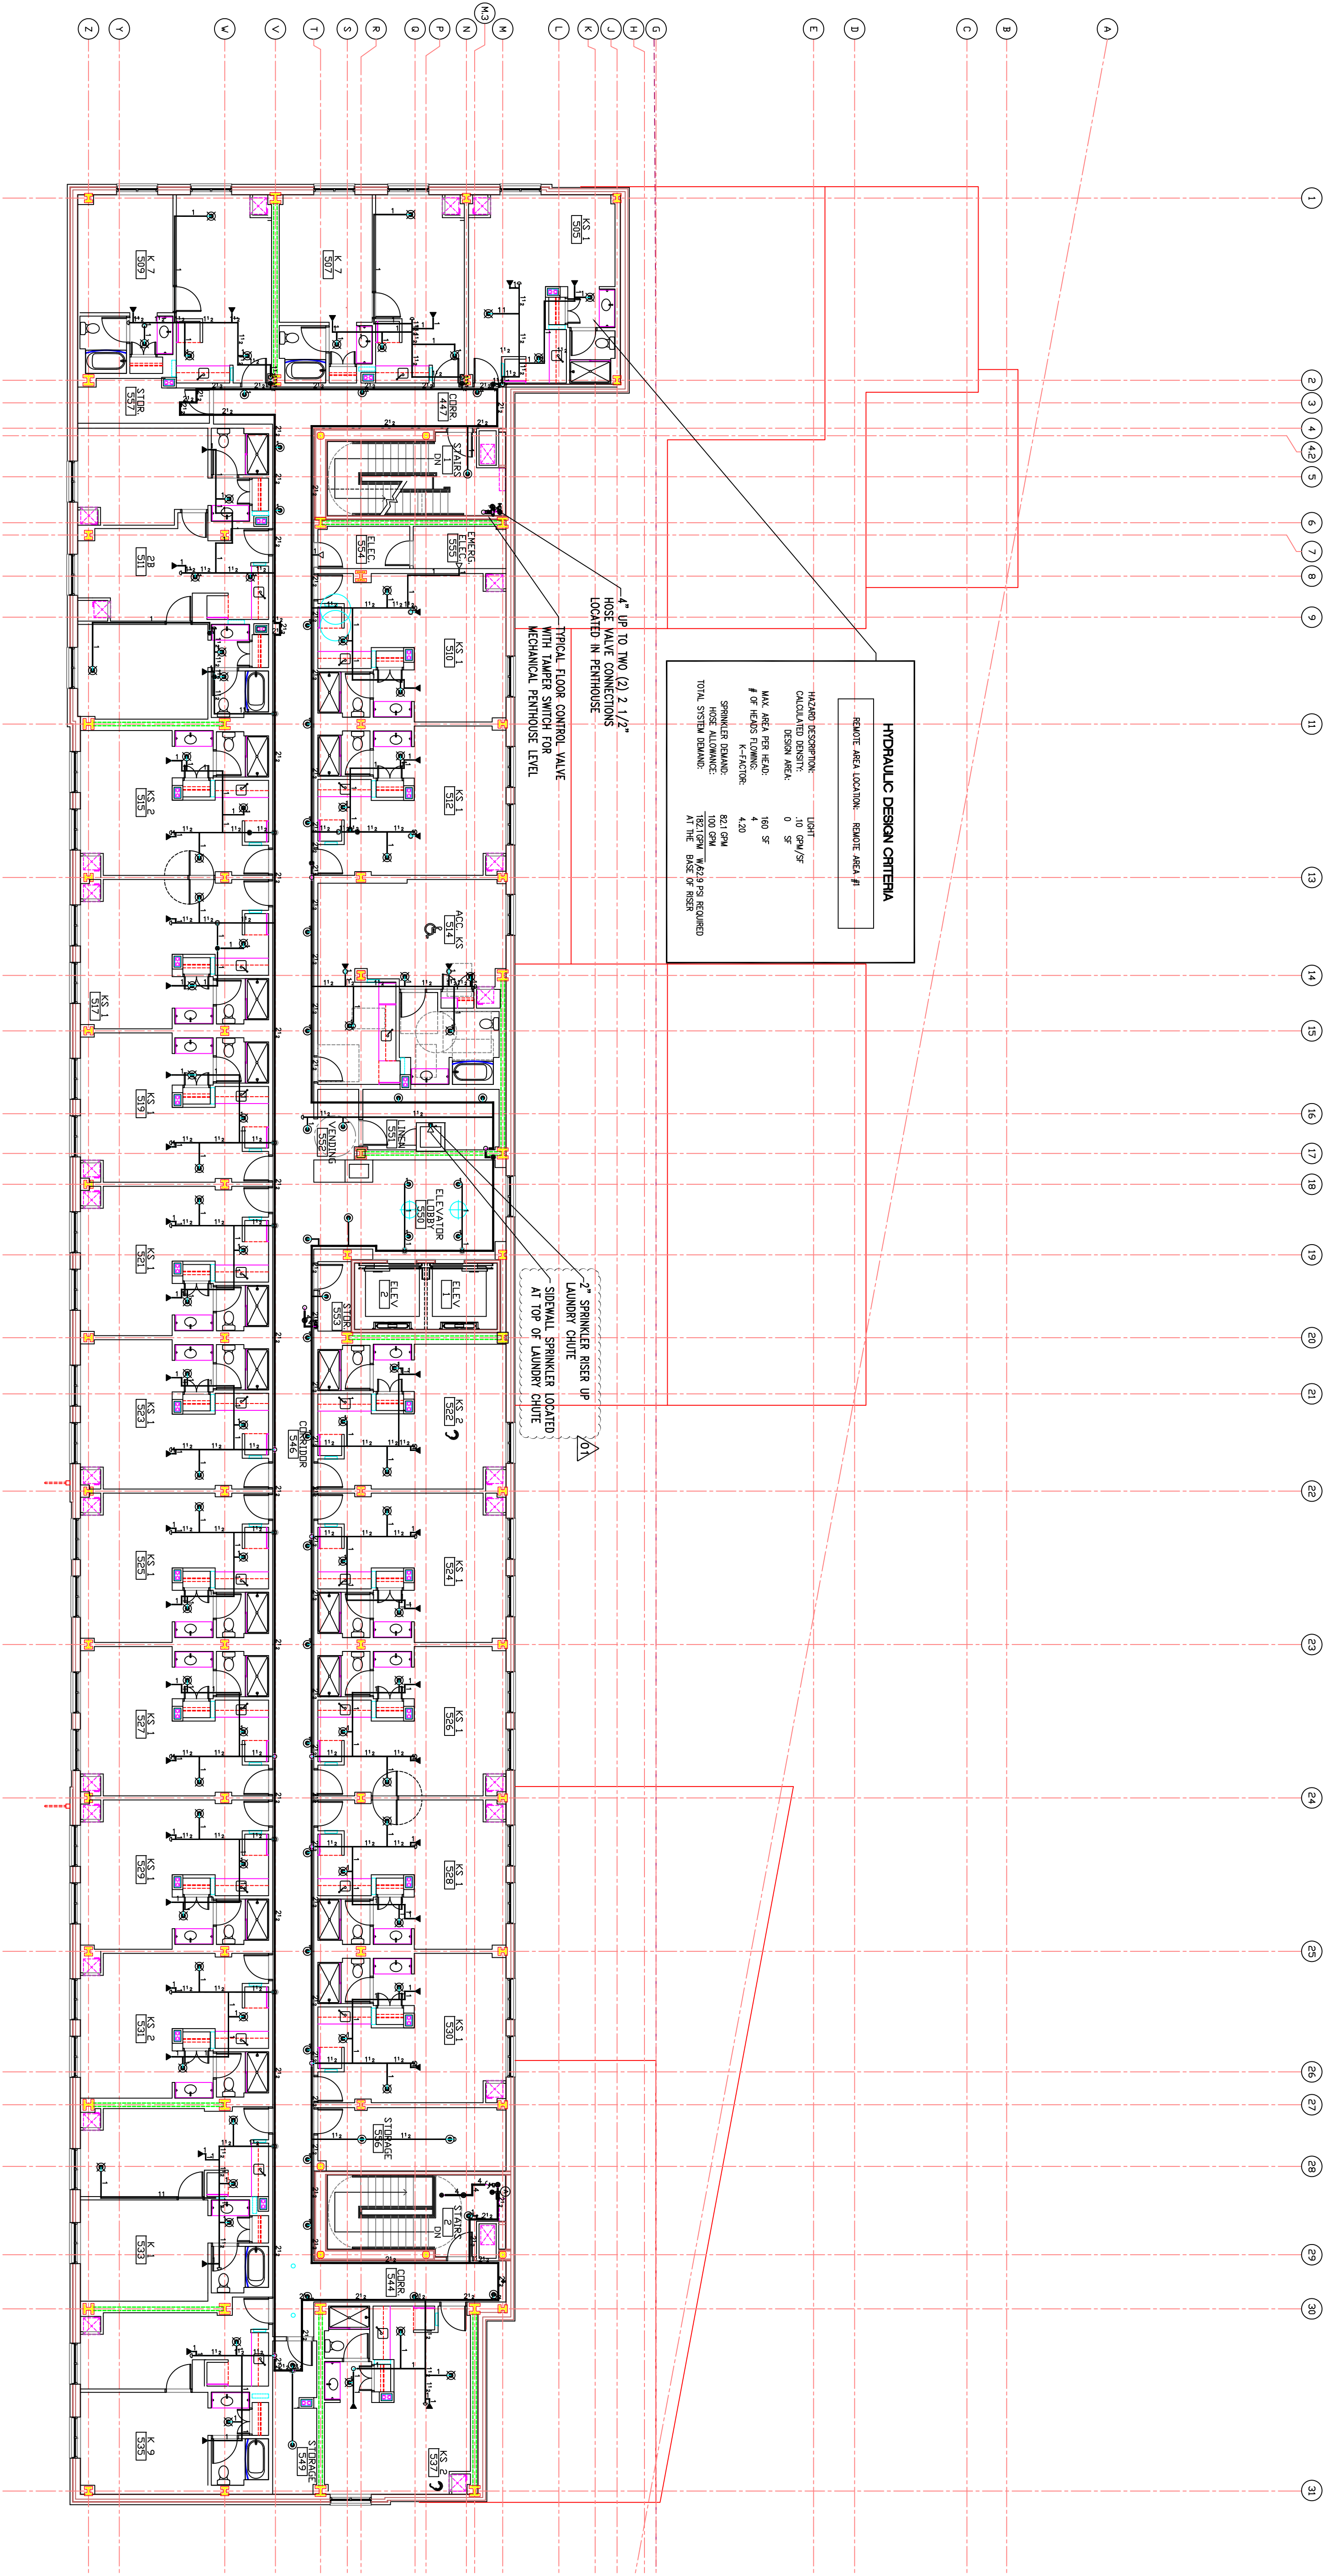

FIFTH FLOOR SPRINKLER PLAN  
SCALE: 3/32" = 1'-0"


| REVISIONS  |         | DESCRIPTION                                |
|------------|---------|--|
| REVISION # | DATE    | DESCRIPTION                                |
| 01         | 6/26/15 | SHOW SPRINKLER PROTECTION IN LAUNDRY CHUTE |

SEAL:



Professional Fire Systems Inc.  
200 Stonewall Blvd. Suite 2A  
Wrentham, Ma. 02093

P=(508)384-2001 F=(508)384-2551

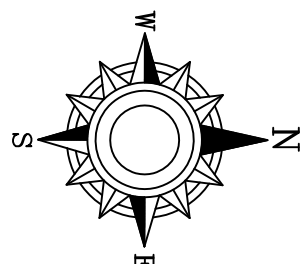

DATE: 8/21/14  
SCALE: 3/32" = 1'-0"  
DRAWN BY: J. LANTON  
CONTRACTOR: TCCI BUILDING COMPANIES



111 Boylston Street  
Brookline, MA

SP-6