

NOTE:
IT IS THE OWNERS RESPONSIBILITY TO
PROVIDE ADEQUATE HEAT (40 DEGREES F)
AND FOR MAINTAINING THE SPRINKLER
SYSTEM PER NFPA 25


[illegible]

SEAL:



Professional Fire Systems Inc.
200 Stonewall Blvd. Suite 2A
Wrentham, Ma. 02093

P=(508)384-2001 F=(508)384-2551

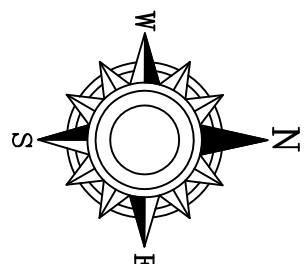


DATE: 8/21/14
SCALE: 3/32" = 1'-0"
DRAWN BY: J.LAWTON
CONTRACTOR: TOCCI BUILDING COMPANIES

111 Boylston Street
Brookline, MA



SPIN

DRAWING 2 OF 7

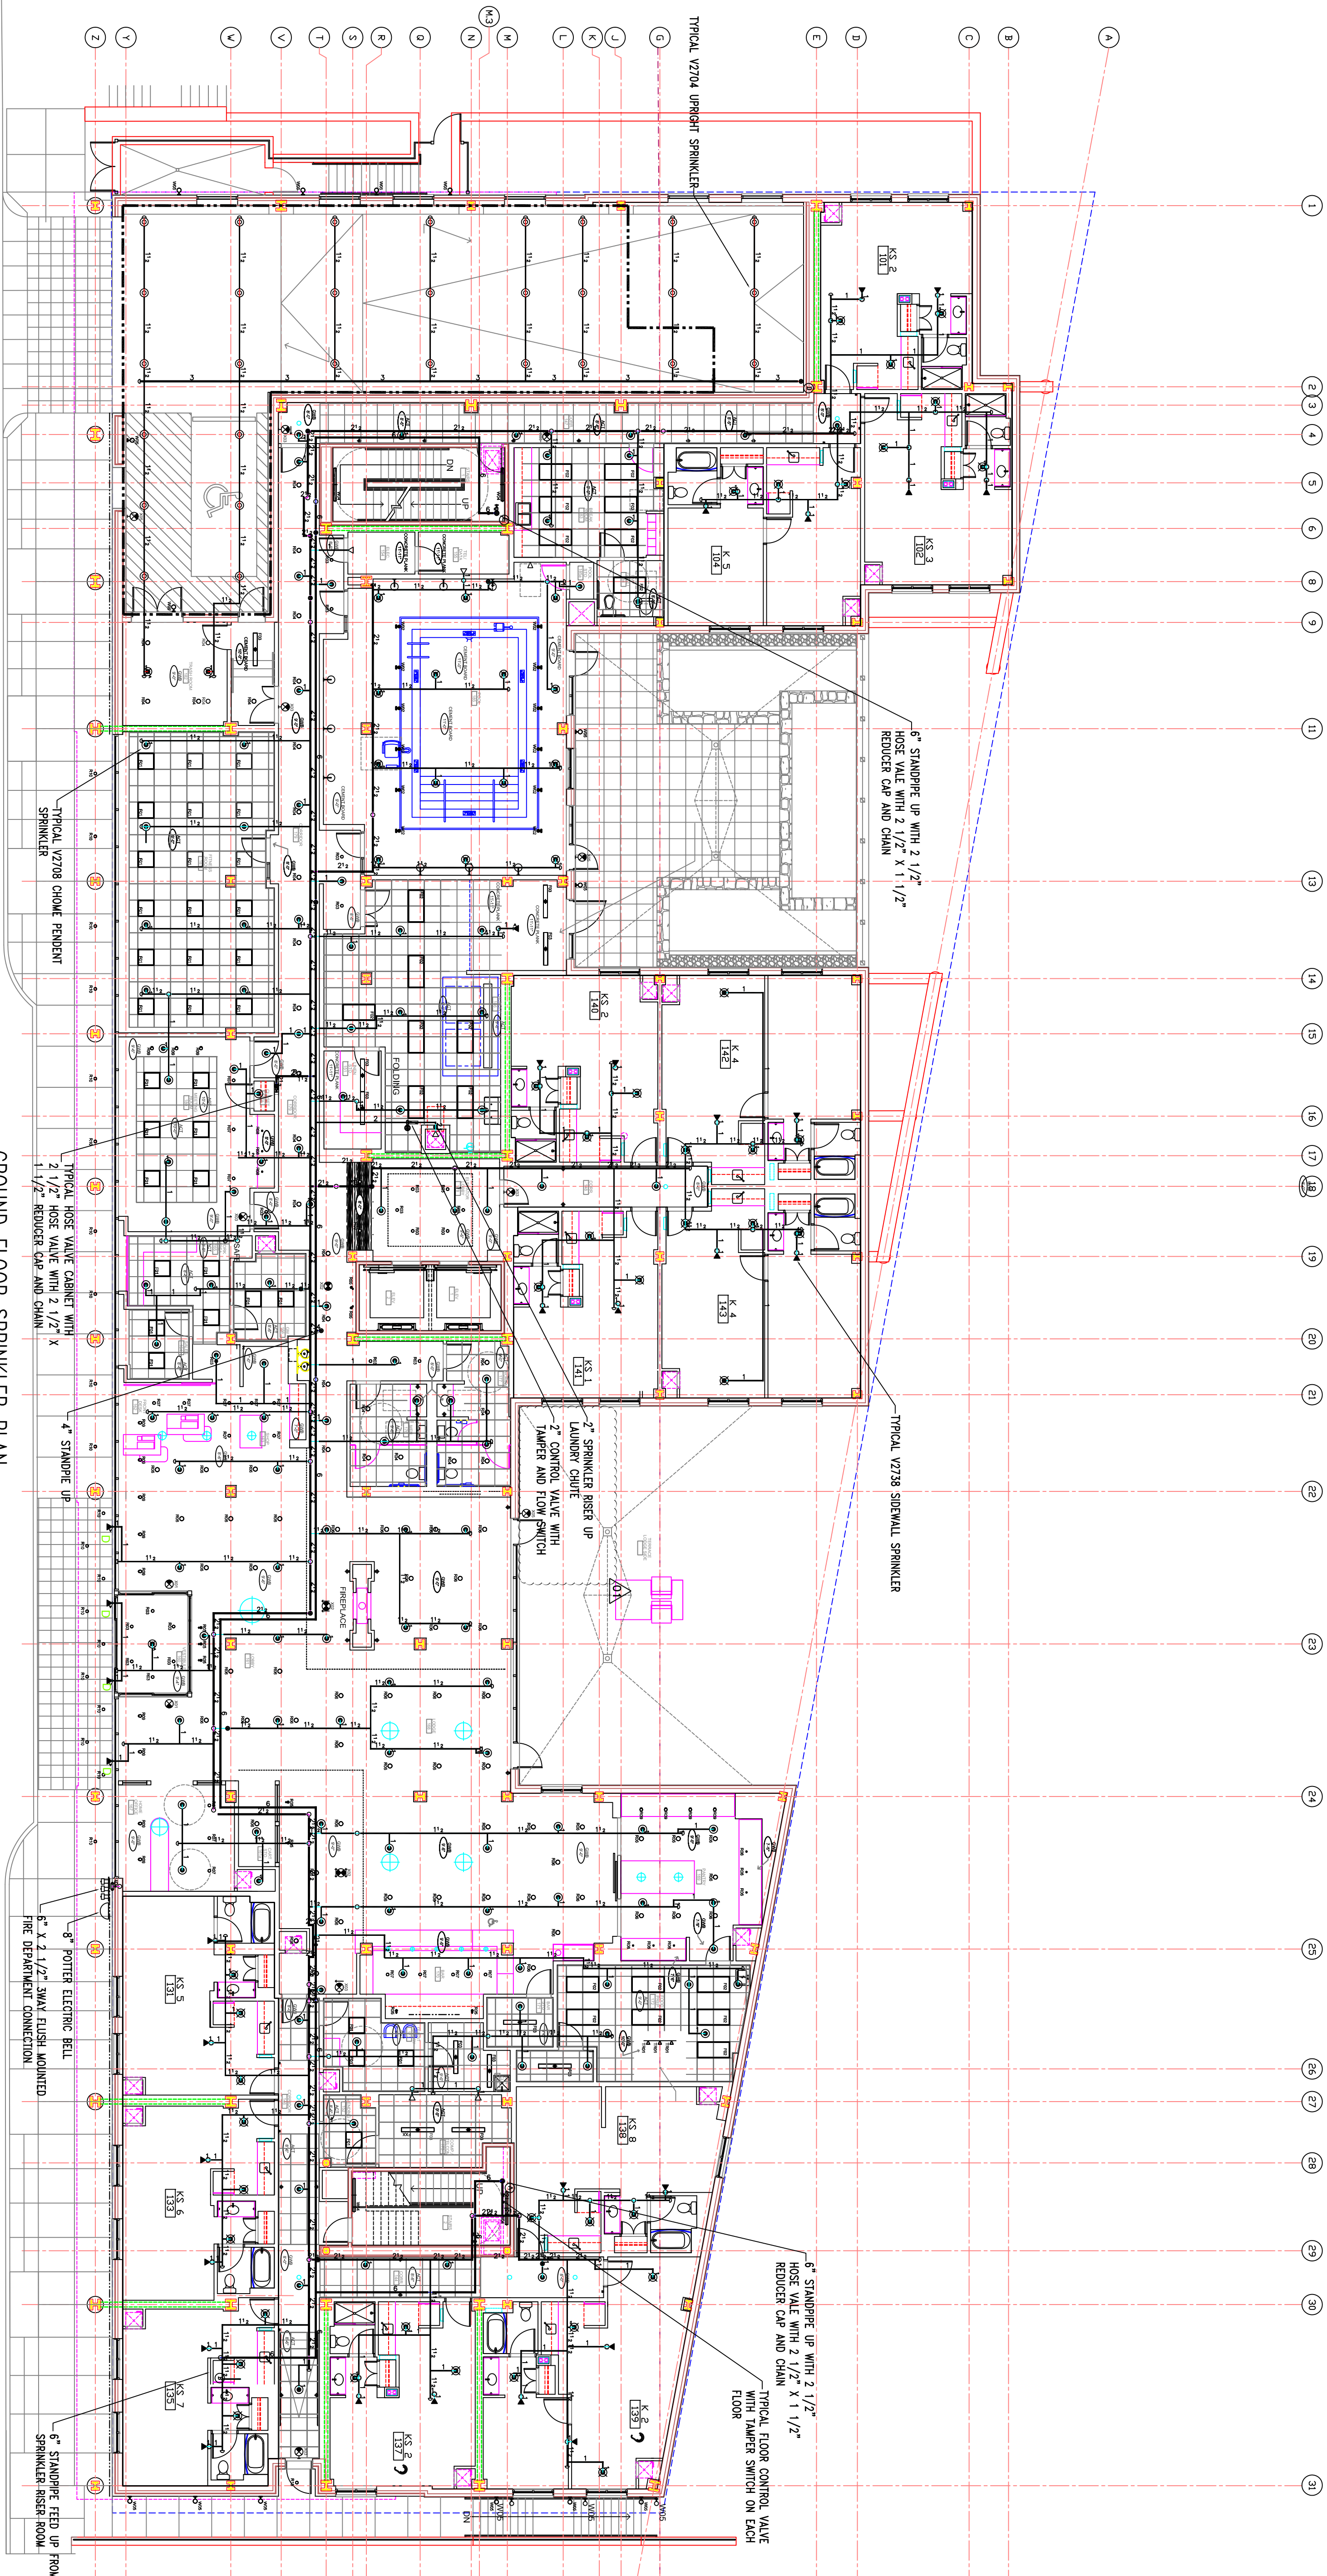



GROUND FLOOR SPRINKLER PLAN
SCALE: 3/32" = 1'-0"

SCALE: 3/32" = 1'-0"


SEISMIC HANGER DETAIL

ALL SEISMIC SHALL BE ATTACHED TO TOP CHORD OF JOIST

FOR PIPE 2 1/2" & LARGER W/
HANGER ROD LONGER THAN 6"

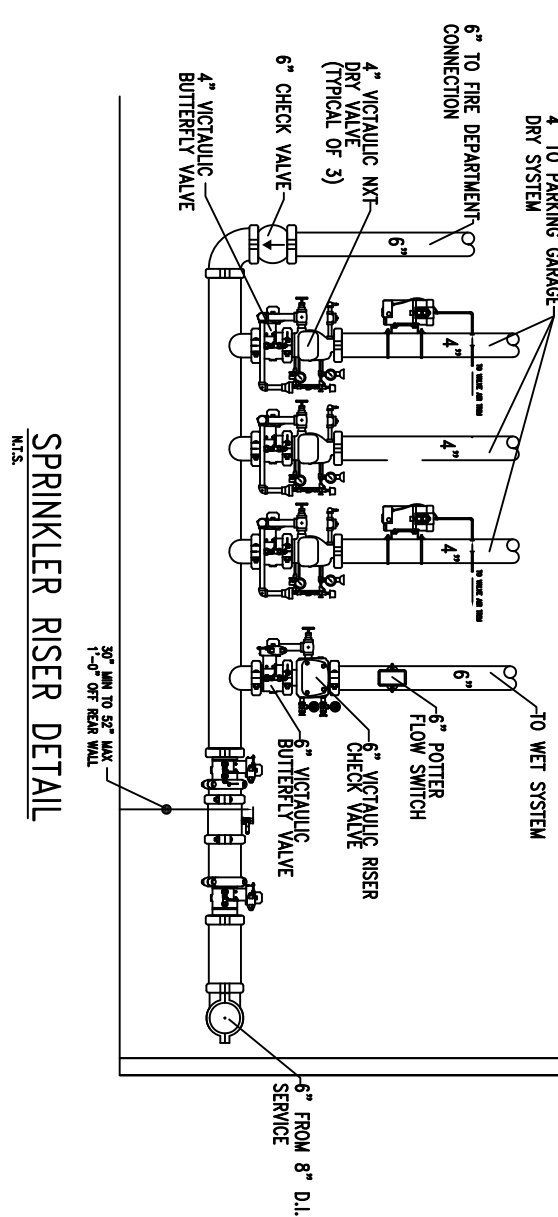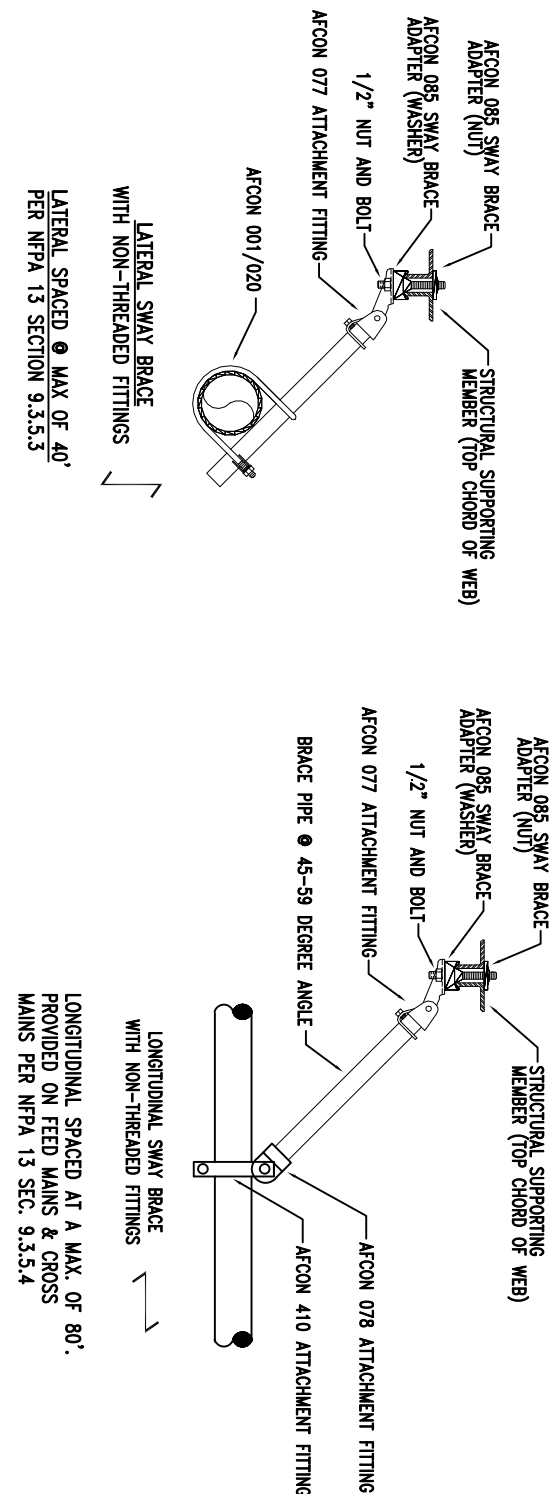

SPRINKLER RISER DETAIL

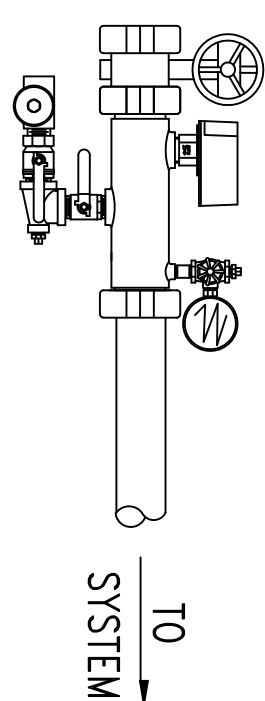

FLOOR CONTROL VALVE DETAIL