




FAN AT OPPOSITE END OF HOUSE FROM THE EVAPORATIVE PAD TO DRAW
AIR THROUGH THE BUILDING FOR THE COOLING SYSTEM

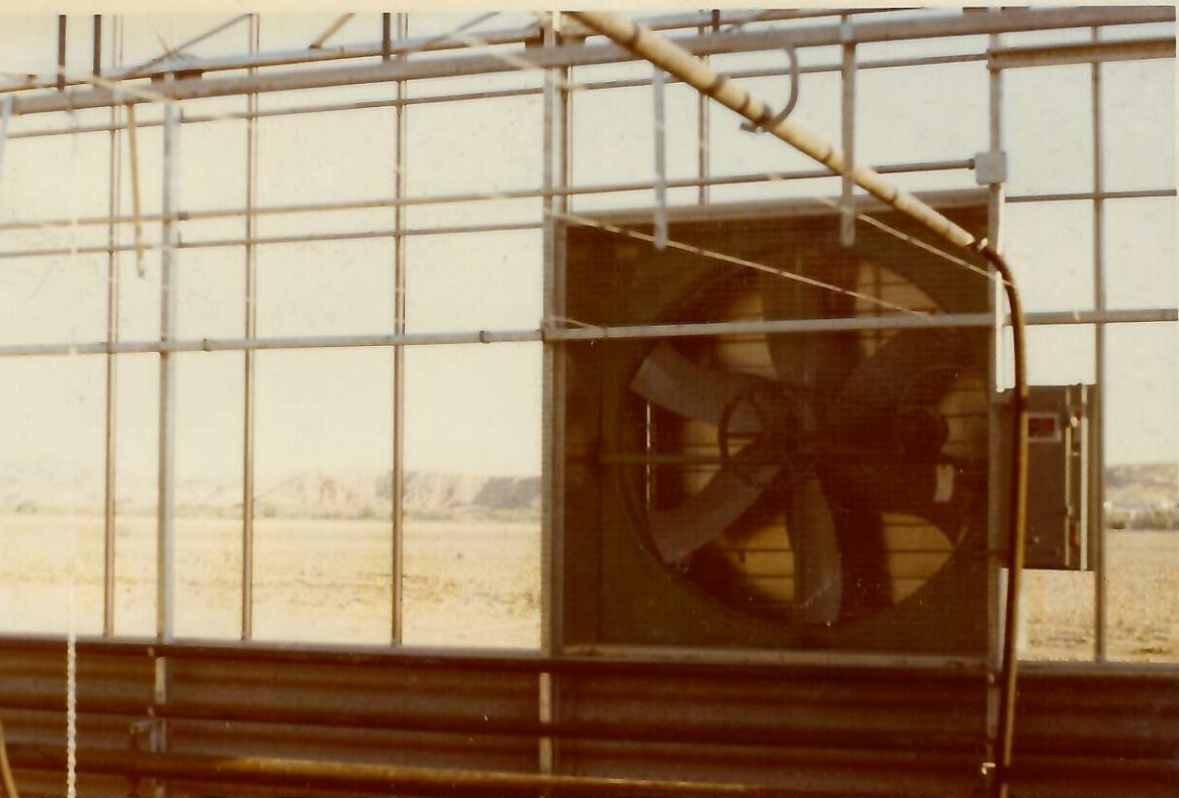

PEAT BAGS (12" WIDE x 36" LONG) INTO WHICH THE PEAT BLOCKS WILL
BE TRANSPLANTED