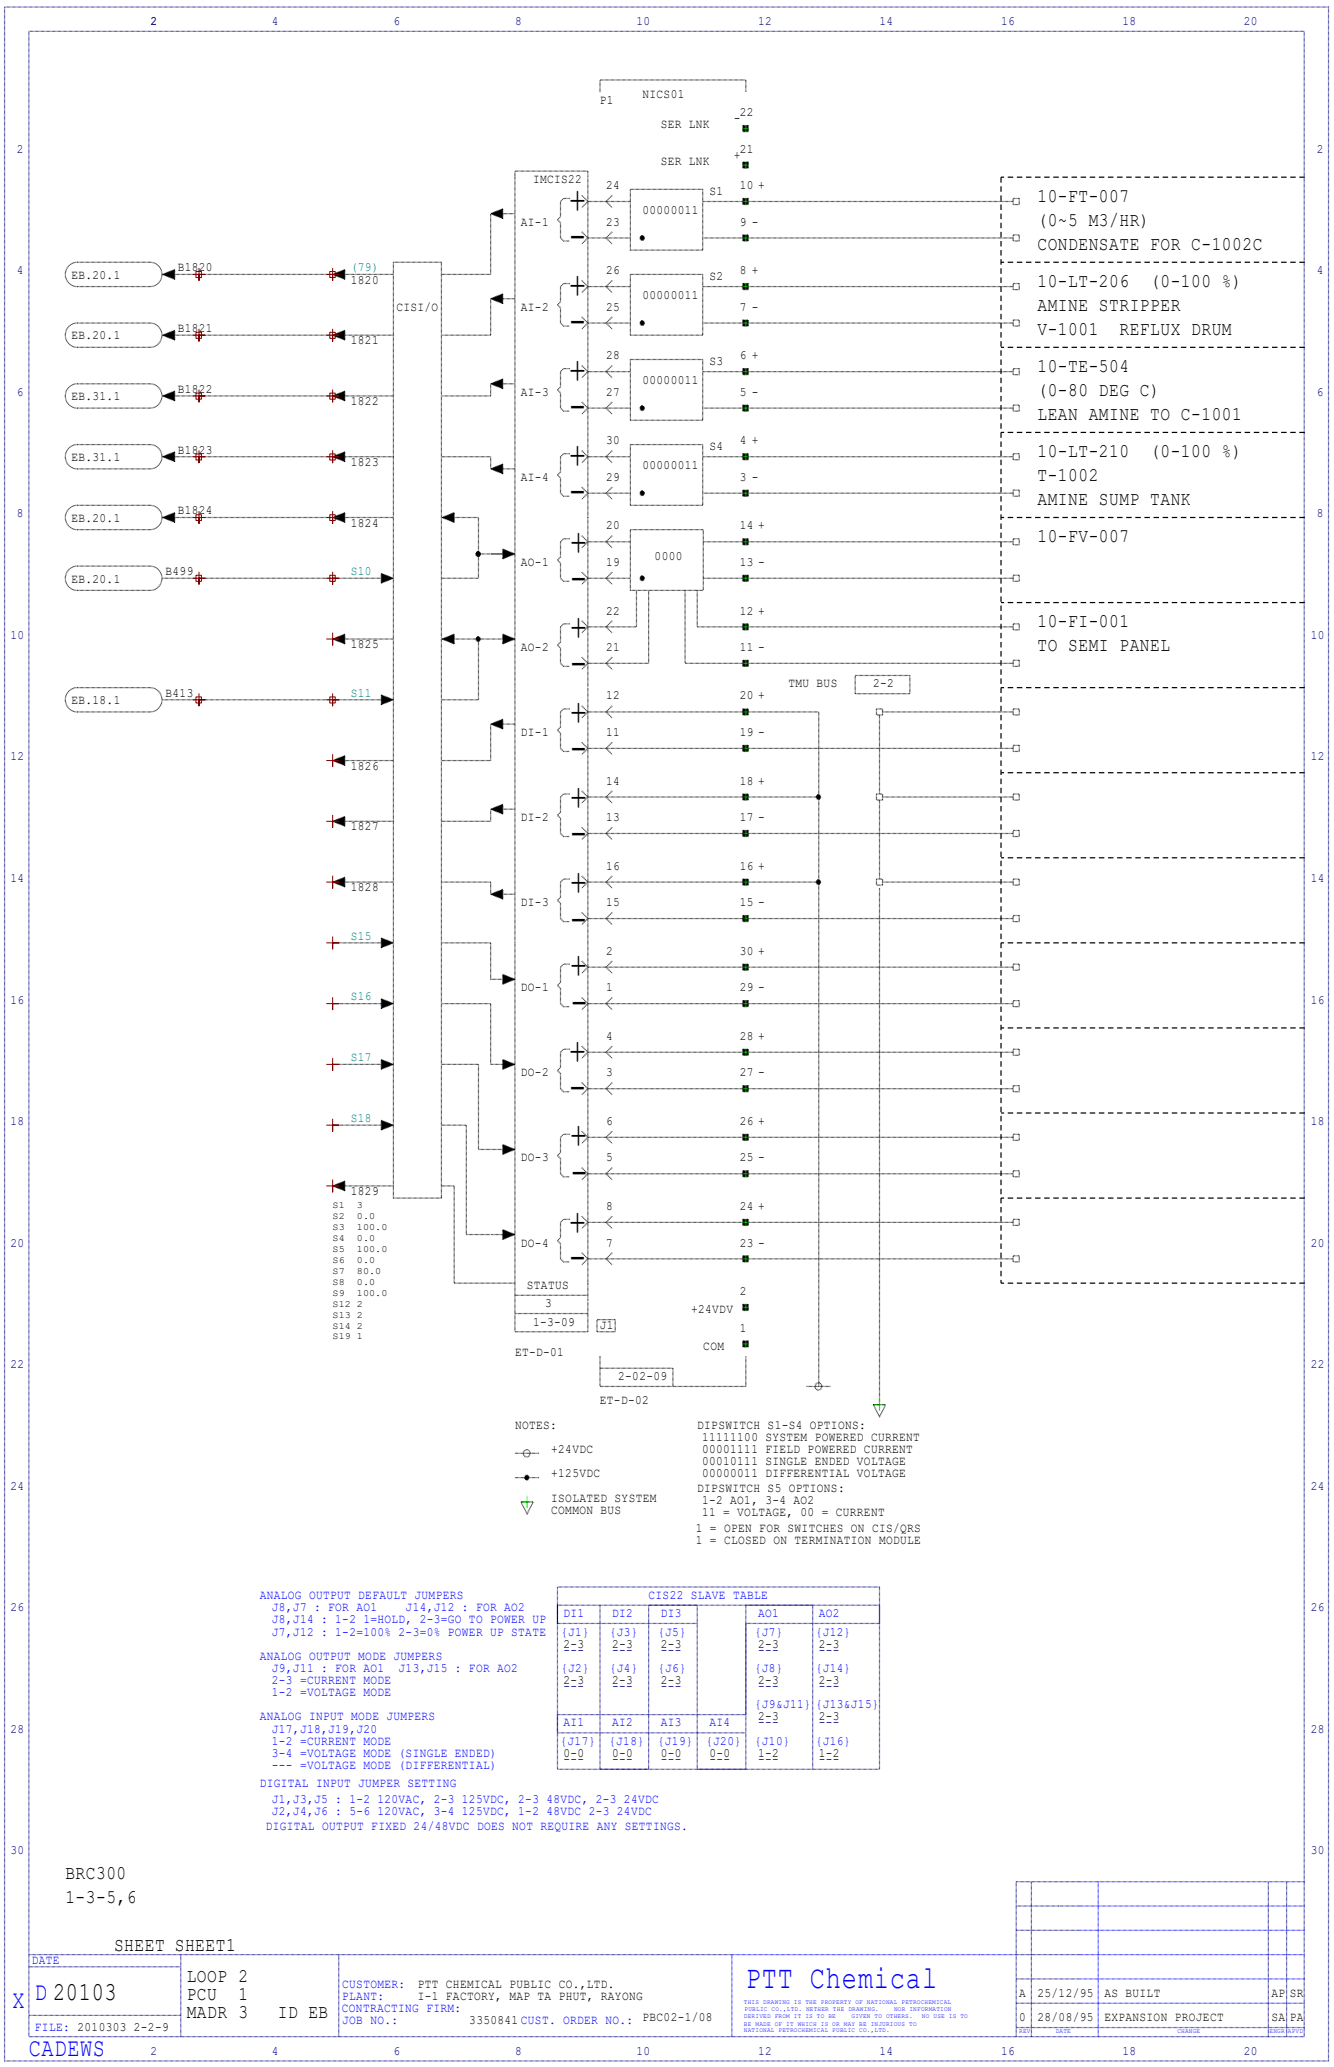


NOTES:
- +24VDC
- +125VDC
- ISOLATED SYSTEM COMMON BUS

DIPSWITCH S1-S4 OPTIONS:
11111100 SYSTEM POWERED CURRENT
00001111 FIELD POWERED CURRENT
00010111 SINGLE ENDED VOLTAGE
00000011 DIFFERENTIAL VOLTAGE

DIPSWITCH S5 OPTIONS:
1-2 AO1, 3-4 AO2
11 = VOLTAGE, 00 = CURRENT

1 = OPEN FOR SWITCHES ON CIS/QRS
1 = CLOSED ON TERMINATION MODULE

ANALOG OUTPUT DEFAULT JUMPERS
J8,J7 : FOR AO1 J14,J12 : FOR AO2
J8,J14 : 1-2 1=HOLD, 2-3=GO TO POWER UP
J7,J12 : 1-2=100% 2-3=0% POWER UP STATE

ANALOG OUTPUT MODE JUMPERS
J9,J11 : FOR AO1 J13,J15 : FOR AO2
2-3 =CURRENT MODE
1-2 =VOLTAGE MODE

ANALOG INPUT MODE JUMPERS
J17,J18,J19,J20
1-2 =CURRENT MODE
3-4 =VOLTAGE MODE (SINGLE ENDED)
--- =VOLTAGE MODE (DIFFERENTIAL)

DIGITAL INPUT JUMPER SETTING
J1,J3,J5 : 1-2 120VAC, 2-3 125VDC, 2-3 48VDC, 2-3 24VDC
J2,J4,J6 : 5-6 120VAC, 3-4 125VDC, 1-2 48VDC 2-3 24VDC
DIGITAL OUTPUT FIXED 24/48VDC DOES NOT REQUIRE ANY SETTINGS.

CIS22 SLAVE TABLE

DI1	DI2	DI3		AO1	AO2
(J1) 2-3	(J3) 2-3	(J5) 2-3		(J7) 2-3	(J12) 2-3
(J2) 2-3	(J4) 2-3	(J6) 2-3		(J8) 2-3	(J14) 2-3
				(J9&J11) 2-3	(J13&J15) 2-3
AI1	AI2	AI3	AI4		
(J17) 0-0	(J18) 0-0	(J19) 0-0	(J20) 0-0	(J10) 1-2	(J16) 1-2

BRC300
1-3-5,6

SHEET SHEET1

A	25/12/95	AS BUILT				AP	SR	
0	28/08/95	EXPANSION PROJECT				SA	PA	
REV	DATE	CHANGE				ENGR	APVD	

DATE
D 20103
FILE: 2010303 2-2-9

LOOP 2
PCU 1
MADR 3 ID EB

CUSTOMER: PTT CHEMICAL PUBLIC CO.,LTD.
PLANT: I-1 FACTORY, MAP TA PHUT, RAYONG
CONTRACTING FIRM:
JOB NO.: 3350841 CUST. ORDER NO.: PBC02-1/08

PTT Chemical

THIS DRAWING IS THE PROPERTY OF NATIONAL PETROCHEMICAL PUBLIC CO.,LTD. NEITHER THE DRAWING, NOR INFORMATION DERIVED FROM IT IS TO BE GIVEN TO OTHERS. NO USE IS TO BE MADE OF IT WHICH IS OR MAY BE INJURIOUS TO NATIONAL PETROCHEMICAL PUBLIC CO.,LTD.

CADEWS