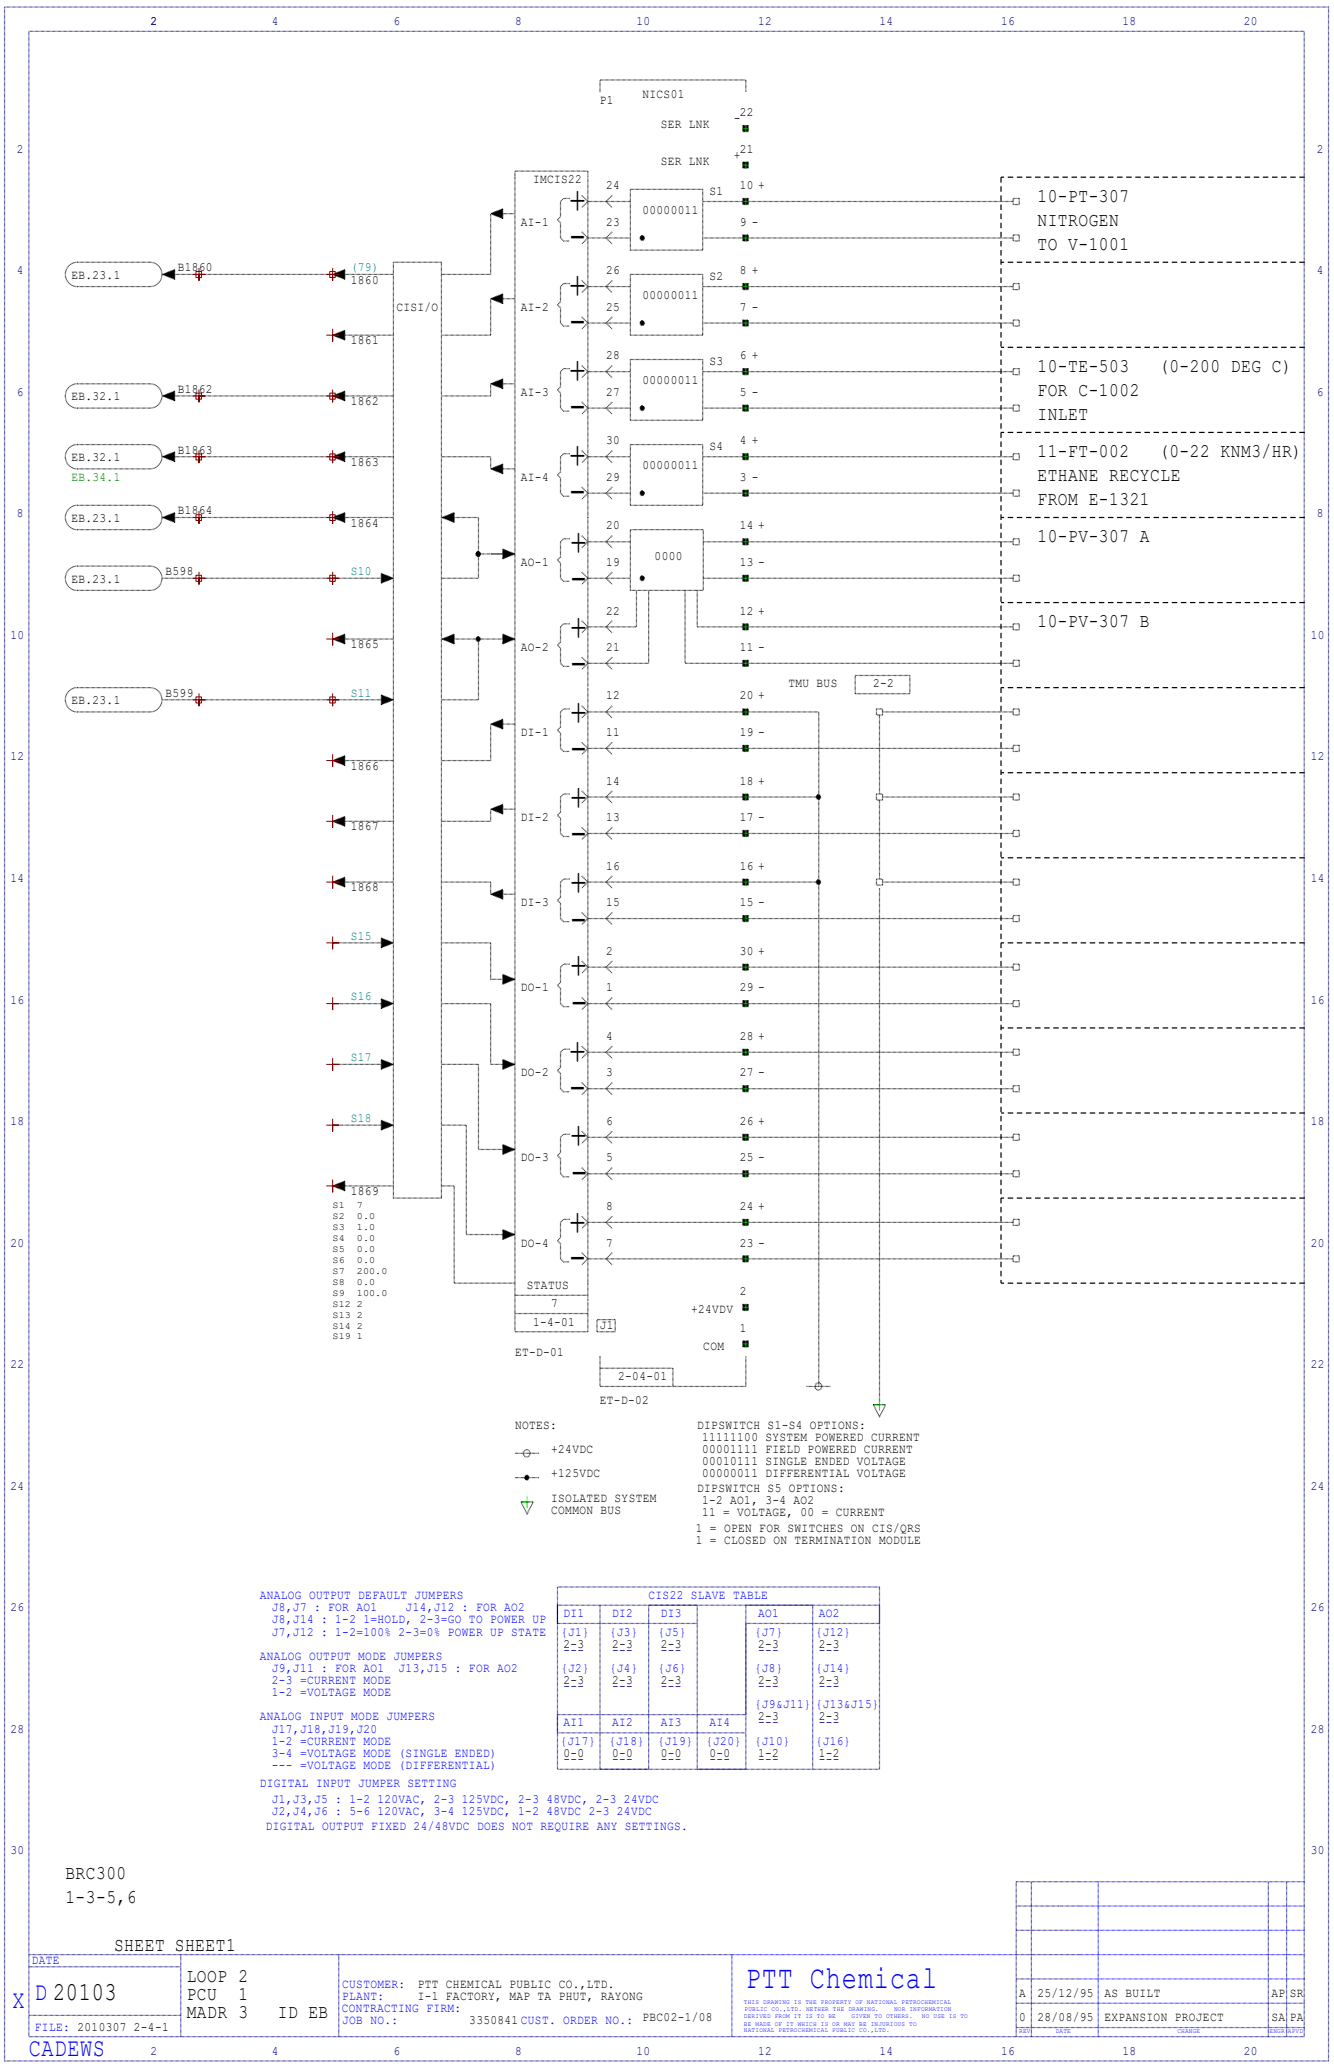

P1
NICS01
SER LNK -22
SER LNK +21
IMCIS22
CISI/O
AI-1
AI-2
AI-3
AI-4
AO-1
AO-2
DI-1
DI-2
DI-3
DO-1
DO-2
DO-3
DO-4
00000011
0000
S1
S2
S3
S4
10-PT-307
NITROGEN
TO V-1001
10-TE-503 (0-200 DEG C)
FOR C-1002
INLET
11-FT-002 (0-22 KNM3/HR)
ETHANE RECYCLE
FROM E-1321
10-PV-307 A
10-PV-307 B
TMU BUS 2-2
EB.23.1
EB.32.1
EB.34.1
B1860
B1862
B1863
B1864
B598
B599
S10
S11
S15
S16
S17
S18
1860
1861
1862
1863
1864
1865
1866
1867
1868
1869
STATUS
1-4-01
J1
2-04-01
+24VDV
COM
ET-D-01
ET-D-02
NOTES:
+24VDC
+125VDC
ISOLATED SYSTEM COMMON BUS
DIPSWITCH S1-S4 OPTIONS:
11111100 SYSTEM POWERED CURRENT
00001111 FIELD POWERED CURRENT
00010111 SINGLE ENDED VOLTAGE
00000011 DIFFERENTIAL VOLTAGE
DIPSWITCH S5 OPTIONS:
1-2 AO1, 3-4 AO2
11 = VOLTAGE, 00 = CURRENT
1 = OPEN FOR SWITCHES ON CIS/QRS
1 = CLOSED ON TERMINATION MODULE
ANALOG OUTPUT DEFAULT JUMPERS
J8,J7 : FOR AO1 J14,J12 : FOR AO2
J8,J14 : 1-2 1=HOLD, 2-3=GO TO POWER UP
J7,J12 : 1-2=100% 2-3=0% POWER UP STATE
ANALOG OUTPUT MODE JUMPERS
J9,J11 : FOR AO1 J13,J15 : FOR AO2
2-3 =CURRENT MODE
1-2 =VOLTAGE MODE
ANALOG INPUT MODE JUMPERS
J17,J18,J19,J20
1-2 =CURRENT MODE
3-4 =VOLTAGE MODE (SINGLE ENDED)
--- =VOLTAGE MODE (DIFFERENTIAL)
DIGITAL INPUT JUMPER SETTING
J1,J3,J5 : 1-2 120VAC, 2-3 125VDC, 2-3 48VDC, 2-3 24VDC
J2,J4,J6 : 5-6 120VAC, 3-4 125VDC, 1-2 48VDC 2-3 24VDC
DIGITAL OUTPUT FIXED 24/48VDC DOES NOT REQUIRE ANY SETTINGS.
CIS22 SLAVE TABLE
DI1 DI2 DI3 AO1 AO2
AI1 AI2 AI3 AI4
BRC300
1-3-5,6
SHEET SHEET1
DATE
D 20103
FILE: 2010307 2-4-1
LOOP 2
PCU 1
MADR 3 ID EB
CUSTOMER: PTT CHEMICAL PUBLIC CO.,LTD.
PLANT: I-1 FACTORY, MAP TA PHUT, RAYONG
CONTRACTING FIRM:
JOB NO.: 3350841 CUST. ORDER NO.: PBC02-1/08
PTT Chemical
A 25/12/95 AS BUILT AP SR
0 28/08/95 EXPANSION PROJECT SA PA
CADEWS