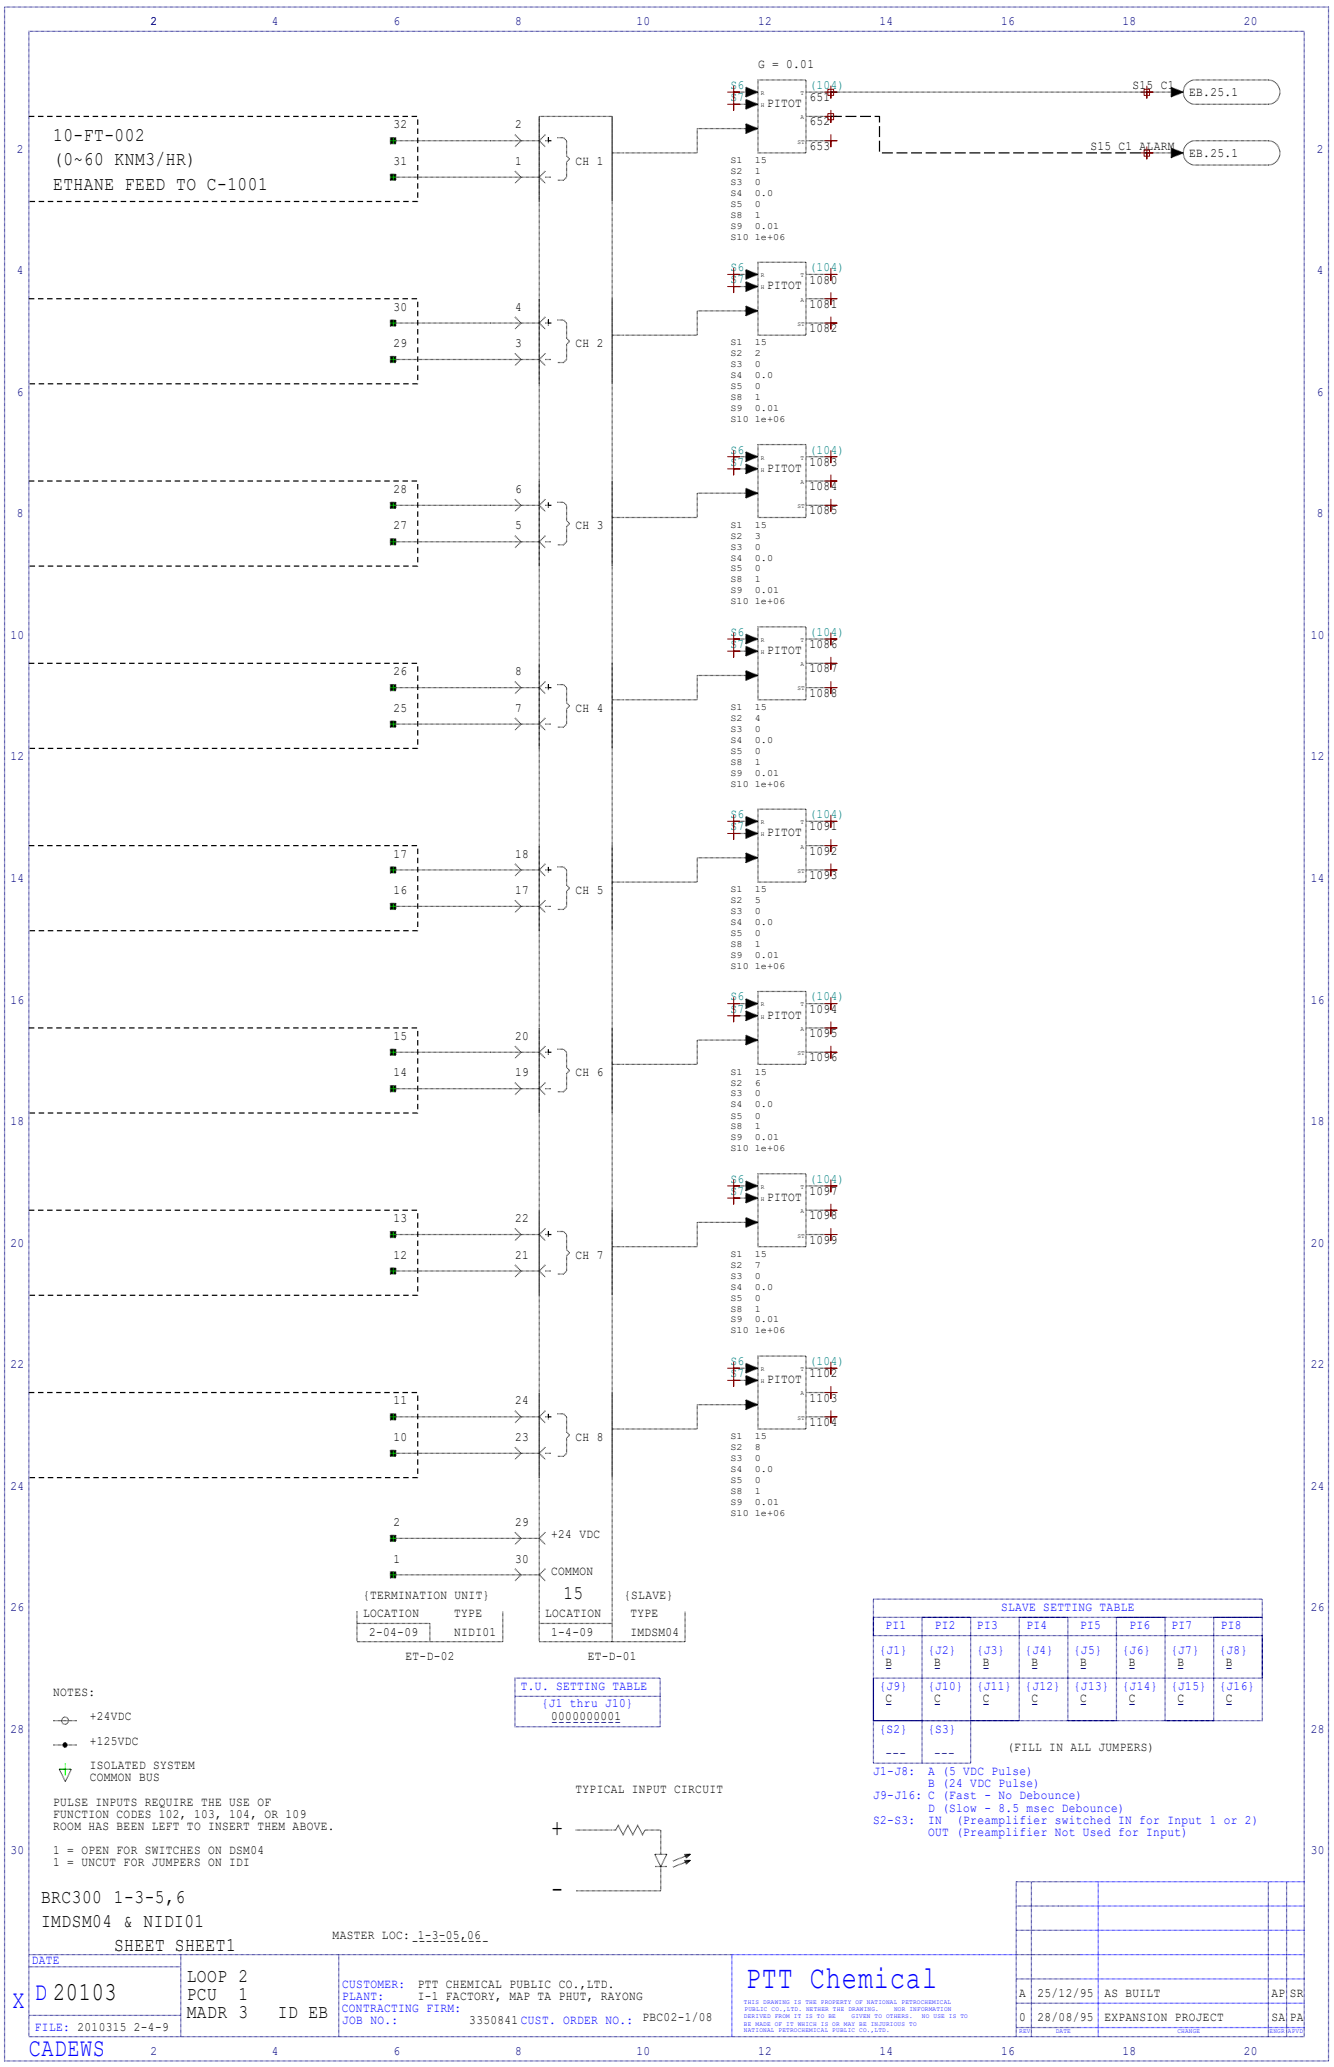

10-FT-002
(0~60 KNM3/HR)
ETHANE FEED TO C-1001
CH 1
CH 2
CH 3
CH 4
CH 5
CH 6
CH 7
CH 8
G = 0.01
PITOT
S15 C1
EB.25.1
S15 C1 ALARM
EB.25.1
+24 VDC
COMMON
{TERMINATION UNIT}
LOCATION TYPE
2-04-09 NIDI01
ET-D-02
15
{SLAVE}
LOCATION TYPE
1-4-09 IMDSM04
ET-D-01
T.U. SETTING TABLE
(J1 thru J10)
0000000001
SLAVE SETTING TABLE
PI1 PI2 PI3 PI4 PI5 PI6 PI7 PI8
(J1) B (J2) B (J3) B (J4) B (J5) B (J6) B (J7) B (J8) B
(J9) C (J10) C (J11) C (J12) C (J13) C (J14) C (J15) C (J16) C
{S2} --- {S3} ---
(FILL IN ALL JUMPERS)
J1-J8: A (5 VDC Pulse)
B (24 VDC Pulse)
J9-J16: C (Fast - No Debounce)
D (Slow - 8.5 msec Debounce)
S2-S3: IN (Preamplifier switched IN for Input 1 or 2)
OUT (Preamplifier Not Used for Input)
NOTES:
+24VDC
+125VDC
ISOLATED SYSTEM COMMON BUS
PULSE INPUTS REQUIRE THE USE OF FUNCTION CODES 102, 103, 104, OR 109 ROOM HAS BEEN LEFT TO INSERT THEM ABOVE.
1 = OPEN FOR SWITCHES ON DSM04
1 = UNCUT FOR JUMPERS ON IDI
TYPICAL INPUT CIRCUIT
BRC300 1-3-5,6
IMDSM04 & NIDI01
SHEET SHEET1
MASTER LOC: 1-3-05,06
DATE
D 20103
FILE: 2010315 2-4-9
LOOP 2
PCU 1
MADR 3 ID EB
CUSTOMER: PTT CHEMICAL PUBLIC CO.,LTD.
PLANT: I-1 FACTORY, MAP TA PHUT, RAYONG
CONTRACTING FIRM:
JOB NO.: 3350841 CUST. ORDER NO.: PBC02-1/08
PTT Chemical
THIS DRAWING IS THE PROPERTY OF NATIONAL PETROCHEMICAL PUBLIC CO.,LTD. NEITHER THE DRAWING, NOR INFORMATION DERIVED FROM IT IS TO BE GIVEN TO OTHERS. NO USE IS TO BE MADE OF IT WHICH IS OR MAY BE INJURIOUS TO NATIONAL PETROCHEMICAL PUBLIC CO.,LTD.
A 25/12/95 AS BUILT AP SR
0 28/08/95 EXPANSION PROJECT SA PA
REV DATE CHANGE ENGR APVD
CADEWS