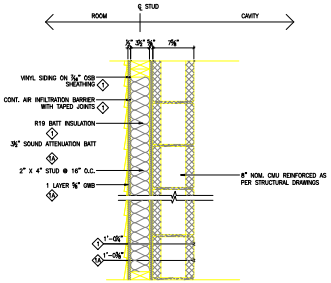
ROOM
℄ STUD
CAVITY
VINYL SIDING ON 7/16" OSB SHEATHING
CONT. AIR INFILTRATION BARRIER WITH TAPED JOINTS
R19 BATT INSULATION
3½" SOUND ATTENUATION BATT
2" X 4" STUD @ 16" O.C.
1 LAYER ⅝" GWB
8" NOM. CMU REINFORCED AS PER STRUCTURAL DRAWINGS

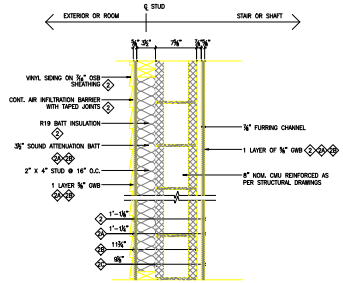
EXTERIOR OR ROOM
℄ STUD
STAIR OR SHAFT
VINYL SIDING ON 7/16" OSB SHEATHING
CONT. AIR INFILTRATION BARRIER WITH TAPED JOINTS
R19 BATT INSULATION
3½" SOUND ATTENUATION BATT
2" X 4" STUD @ 16" O.C.
1 LAYER ⅝" GWB
¾" FURRING CHANNEL
1 LAYER OF ⅝" GWB
8" NOM. CMU REINFORCED AS PER STRUCTURAL DRAWINGS

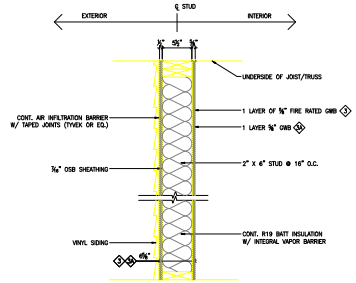
EXTERIOR
℄ STUD
INTERIOR
UNDERSIDE OF JOIST/TRUSS
CONT. AIR INFILTRATION BARRIER W/ TAPED JOINTS (TYVEK OR EQ.)
7/16" OSB SHEATHING
VINYL SIDING
1 LAYER OF ⅝" FIRE RATED GWB
1 LAYER ⅝" GWB
2" X 4" STUD @ 16" O.C.
CONT. R19 BATT INSULATION W/ INTERNAL VAPOR BARRIER

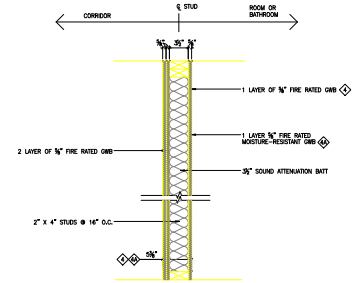
CORRIDOR
℄ STUD
ROOM OR BATHROOM
1 LAYER OF ⅝" FIRE RATED GWB
2 LAYER OF ⅝" FIRE RATED GWB
1 LAYER ⅝" FIRE RATED MOISTURE-RESISTANT GWB
3½" SOUND ATTENUATION BATT
2" X 4" STUDS @ 16" O.C.

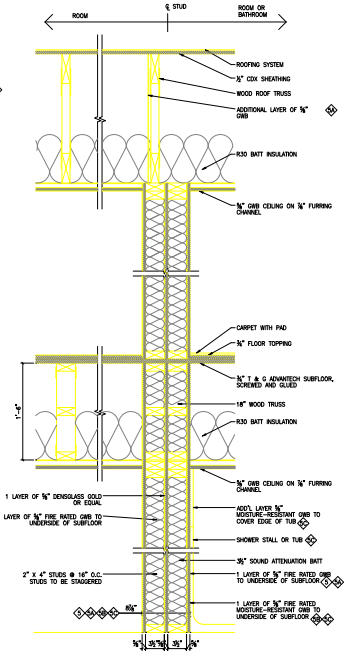
ROOM
℄ STUD
ROOM OR BATHROOM
ROOFING SYSTEM
½" CDX SHEATHING
WOOD ROOF TRUSS
ADDITIONAL LAYER OF ⅝" GWB
R30 BATT INSULATION
⅝" GWB CEILING ON ¾" FURRING CHANNEL
CARPET WITH PAD
¾" FLOOR TOPPING
¾" T & G ADVANTECH SUBFLOOR, SCREWED AND GLUED
18" WOOD TRUSS
R30 BATT INSULATION
⅝" GWB CEILING ON ¾" FURRING CHANNEL
1 LAYER OF ⅝" DENSGLASS GOLD OR EQUAL
1 LAYER OF ⅝" FIRE RATED GWB TO UNDERSIDE OF SUBFLOOR
ADD'L. LAYER ⅝" MOISTURE-RESISTANT GWB TO COVER EDGE OF TUB
SHOWER STALL OR TUB
3½" SOUND ATTENUATION BATT
2" X 4" STUDS @ 16" O.C. STUDS TO BE STAGGERED
1 LAYER OF ⅝" FIRE RATED GWB TO UNDERSIDE OF SUBFLOOR
1 LAYER OF ⅝" FIRE RATED MOISTURE-RESISTANT GWB TO UNDERSIDE OF SUBFLOOR

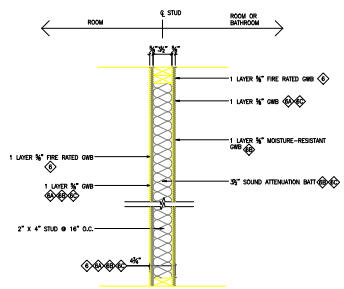
ROOM
℄ STUD
ROOM OR BATHROOM
1 LAYER ⅝" FIRE RATED GWB
1 LAYER ⅝" GWB
1 LAYER ⅝" MOISTURE-RESISTANT GWB
1 LAYER ⅝" FIRE RATED GWB
1 LAYER ⅝" GWB
3½" SOUND ATTENUATION BATT
2" X 4" STUD @ 16" O.C.

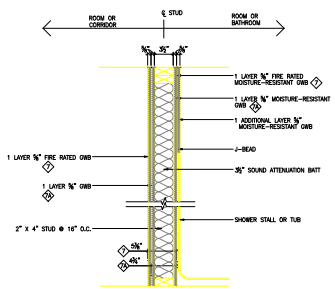
ROOM OR CORRIDOR
℄ STUD
ROOM OR BATHROOM
1 LAYER ⅝" FIRE RATED MOISTURE-RESISTANT GWB
1 LAYER ⅝" MOISTURE-RESISTANT GWB
1 ADDITIONAL LAYER ⅝" MOISTURE-RESISTANT GWB
J-BEAD
3½" SOUND ATTENUATION BATT
1 LAYER ⅝" FIRE RATED GWB
1 LAYER ⅝" GWB
2" X 4" STUD @ 16" O.C.
SHOWER STALL OR TUB

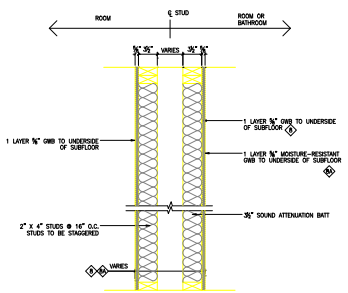
ROOM
℄ STUD
ROOM OR BATHROOM
VARIES
1 LAYER ⅝" GWB TO UNDERSIDE OF SUBFLOOR
1 LAYER ⅝" GWB TO UNDERSIDE OF SUBFLOOR
1 LAYER ⅝" MOISTURE-RESISTANT GWB TO UNDERSIDE OF SUBFLOOR
3½" SOUND ATTENUATION BATT
2" X 4" STUDS @ 16" O.C. STUDS TO BE STAGGERED
VARIES

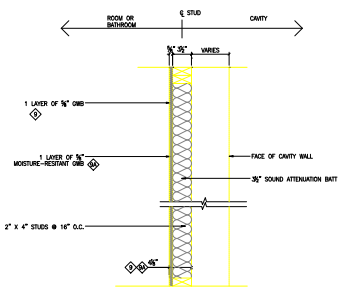
ROOM OR BATHROOM
℄ STUD
CAVITY
VARIES
1 LAYER OF ⅝" GWB
1 LAYER OF ⅝" MOISTURE-RESISTANT GWB
FACE OF CAVITY WALL
3½" SOUND ATTENUATION BATT
2" X 4" STUDS @ 16" O.C.

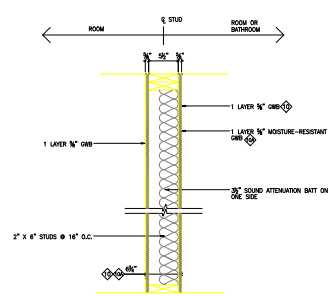
ROOM
℄ STUD
ROOM OR BATHROOM
1 LAYER ⅝" GWB
1 LAYER ⅝" MOISTURE-RESISTANT GWB
1 LAYER ⅝" GWB
3½" SOUND ATTENUATION BATT ON ONE SIDE
2" X 6" STUDS @ 16" O.C.

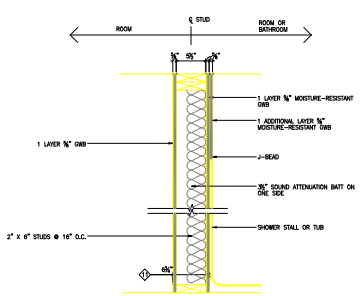
ROOM
℄ STUD
ROOM OR BATHROOM
1 LAYER ⅝" MOISTURE-RESISTANT GWB
1 ADDITIONAL LAYER ⅝" MOISTURE-RESISTANT GWB
1 LAYER ⅝" GWB
J-BEAD
3½" SOUND ATTENUATION BATT ON ONE SIDE
2" X 6" STUDS @ 16" O.C.
SHOWER STALL OR TUB

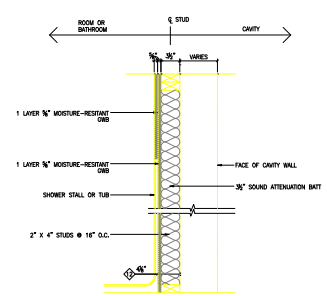
ROOM OR BATHROOM
℄ STUD
CAVITY
VARIES
1 LAYER ⅝" MOISTURE-RESISTANT GWB
1 LAYER ⅝" MOISTURE-RESISTANT GWB
FACE OF CAVITY WALL
SHOWER STALL OR TUB
3½" SOUND ATTENUATION BATT
2" X 4" STUDS @ 16" O.C.


SHAFT
℄ STUD
ROOM
2½" "J" RUNNER
UNDERSIDE OF SUBFLOOR
FACE OF FINISHED CLNG.
1 LAYER OF ⅝" FIRE RATED GWB
1" THICK GYP. LINER PANEL
3½" "C-H" STUD @ 24" O.C.
FLOOR SLAB



1 TWO HOUR RATED EXTERIOR BEARING FIRE WALL

SCALE: 1½"=1'-0"
DESIGN NO. U905 (SIMILAR)
VINYL SIDING ON 3/8" OSB SHEATHING, 2" x 4" WOOD FRAME WITH 3½" SOUND BATT INS., AIR INFILTRATION BARRIER WITH TAPED JOINTS
1 LAYER DENSGLASS GOLD OR EQUAL, 8" NOM. CMU.
1 LAYER ½" FIRE RATED GWB ON ½" FURRING CHANNELS ON STAIR SIDE.

1A TWO HOUR RATED EXTERIOR BEARING FIRE WALL

SCALE: 1½"=1'-0"
DESIGN NO. U905 (SIMILAR)
1 LAYER ½" FIRE RATED GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON ROOM SIDE.
1 LAYER DENSGLASS GOLD OR EQUAL, 8" NOM. CMU.



2 ONE HOUR RATED EXTERIOR MASONRY PARTITION

SCALE: 1½"=1'-0"
DESIGN NO. U905 (SIMILAR)
VINYL SIDING ON 3/8" OSB SHEATHING, 2" x 4" WOOD FRAME WITH 3½" SOUND BATT INS., AIR INFILTRATION BARRIER WITH TAPED JOINTS
1 LAYER ½" FIRE RATED GWB ON ½" FURRING CHANNELS ON STAIR SIDE.

2A ONE HOUR RATED EXTERIOR MASONRY PARTITION

SCALE: 1½"=1'-0"
DESIGN NO. U905 (SIMILAR)
1 LAYER ½" FIRE RATED GWB ON 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON ROOM SIDE.
1 LAYER ½" FIRE RATED GWB ON ½" FURRING CHANNELS ON STAIR SIDE.

2B ONE HOUR RATED EXTERIOR MASONRY PARTITION

SCALE: 1½"=1'-0"
DESIGN NO. U905 (SIMILAR)
1 LAYER ½" FIRE RATED GWB ON 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON ROOM SIDE.
8" NOM. CMU.
NO FURRING OR GWB ON SHAFT SIDE.

2C ONE HOUR RATED INTERIOR MASONRY PARTITION

SCALE: 1½"=1'-0"
DESIGN NO. U905 (SIMILAR)
NO GWB, WOOD FRAME OR SOUND ATTENUATION BATT ON ROOM SIDE.
8" NOM. CMU.
1 LAYER ½" FIRE RATED GWB ON ½" FURRING CHANNELS ON STAIR SIDE.



3 ONE HOUR RATED EXTERIOR BEARING PARTITION

SCALE: 1½"=1'-0"
DESIGN NO. U305
VINYL SIDING, 1 LAYER ¾" OSB SHEATHING WITH AIR INFILTRATION BARRIER ON EXTERIOR SIDE.
2" x 6" WOOD FRAME WITH R19 BATT INSULATION.
1 LAYER ½" FIRE RATED GWB ON INTERIOR SIDE.

3A NON-RATED EXTERIOR BEARING PARTITION

SCALE: 1½"=1'-0"
VINYL SIDING, 1 LAYER ¾" OSB SHEATHING WITH AIR INFILTRATION BARRIER ON EXTERIOR SIDE.
2" x 6" WOOD FRAME WITH R19 BATT INSULATION.
1 LAYER ½" GWB ON INTERIOR SIDE.



4 ONE HR RATED INTERIOR BEARING PARTITION

MIN. STC RATING: 50

SCALE: 1½"=1'-0"
DESIGN NO. U305 (SIMILAR)
2 LAYER ½" FIRE RATED GWB ON CORRIDOR SIDE.
1 LAYER ½" FIRE RATED GWB ON ROOM SIDE.
1 LAYER ½" FIRE RATED MOISTURE-RESISTANT GWB ON BATHROOM SIDE.

4A ONE HR RATED INTERIOR BEARING PARTITION

SCALE: 1½"=1'-0"
DESIGN NO. U305 (SIMILAR)
2 LAYER ½" FIRE RATED GWB ON CORRIDOR SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.
1 LAYER ½" FIRE RATED MOISTURE-RESISTANT GWB ON BATHROOM SIDE.

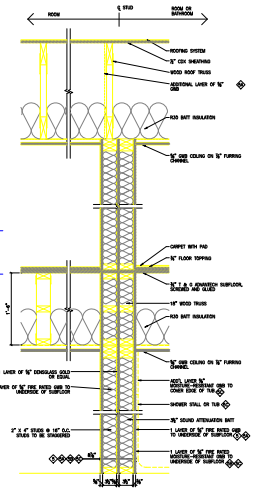

5 ONE HOUR RATED INTERIOR DEMISING PARTITION

MIN. STC RATING: 54

SCALE: 1½"=1'-0"
WALL DESIGN NO. U305 (SIMILAR), FLOOR DESIGN NO. L521, ROOF DESIGN NO. P531
1 LAYER ½" FIRE RATED GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON ROOM SIDE.
1 LAYER ½" FIRE RATED GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON OTHER SIDE.
1 LAYER ½" DENSGLASS GOLD OR EQUAL.
1 LAYER ½" FIRE RATED GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON OTHER SIDE.

5A ONE HOUR RATED INTERIOR DEMISING PARTITION

MIN. STC RATING: 54

SCALE: 1½"=1'-0"
WALL DESIGN NO. U305 (SIMILAR), FLOOR DESIGN NO. L521, ROOF DESIGN NO. P531
1 LAYER ½" FIRE RATED GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON ROOM SIDE.
1 LAYER ½" DENSGLASS GOLD OR EQUAL.
1 LAYER ½" FIRE RATED GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON OTHER SIDE.
ADDITIONAL LAYER OF ½" FIRE RATED GWB ON ONE SIDE OF WOOD TRUSS.

5B ONE HOUR RATED INTERIOR DEMISING PARTITION

MIN. STC RATING: 54

SCALE: 1½"=1'-0"
WALL DESIGN NO. U305 (SIMILAR), FLOOR DESIGN NO. L521, ROOF DESIGN NO. P531
1 LAYER ½" FIRE RATED GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON ROOM SIDE.
1 LAYER ½" DENSGLASS GOLD OR EQUAL.
1 LAYER ½" FIRE RATED GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.
1 LAYER ½" FIRE RATED MOISTURE-RESISTANT GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON BATHROOM SIDE.

5C ONE HOUR RATED INTERIOR DEMISING PARTITION

MIN. STC RATING: 54

SCALE: 1½"=1'-0"
WALL DESIGN NO. U305 (SIMILAR), FLOOR DESIGN NO. L521, ROOF DESIGN NO. P531
1 LAYER ½" FIRE RATED GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON ROOM SIDE.
1 LAYER ½" DENSGLASS GOLD OR EQUAL.
1 LAYER ½" FIRE RATED MOISTURE-RESISTANT GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON BATHROOM SIDE.
1 ADDITIONAL LAYER ½" MOISTURE-RESISTANT GWB TO COVER EDGE OF TUB.



6 ONE HR RATED INTERIOR BEARING PARTITION

MIN. STC RATING: 38

SCALE: 1½"=1'-0"
DESIGN NO. U305
1 LAYER ½" FIRE RATED GWB ON EACH SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.

6A NON-RATED INTERIOR PARTITION

SCALE: 1½"=1'-0"
1 LAYER ½" GWB ON EACH SIDE.
2" x 4" WOOD FRAME.

6B NON-RATED INTERIOR PARTITION

SCALE: 1½"=1'-0"
MIN. STC RATING: 36
1 LAYER ½" GWB ON ROOM SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.
1 LAYER ½" MOISTURE-RESISTANT GWB ON BATHROOM SIDE.

6C NON-RATED INTERIOR PARTITION

SCALE: 1½"=1'-0"
MIN. STC RATING: 36
1 LAYER ½" GWB ON EACH SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.



7 ONE HR RATED INTERIOR BEARING PARTITION

MIN. STC RATING: 50

SCALE: 1½"=1'-0"
DESIGN NO. U305
2 LAYER ½" FIRE RATED GWB ON CORRIDOR SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.
1 LAYER ½" FIRE RATED MOISTURE-RESISTANT GWB ON BATHROOM SIDE.
1 ADDITIONAL LAYER ½" MOISTURE-RESISTANT GWB TO COVER EDGE OF TUB.

7A NON-RATED INTERIOR PARTITION

MIN. STC RATING: 50

SCALE: 1½"=1'-0"
1 LAYER ½" GWB ON ROOM SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.
1 LAYER ½" MOISTURE-RESISTANT GWB ON BATHROOM SIDE.
1 ADDITIONAL LAYER ½" MOISTURE-RESISTANT GWB TO COVER EDGE OF TUB.



8 NON-RATED PLUMBING CHASE

SCALE: 1½"=1'-0"
MIN. STC RATING: 36
1 LAYER ½" GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON ROOM SIDE.
1 LAYER ½" GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON OTHER SIDE.

8A NON-RATED PLUMBING CHASE

SCALE: 1½"=1'-0"
1 LAYER ½" GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON ROOM SIDE.
1 LAYER ½" MOISTURE-RESISTANT GWB, 2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT ON BATHROOM SIDE.



9 NON-RATED INTERIOR FURRING

SCALE: 1½"=1'-0"
1 LAYER OF ½" GWB ON ROOM SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.

9A NON-RATED INTERIOR FURRING

SCALE: 1½"=1'-0"
1 LAYER OF ½" MOISTURE-RESISTANT GWB ON BATHROOM SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.



10 NON-RATED INTERIOR PARTITION

SCALE: 1½"=1'-0"
MIN. STC RATING: 38
1 LAYER ½" GWB ON EACH SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.

10A NON-RATED INTERIOR PARTITION

SCALE: 1½"=1'-0"
MIN. STC RATING: 38
1 LAYER ½" GWB ON ROOM SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.
1 LAYER ½" MOISTURE-RESISTANT GWB ON BATHROOM SIDE.



11 NON-RATED INTERIOR PARTITION

SCALE: 1½"=1'-0"
MIN. STC RATING: 38
1 LAYER ½" GWB ON ROOM SIDE.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.
1 LAYER ½" MOISTURE-RESISTANT GWB ON BATHROOM SIDE.
1 ADDITIONAL LAYER ½" MOISTURE-RESISTANT GWB TO COVER EDGE OF TUB.



12 NON-RATED INTERIOR FURRING

SCALE: 1½"=1'-0"
1 LAYER ½" MOISTURE-RESISTANT GWB ON BATHROOM SIDE.
1 ADDITIONAL LAYER ½" MOISTURE-RESISTANT GWB TO COVER EDGE OF TUB.
2" x 4" WOOD FRAME WITH 3½" SOUND ATTENUATION BATT.



13 ONE HR RATED SHAFT WALL

SCALE: 1½"=1'-0"
DESIGN NO. U488
1" THICK GYP. LINER PANEL ON SHAFT SIDE.
3½" "C"-H" STUD @ 24" O.C.
1 LAYER ½" GWB ON ROOM SIDE.

800.700.3305

Q-CAD
CAD PAPER TO CAD