





1  
A 1 3D EXTERIOR PERSPECTIVE  
SCALE: NTS

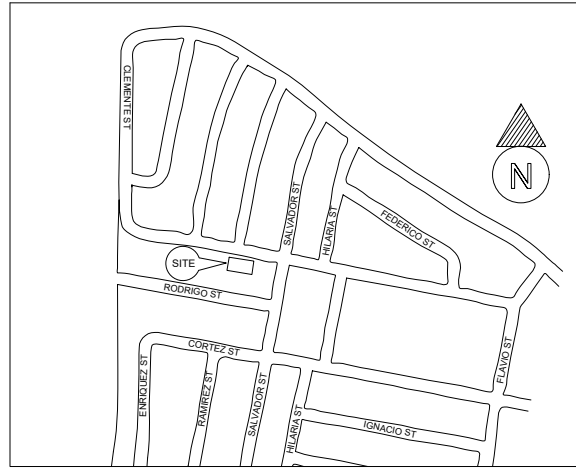

2  
A 1 VICINITY MAP  
SCALE: NTS

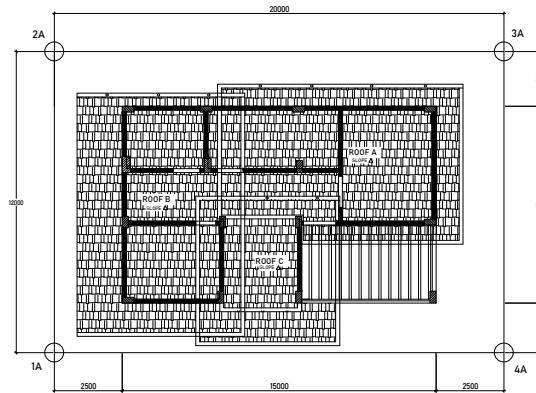


3  
A 1 SITE DEVELOPMENT PLAN  
SCALE: 1:100

| TECHNICAL DESCRIPTION |                           |
|-----------------------|---------------------------|
| LOT A                 |                           |
| 1A-2A                 | 14.123494°N, 121.151352°E |
| 2A-3A                 | 14.123556°N, 121.151364°E |
| 3A-4A                 | 14.123545°N, 121.151443°E |
| 4A-1A                 | 14.123489°N, 121.151428°E |


## TABLE OF CONTENTS

|      |                                                                                                                              |
|------|------------------------------------------------------------------------------------------------------------------------------|
| A-01 | 3D EXTERIOR PERSPECTIVE<br>VICINITY MAP<br>SITE DEVELOPMENT PLAN                                                             |
| A-02 | FLOOR PLAN<br>FRONT & REAR ELEVATION<br>LEFT & RIGHT SIDE ELEVATION                                                          |
| A-03 | REFLECTED CEILING PLAN<br>ROOF PLAN<br>SECTION THRU -- X<br>SECTION THRU -- Y                                                |
| S-01 | STRUCTURAL NOTES                                                                                                             |
| S-02 | FOUNDATION PLAN<br>FOOTING DETAILS<br>WALL FOOTING DETAILS<br>ROOF BEAM DETAILS                                              |
| S-03 | ROOFING DETAILS<br>FRAMING PLAN                                                                                              |
| E-01 | PANEL BOARD MANAGEMENT<br>PANEL BOARD 1<br>PANEL BOARD 2<br>PANEL BOARD 3<br>CATV SINGLE DIAGRAM<br>TELEPHONE SINGLE DIAGRAM |
| E-02 | SCHEDULE OF LOADS<br>LIGHTING LAYOUT<br>POWER & AUXILIARY LAYOUT                                                             |
| P-01 | PLUMBING NOTES<br>PLUMBING DETAILS                                                                                           |
| P-02 | WATERLINE LAYOUT<br>SEWER LINE LAYOUT                                                                                        |
| P-03 | WATERLINE ISOMETRIC LAYOUT<br>SEWER LINE ISOMETRIC LAYOUT                                                                    |


|                                                |                             |                                                                  |            |
|------------------------------------------------|-----------------------------|------------------------------------------------------------------|------------|
| PROJECT TITLE:                                 | DESIGNED BY:                | SHEET CONTENTS:                                                  | SECTION:   |
| PROPOSED 3-STOREY RESIDENTIAL HOUSE            | SHIELA MAE A. PUTUNGAN, S02 | 3D EXTERIOR PERSPECTIVE<br>VICINITY MAP<br>SITE DEVELOPMENT PLAN | BSCE211A   |
| PROJECT LOCATION:                              |                             |                                                                  | DATE:      |
| SAN ANTONIO HEIGHTS PHASE 3, STO. TOMAS, BATS. |                             |                                                                  | MARCH 2024 |

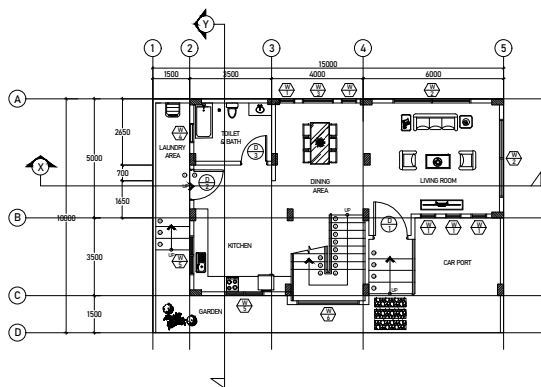

4  
A 2  
GROUND FLOOR PLAN  
SCALE: 1:100

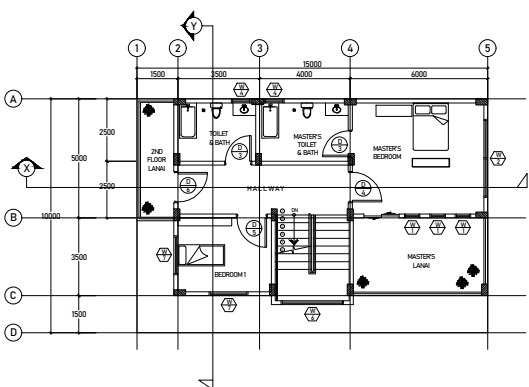


5  
A 2  
SECOND FLOOR PLAN  
SCALE: 1:100

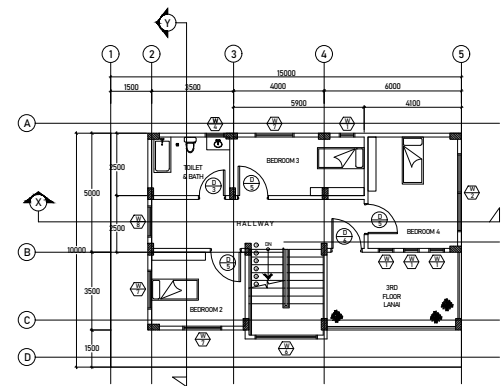


6  
A 2  
THIRD FLOOR PLAN  
SCALE: 1:100


| LEGEND |                                                         |
|--------|---------------------------------------------------------|
| (PT1)  | SMOOTH CIP CONCRETE IN LATEX PAINT FINISH (OFF-WHITE)   |
| (PT2)  | SMOOTH CIP CONCRETE IN LATEX PAINT FINISH (DARK GRAY)   |
| (PT3)  | SMOOTH CIP CONCRETE IN LATEX PAINT FINISH (LIGHT BROWN) |

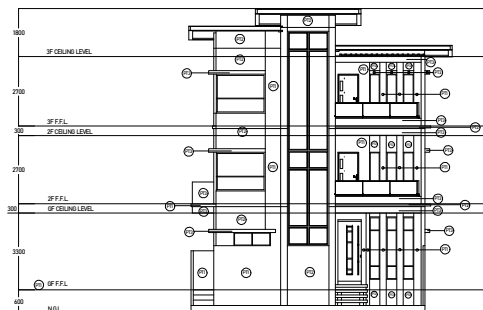


7  
A 2  
FRONT ELEVATION  
SCALE: 1:150

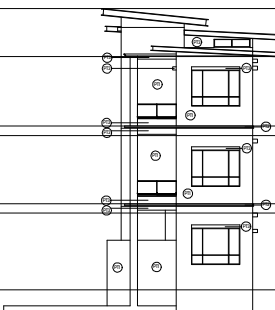

8  
A 2  
RIGHT SIDE ELEVATION  
SCALE: 1:150

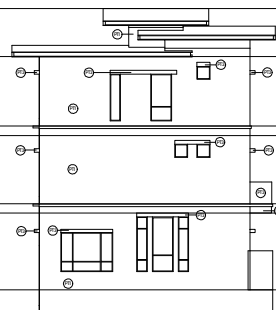


9  
A 2  
REAR ELEVATION  
SCALE: 1:150

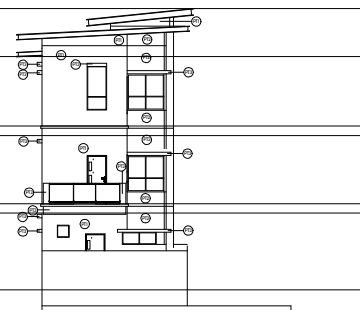


8  
A 2  
LEFT SIDE ELEVATION  
SCALE: 1:150


|                                                |                             |                                                                     |            |
|------------------------------------------------|-----------------------------|---------------------------------------------------------------------|------------|
| PROJECT TITLE:                                 | DESIGNED BY:                | SHEET CONTENTS:                                                     | SECTION:   |
| PROPOSED 3-STOREY RESIDENTIAL HOUSE            | SHIELA MAE A. PUTUNGAN, S02 | FLOOR PLAN<br>FRONT & REAR ELEVATION<br>RIGHT & LEFT SIDE ELEVATION | BSCE211A   |
| PROJECT LOCATION:                              |                             |                                                                     | DATE:      |
| SAN ANTONIO HEIGHTS PHASE 3, STO. TOMAS, BATS. |                             |                                                                     | MARCH 2024 |

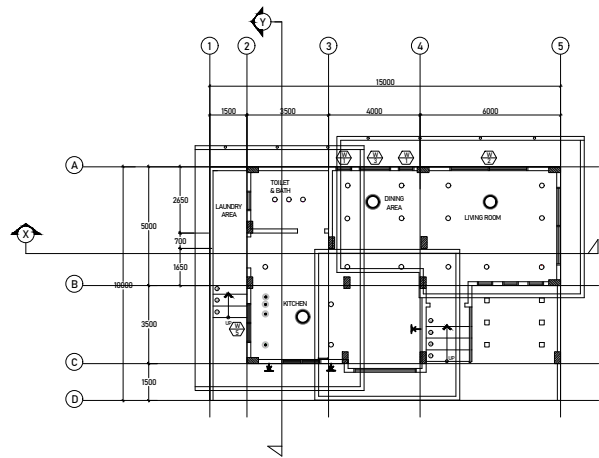

GROUND FLOOR  
REFLECTED CEILING PLAN  
SCALE: 1:100

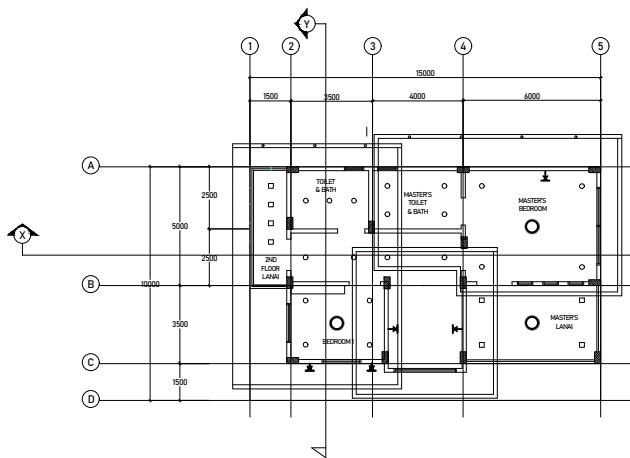


SECOND FLOOR  
REFLECTED CEILING PLAN  
SCALE: 1:100

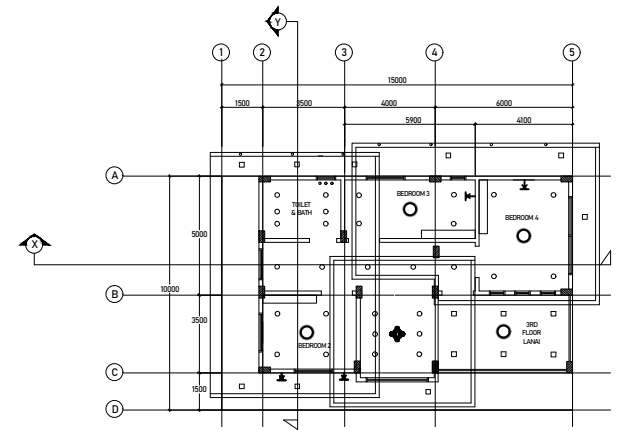


THIRD FLOOR  
REFLECTED CEILING PLAN  
SCALE: 1:100


| LIGHTING LEGENDS |                  |
|------------------|------------------|
| SYMBOL           | DESCRIPTION      |
|                  | DECORATIVE LIGHT |
|                  | PIN LIGHT        |
|                  | SPOT LIGHT       |
|                  | PANEL LIGHT      |
|                  | VANITY LIGHT     |
|                  | CHANDELIER LIGHT |
|                  | WALL LIGHT       |

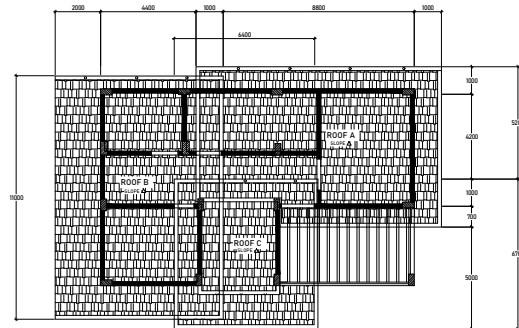

ROOF PLAN  
SCALE: 1:100

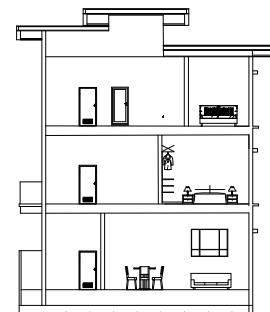

SECTION THRU -- X  
SCALE: 1:150

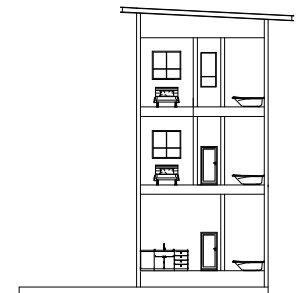


SECTION THRU -- Y  
SCALE: 1:150

|                                                |                             |                                                                               |            |
|------------------------------------------------|-----------------------------|-------------------------------------------------------------------------------|------------|
| PROJECT TITLE:                                 | DESIGNED BY:                | SHEET CONTENTS:                                                               | SECTION:   |
| PROPOSED 3-STOREY RESIDENTIAL HOUSE            | SHIELA MAE A. PUTUNGAN, S02 | REFLECTED CEILING PLAN<br>ROOF PLAN<br>SECTION THRU -- X<br>SECTION THRU -- Y | BSCE211A   |
| PROJECT LOCATION:                              |                             |                                                                               | DATE:      |
| SAN ANTONIO HEIGHTS PHASE 3, STO. TOMAS, BATS. |                             |                                                                               | MARCH 2024 |

1. ALL ELECTRICAL WORKS INDICATED HEREIN SHALL BE DONE IN ACCORDANCE WITH THE LATEST ISSUED EDITIONS OF THE PHILIPPINE ELECTRICAL CODE, THE LAWS AND ORDINANCES OF THE LOCAL CODE ENFORCING AUTHORITIES, AND THE TECHNICAL SPECIFICATIONS FOR ELECTRICAL WORKS OF THIS PROJECT.
2. POWER SOURCE SHALL BE 230V, 3Ø, 3W, 60HZ. THERE SHALL BE ONLY ONE SERVICE DROP TO THE BUILDING.
3. ALL INSTALLATIONS SHALL BE CONCEALED FROM VIEW BY INSTALLING CONDUCTORS IN:
  - IMC-EXPOSED INDOOR OR OUTDOOR
  - EMT-EXPOSED INDOOR
  - PVC-CONCEALED IN CONCRETEUNLESS OTHERWISE SPECIFIED IN THE DRAWINGS
4. MINIMUM SIZE OF CONDUCTORS WHEN NOT INDICATED IN THE DRAWINGS SHALL BE 3.5mm TYPE THHN.
5. MINIMUM SIZE OF CONDUITS TO BE USED SHALL BE 16mm (1/2") NOMINAL DIAMETER, 20mm (PVC).
6. MINIMUM SIZE OF CONDUIT FOR INTERCOM AND CABLE TV SYSTEMS SHALL BE 21mm, 27mmØ (PVC).
7. TELEPHONE SYSTEM PLANS AND SPECIFICATIONS SHALL BE SUBJECT TO THE APPROVAL OF THE TELEPHONE COMPANY.
8. ONLY HIGH POWER FACTOR BALLAST SHALL BE USED FOR FLUORESCENT LAMP LIGHTING FIXTURE.
9. REFER TO TABLE 12.11.3 (a) OF THE PHILIPPINE ELECTRICAL CODE FOR PROPER CONDUIT SIZES CONTAINING CONDUITS WHEN SUCH ARE NOT INDICATED IN THE DRAWINGS.
10. WHENEVER NECESSARY PULLBOXES SHALL BE PROVIDED EVEN IF NOT INDICATED IN PLANS.
11. 100mm X 100mm OCTAGONAL BOXES SHALL BE INSTALLED AT CEILING TO BE USED AS TAPPING POINT FOR CONDUCTORS LEADING TO THE LIGHTING FIXTURES.
12. ALL RECEPTACLES SHALL BE OF THE GROUNDING TYPE.
13. ADEQUATE AND EFFECTIVE GROUNDING SHALL BE PROVIDED.
14. PROVIDE AN INSULATED, GREEN-COLORED EQUIPMENT GROUNDING CONDUCTOR IN ALL FEEDERS AND BRANCH CIRCUITS.
15. ALL PANELEBOARD SHALL BE PROVIDED WITH GROUNDING TERMINALS.
16. TELEPHONE BOX/CABINET SHALL BE PROPERLY GROUNDED.
17. CIRCUIT BREAKERS SHALL BE BOLT-ON TYPE AND OF THE MAGNETIC-THERMAL TYPE COMMON TRIP WITH THE RATINGS AND NUMBER OF POLES AS INDICATED IN THE DRAWINGS.
18. ALL MOLDED CASE CIRCUIT BREAKERS FOR MOTORS SHALL BE INDUSTRIAL TYPE.
19. THE ELECTRICAL CONTRACTOR SHALL SUBMIT A SAMPLE OF ANY ITEM THAT HE INTENDS TO INSTALL OR USE IN THIS PROJECT TO THE ARCHITECT/ENGINEER FOR APPROVAL.
20. ALL WIRES AND CABLES SHALL BE COLOR CODED AS FOLLOWS:
  - LINE A..... RED
  - LINE B..... YELLOW
  - LINE C..... BLUE
  - LINE D..... GREEN
21. COMPLETED WIRING SYSTEMS SHALL BE TESTED FOR INSULATION RESISTANCE. THE TEST SHOULD BE MADE WITH A MEGGER WITH ALL SWITCHBOARDS, PANELBOARDS, SWITCHES, AND OVER-CURRENT DEVICES IN PLACE.
22. ALL ELECTRICAL WORKS SHALL BE DONE UNDER THE DIRECT AND IMMEDIATE SUPERVISION OF DULY QUALIFIED LICENSED ELECTRICAL ENGINEER.

1. LIGHT CONTROL SWITCHES: 1.37M (4'-6") FROM CENTER OF DEVICE TO FIN. FLOOR LINE.
2. CONVENIENCE & TEL. OUTLET: 0.30M (1'-0") FROM CENTER OF PLATE TO FIN. FLOOR LINE OR 0.15M (6") ABOVE WORKING COUNTER OR FITTED INTO BASEBOARD IF REQUIRED BY THE ARCHITECT.
3. PANELBOARD, FAP, & TTC: 1.37M (4'-6") FROM BOTTOM OF PANEL TO FIN. FLOOR LINE UNLESS OTHERWISE REQUIRED BY FIELD CONDITIONS.

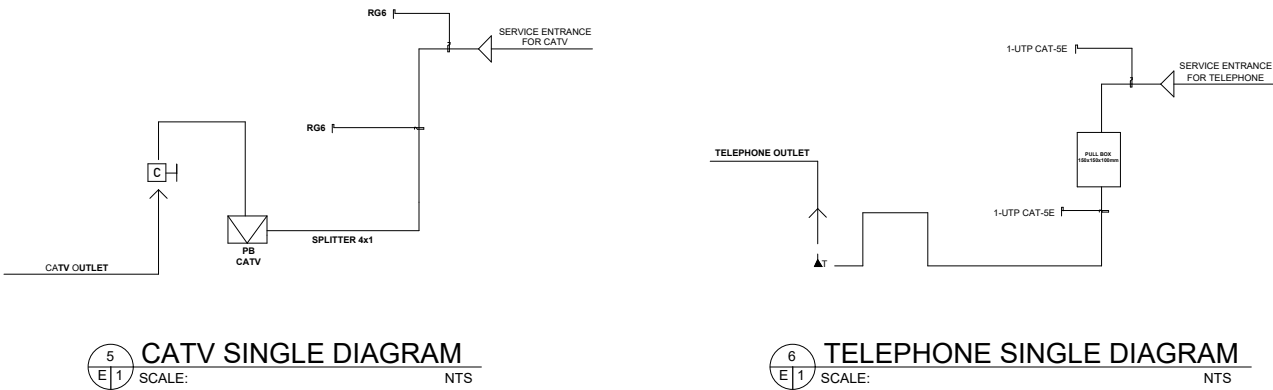

|                                                |                             |                                                                                                                                   |            |
|------------------------------------------------|-----------------------------|-----------------------------------------------------------------------------------------------------------------------------------|------------|
| PROJECT TITLE:                                 | DESIGNED BY:                | SHEET CONTENTS:                                                                                                                   | SECTION:   |
| PROPOSED 3-STOREY RESIDENTIAL HOUSE            | SHIELA MAE A. PUTUNGAN, S02 | PANEL BOARD MANAGEMENT<br>PANEL BOARDS<br>ELECTRICAL NOTES<br>MOUNTING HEIGHTS<br>CATV SINGLE DIAGRAM<br>TELEPHONE SINGLE DIAGRAM | BSCE211A   |
| PROJECT LOCATION:                              |                             |                                                                                                                                   | DATE:      |
| SAN ANTONIO HEIGHTS PHASE 3, STO. TOMAS, BATS. |                             |                                                                                                                                   | MARCH 2024 |

SERVICE ENTRANCE: 230 VOLTS, 60 HZ, 2 WIRES + 1 GROUND

| SCHEDULE OF LOADS                                                                      |                           |     |                                  |       |         |        |             |           |    |   |                                                 |  |
|----------------------------------------------------------------------------------------|---------------------------|-----|----------------------------------|-------|---------|--------|-------------|-----------|----|---|-------------------------------------------------|--|
| CKT NO.                                                                                | LOAD DESCRIPTION          | QTY | WATTS                            | VOLTS | AMPS    | DF     | DEMAND AMPS | CB RATING |    |   | WIRE AND CONDUITS                               |  |
|                                                                                        |                           |     |                                  |       |         |        |             | AT        | AF | P |                                                 |  |
| 1                                                                                      | LIGHTING                  | 8   | 800                              | 230   | 3.48    | 100%   | 3.48        | 20        | 50 | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 2                                                                                      | LIGHTING                  | 12  | 1200                             | 230   | 5.22    | 100%   | 5.22        | 20        | 50 | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 3                                                                                      | LIGHTING                  | 13  | 1300                             | 230   | 5.65    | 100%   | 5.65        | 20        | 50 | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 4                                                                                      | CONVENIENCE OUTLET        | 8   | 1440                             | 230   | 6.65    | 100%   | 6.65        | 20        | 50 | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 5                                                                                      | 1HP ACU                   | 1   | 1840                             | 230   | 8.00    | 100%   | 8.00        | 30        | 50 | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 6                                                                                      | WATER HEATER SINGLE POINT | 1   | 3500                             | 230   | 15.22   | 80%    | 12.17       | 20        | 50 | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 7                                                                                      | WASHING MACHINE           | 1   | 2000                             | 230   | 8.70    | 80%    | 6.96        | 20        | 50 | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 8                                                                                      | COOKTOP                   | 1   | 3000                             | 230   | 13.04   | 80%    | 10.43       | 20        | 50 | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 9                                                                                      | REFRIGERATOR              | 1   | 800                              | 230   | 3.48    | 80%    | 2.78        | 20        | 50 | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 10                                                                                     | SPARE                     | 1   |                                  | 230   |         |        |             |           |    |   |                                                 |  |
| 11                                                                                     | TOTAL                     |     |                                  |       |         |        |             |           |    |   |                                                 |  |
|                                                                                        | Design Analysis           |     | 15880                            | 230   | 69.4400 | 91.11% | 61.34       |           |    |   |                                                 |  |
| Total Ampere                                                                           |                           |     | 61.34 AMPERES                    |       |         |        |             |           |    |   |                                                 |  |
| Total Demand Load:                                                                     |                           |     | 61.34 * (0.25) ÷ = 63.34 AMPERES |       |         |        |             |           |    |   |                                                 |  |
| USE: 2 - 30mm <sup>2</sup> THHW + 1-8.0mm <sup>2</sup> THHN/THWN IN 32mm dia. PVC pipe |                           |     |                                  |       |         |        |             |           |    |   |                                                 |  |
| 80 AT/80 AF MAIN BREAKER                                                               |                           |     |                                  |       |         |        |             |           |    |   |                                                 |  |


SERVICE ENTRANCE: 230 VOLTS, 60 HZ, 2 WIRES + 1 GROUND

| SCHEDULE OF LOADS                                                                      |                    |     |                                  |       |       |        |             |           |    |   |                                                 |  |
|----------------------------------------------------------------------------------------|--------------------|-----|----------------------------------|-------|-------|--------|-------------|-----------|----|---|-------------------------------------------------|--|
| CKT NO.                                                                                | LOAD DESCRIPTION   | QTY | WATTS                            | VOLTS | AMPS  | DF     | DEMAND AMPS | CB RATING |    |   | WIRE AND CONDUITS                               |  |
|                                                                                        |                    |     |                                  |       |       |        |             | AT        | AF | P |                                                 |  |
| 1                                                                                      | LIGHTING           | 7   | 700                              | 230   | 3.04  | 100%   | 3.04        | 20        | 50 | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 2                                                                                      | LIGHTING           | 11  | 1100                             | 230   | 4.78  | 100%   | 4.78        | 20        | 50 | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 3                                                                                      | LIGHTING           | 16  | 1600                             | 230   | 6.96  | 100%   | 6.96        | 20        | 50 | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 4                                                                                      | CONVENIENCE OUTLET | 6   | 1080                             | 230   | 4.70  | 100%   | 4.70        | 20        | 50 | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 5                                                                                      | CONVENIENCE OUTLET | 7   | 1260                             | 230   | 5.48  | 100%   | 5.48        | 30        | 50 | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 6                                                                                      | 1 HP WACU          | 1   | 1840                             | 230   | 8.00  | 100%   | 8.00        | 20        | 50 | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 7                                                                                      | WATER HEATER       | 1   | 3500                             | 230   | 15.22 | 80%    | 12.18       | 20        | 50 | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 8                                                                                      | WATER HEATER       | 1   | 3500                             | 230   | 15.22 | 80%    | 12.18       | 20        | 50 | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 9                                                                                      | 1 HP WACU          | 1   | 1840                             | 230   | 8.00  | 100%   | 8.00        | 20        | 50 | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 10                                                                                     | SPARE              | 1   |                                  | 230   |       |        |             |           |    |   |                                                 |  |
| 11                                                                                     | SPARE              | 1   |                                  |       |       |        |             |           |    |   |                                                 |  |
| TOTAL                                                                                  |                    |     | 15880                            | 230   | 71.37 | 95.50% | 65.32       |           |    |   |                                                 |  |
| Design Analysis                                                                        |                    |     |                                  |       |       |        |             |           |    |   |                                                 |  |
| Total Ampere                                                                           |                    |     | 65.32 AMPERES                    |       |       |        |             |           |    |   |                                                 |  |
| Total Demand Load:                                                                     |                    |     | 65.32 * (0.25) ÷ = 67.33 AMPERES |       |       |        |             |           |    |   |                                                 |  |
| USE: 2 - 30mm <sup>2</sup> THHN + 1-8.0mm <sup>2</sup> THHN/THWN IN 32mm dia. PVC pipe |                    |     |                                  |       |       |        |             |           |    |   |                                                 |  |
| 80 AT/80 AF MAIN BREAKER                                                               |                    |     |                                  |       |       |        |             |           |    |   |                                                 |  |


SERVICE ENTRANCE: 230 VOLTS, 60 HZ, 2 WIRES + 1 GROUND

| SCHEDULE OF LOADS        |                    |     |                          |       |         |      |                                                                                       |           |       |   |                                                 |  |
|--------------------------|--------------------|-----|--------------------------|-------|---------|------|---------------------------------------------------------------------------------------|-----------|-------|---|-------------------------------------------------|--|
| CKT NO.                  | LOAD DESCRIPTION   | QTY | WATTS                    | VOLTS | AMPS    | DF   | DEMAND AMPS                                                                           | CB RATING |       |   | WIRE AND CONDUITS                               |  |
|                          |                    |     |                          |       |         |      |                                                                                       | AT        | AF    | P |                                                 |  |
| 1                        | LIGHTING           | 10  | 1000                     | 230   | 4.35    | 100% | 4.35                                                                                  | 20        | 50    | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 2                        | LIGHTING           | 19  | 1900                     | 230   | 8.26    | 100% | 8.26                                                                                  | 20        | 50    | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 3                        | LIGHTING           | 18  | 1800                     | 230   | 7.83    | 100% | 7.83                                                                                  | 20        | 50    | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 4                        | CONVENIENCE OUTLET | 9   | 1620                     | 230   | 7.04    | 100% | 7.04                                                                                  | 20        | 50    | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 5                        | CONVENIENCE OUTLET | 4   | 720                      | 230   | 3.13    | 100% | 3.13                                                                                  | 30        | 50    | 2 | 2-3.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 6                        | 1 HP WACU          | 1   | 1840                     | 230   | 8.00    | 100% | 8.00                                                                                  | 20        | 50    | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 7                        | WATER HEATER       | 1   | 3500                     | 230   | 15.22   | 80%  | 12.18                                                                                 | 20        | 50    | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 8                        | WATER HEATER       | 1   | 3500                     | 230   | 15.22   | 80%  | 12.18                                                                                 | 20        | 50    | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 9                        | 1 HP WACU          | 1   | 1840                     | 230   | 8.00    | 100% | 8.00                                                                                  | 20        | 50    | 2 | 2-5.5mm <sup>2</sup> THHN IN 20mm dia. PVC pipe |  |
| 10                       | SPARE              | 1   |                          | 230   |         |      |                                                                                       |           |       |   |                                                 |  |
| TOTAL                    |                    |     |                          |       | 15880   | 230  | 77.05                                                                                 | 95.50%    | 70.97 |   |                                                 |  |
| Design Analysis          |                    |     |                          |       |         |      |                                                                                       |           |       |   |                                                 |  |
| Total Ampere             |                    |     | 70.97                    |       | AMPERES |      |                                                                                       |           |       |   |                                                 |  |
| Total Demand Load:       |                    |     | 70.97 * (0.25) ÷ = 72.97 |       | AMPERES |      | USE: 2 - 30mm <sup>2</sup> THHW + 1-8.0mm <sup>2</sup> THN/THWN IN 32mm dia. PVC pipe |           |       |   |                                                 |  |
| 80 AT/80 AF MAIN BREAKER |                    |     |                          |       |         |      |                                                                                       |           |       |   |                                                 |  |


| LEGENDS |                               |        |                         |        |                     |
|---------|-------------------------------|--------|-------------------------|--------|---------------------|
| SYMBOL  | DESCRIPTION                   | SYMBOL | DESCRIPTION             | SYMBOL | DESCRIPTION         |
|         | WEATHER PROOF WALL LIGHT      |        | RANGE RECEPTACLE        |        | ONE GANG SWITCH     |
|         | PANEL BOARD                   |        | REFRIGERATOR RECEPTACLE |        | THREE-WAY SWITCH    |
|         | KWH METER                     |        | GROUND                  |        | KILOWATT HOUR METER |
|         | WATERPROOF CONVENIENCE OUTLET |        | ACU RECEPTACLE          |        | TELEPHONE           |
|         | SERVICE ENTRANCE              |        | WATER HEATER OUTLET     |        | CABLE TV            |

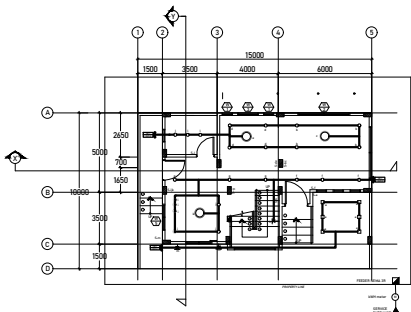


GROUND FLOOR  
LIGHTING LAYOUT  
SCALE: 1:150

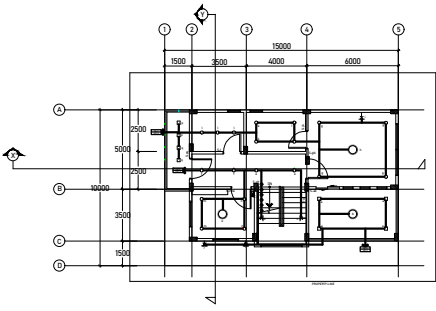


SECOND FLOOR  
LIGHTING LAYOUT  
SCALE: 1:150

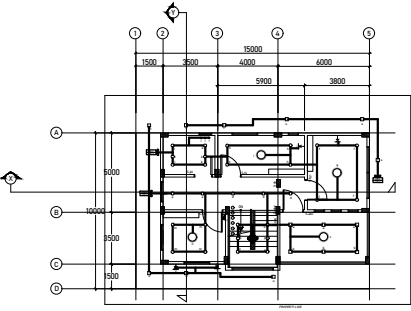


THIRD FLOOR  
LIGHTING LAYOUT  
SCALE: 1:150

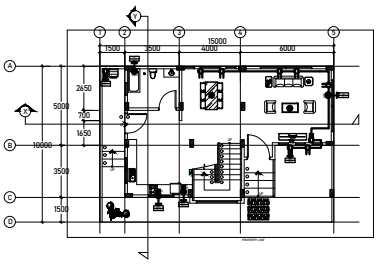

GROUND FLOOR  
POWER & AUXILIARY LAYOUT  
SCALE: 1:150

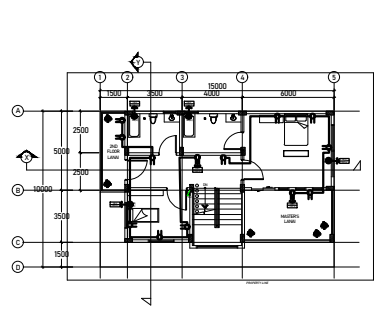

SECOND FLOOR  
POWER & AUXILIARY LAYOUT  
SCALE: 1:150

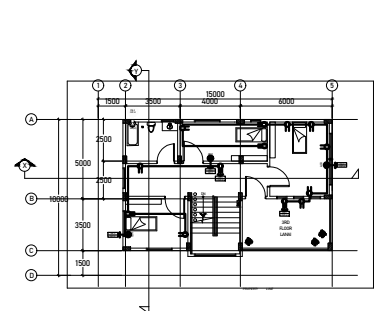

THIRD FLOOR  
POWER & AUXILIARY LAYOUT  
SCALE: 1:150

PROJECT TITLE:  
PROPOSED 3-STOREY RESIDENTIAL HOUSE

PROJECT LOCATION:  
SAN ANTONIO HEIGHTS PHASE 3, ST. TOMAS, BATS.

DESIGNED BY:  
SHIELA MAE A. PUTUNGAN, S02

SHEET CONTENTS:  
SCHEDULE OF LOADS  
LIGHTING LAYOUT  
POWER & AUXILIARY LAYOUT

SECTION:  
BSCE211A  
DATE:  
MARCH 2024