


0 - Plumbing - Fire System

1 : 50

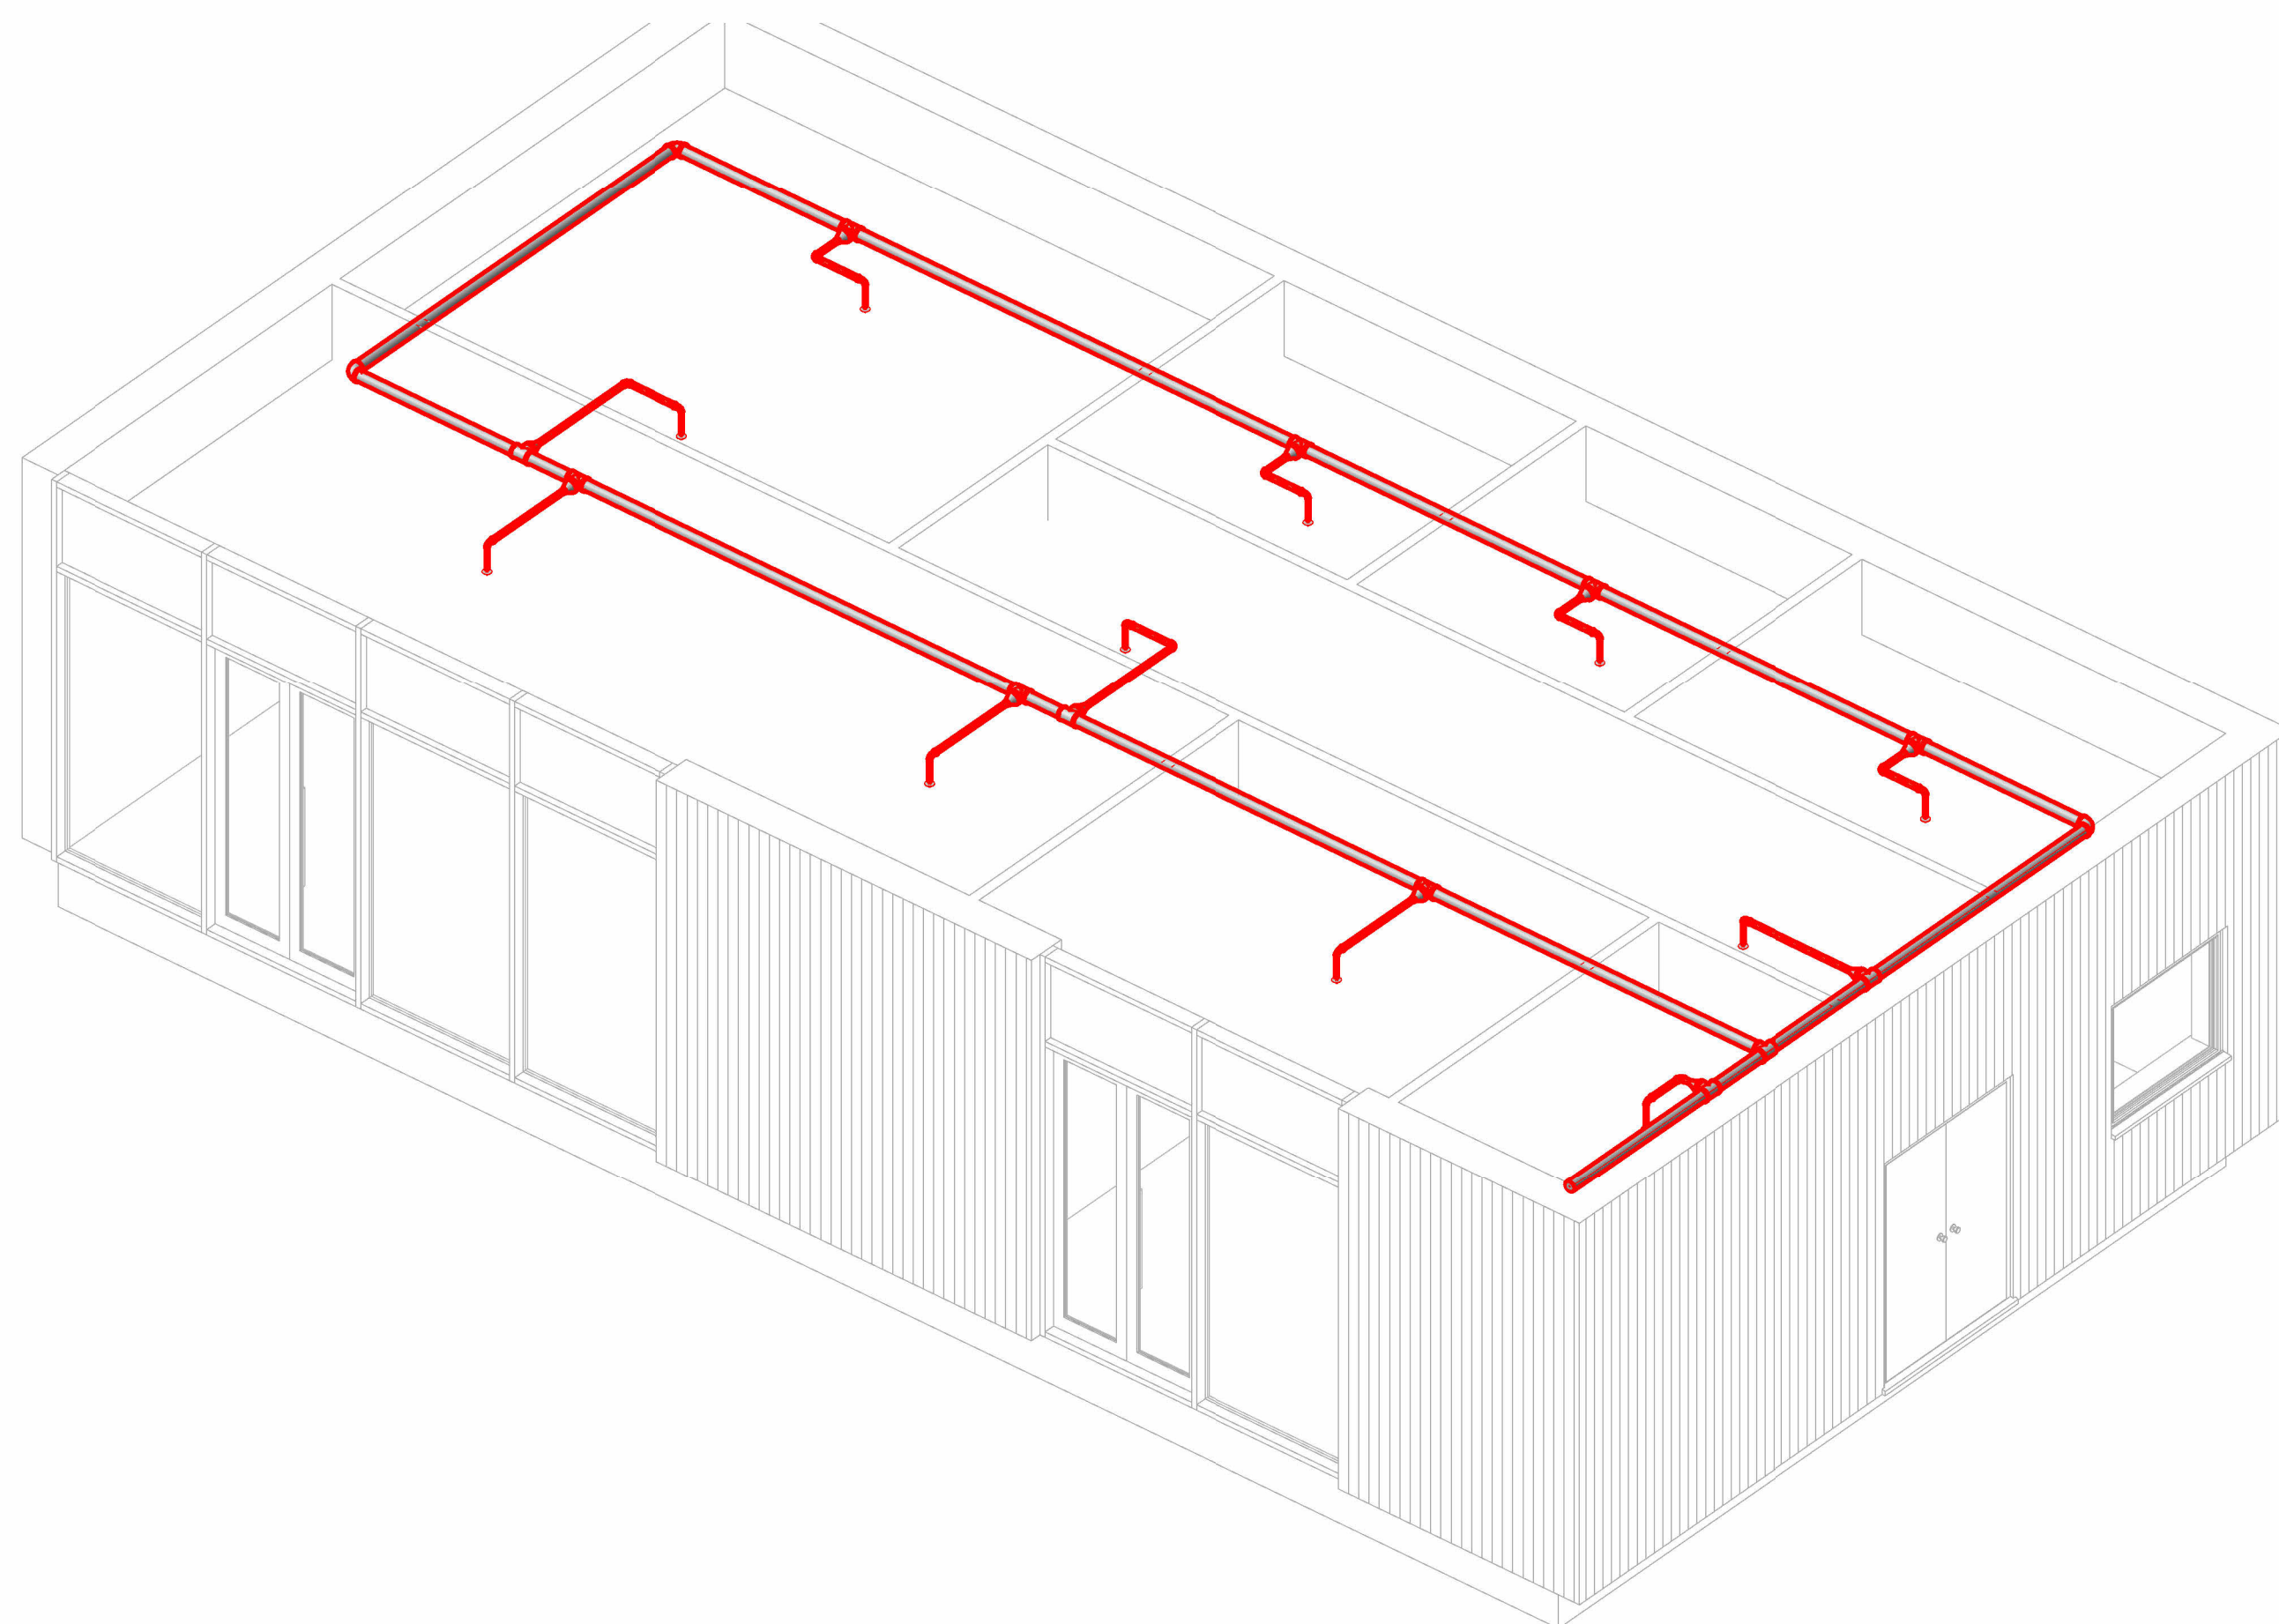

3D View Fire Protection

2

Fire Protection Pipe Fitting Schedule		
Family and Type	Size	Count
Elbow - Threaded - GMI: Standard	15 mmø-15 mmø	11
Elbow - Threaded - GMI: Standard	25 mmø-25 mmø	7
Elbow - Threaded - GMI: Standard	80 mmø-80 mmø	3
Socket Reducing - Threaded - GMI: Standard	25 mmø-15 mmø	11
Socket Reducing - Threaded - GMI: Standard	80 mmø-25 mmø	11
Tee - Threaded - GMI: Standard	80 mmø-80 mmø-80 mmø	12

Sprinkler Schedule			
Mark	Family and Type	Flow	Level
1	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0
2	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0
3	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0
4	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0
5	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0
6	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0
7	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0
8	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0
9	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0
10	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0
11	M_Sprinkler - Pendent - Semi-Recessed - Hosted: 15 mm Pendent	2.0 L/s	Level 0



Revit MEP Autumn 2022

[illegible]

CODE	SUITABILITY DESCRIPTION
A1	Construction
STATUS	PURPOSE OF ISSUE

Educational Exercise
NOT FOR CONSTRUCTION

PROJECT	
---------	--

Revit MEP-03

TITLE

Fire Protection

CLIENT	
--------	--

Owner

DRAWN BY PV	CHECKED BY Checker	DATE 10/22/20
SCALE (@ A1) 1 : 50	PROJECT NUMBER RMEP03	
DRAWING NUMBER M-0002		REV