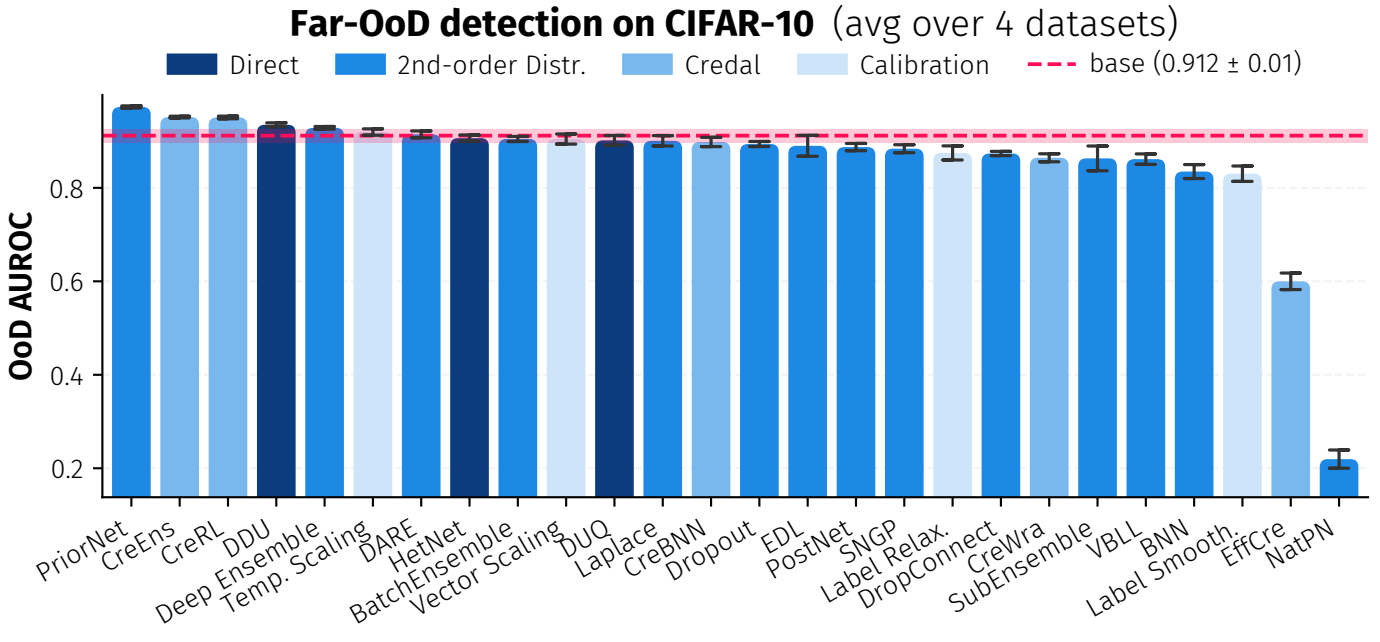
Far-OoD detection on CIFAR-10 (avg over 4 datasets)
Direct
2nd-order Distr.
Credal
Calibration
base (0.912 ± 0.01)
OoD AUROC
0.8
0.6
0.4
0.2
PriorNet
CreEns
CreRL
DDU
Deep Ensemble
Temp. Scaling
DARE
HetNet
BatchEnsemble
Vector Scaling
DUQ
Laplace
CreBNN
Dropout
EDL
PostNet
SNGP
Label Relax.
DropConnect
CreWra
SubEnsemble
VBLL
BNN
Label Smooth.
EffCre
NatPN