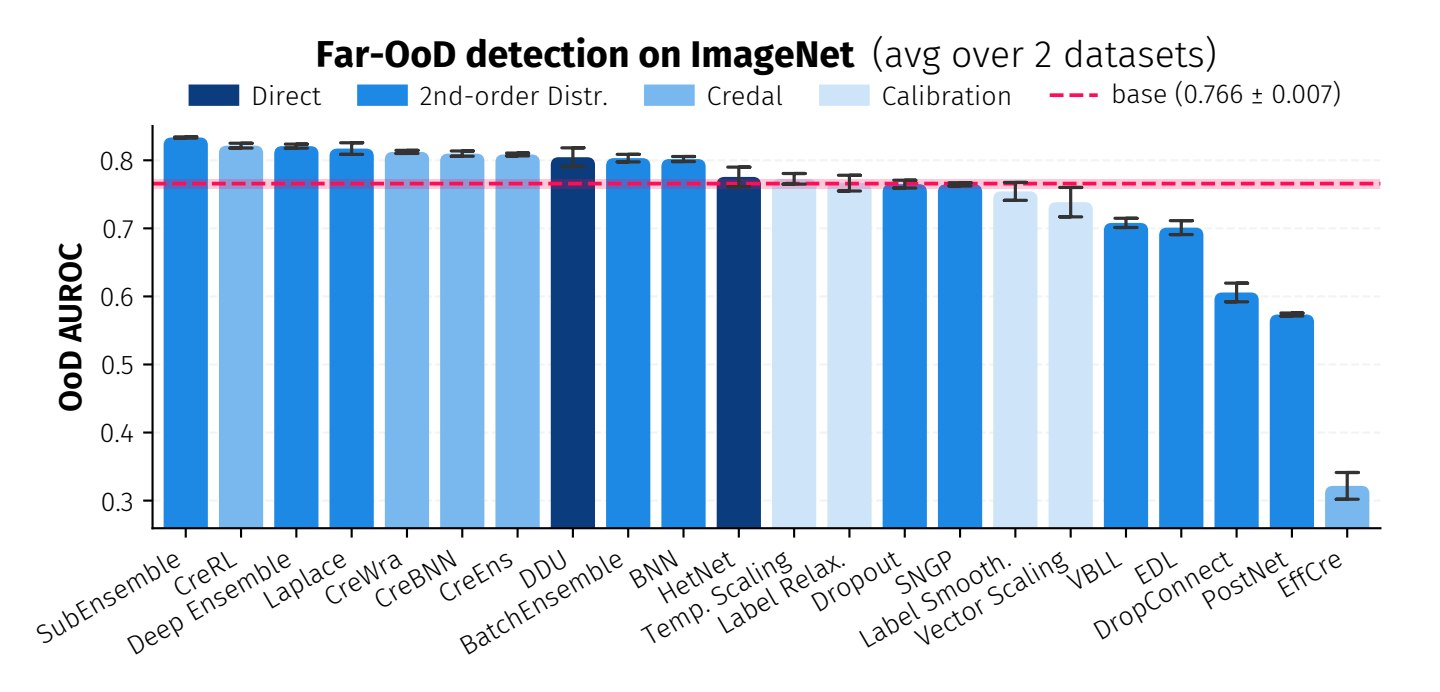
Far-OoD detection on ImageNet (avg over 2 datasets)
Direct
2nd-order Distr.
Credal
Calibration
base (0.766 ± 0.007)
OoD AUROC
0.8
0.7
0.6
0.5
0.4
0.3
SubEnsemble
CreRL
Deep Ensemble
Laplace
CreWra
CreBNN
CreEns
DDU
BatchEnsemble
BNN
HetNet
Temp. Scaling
Label Relax.
Dropout
SNGP
Label Smooth.
Vector Scaling
VBLL
EDL
DropConnect
PostNet
EffCre