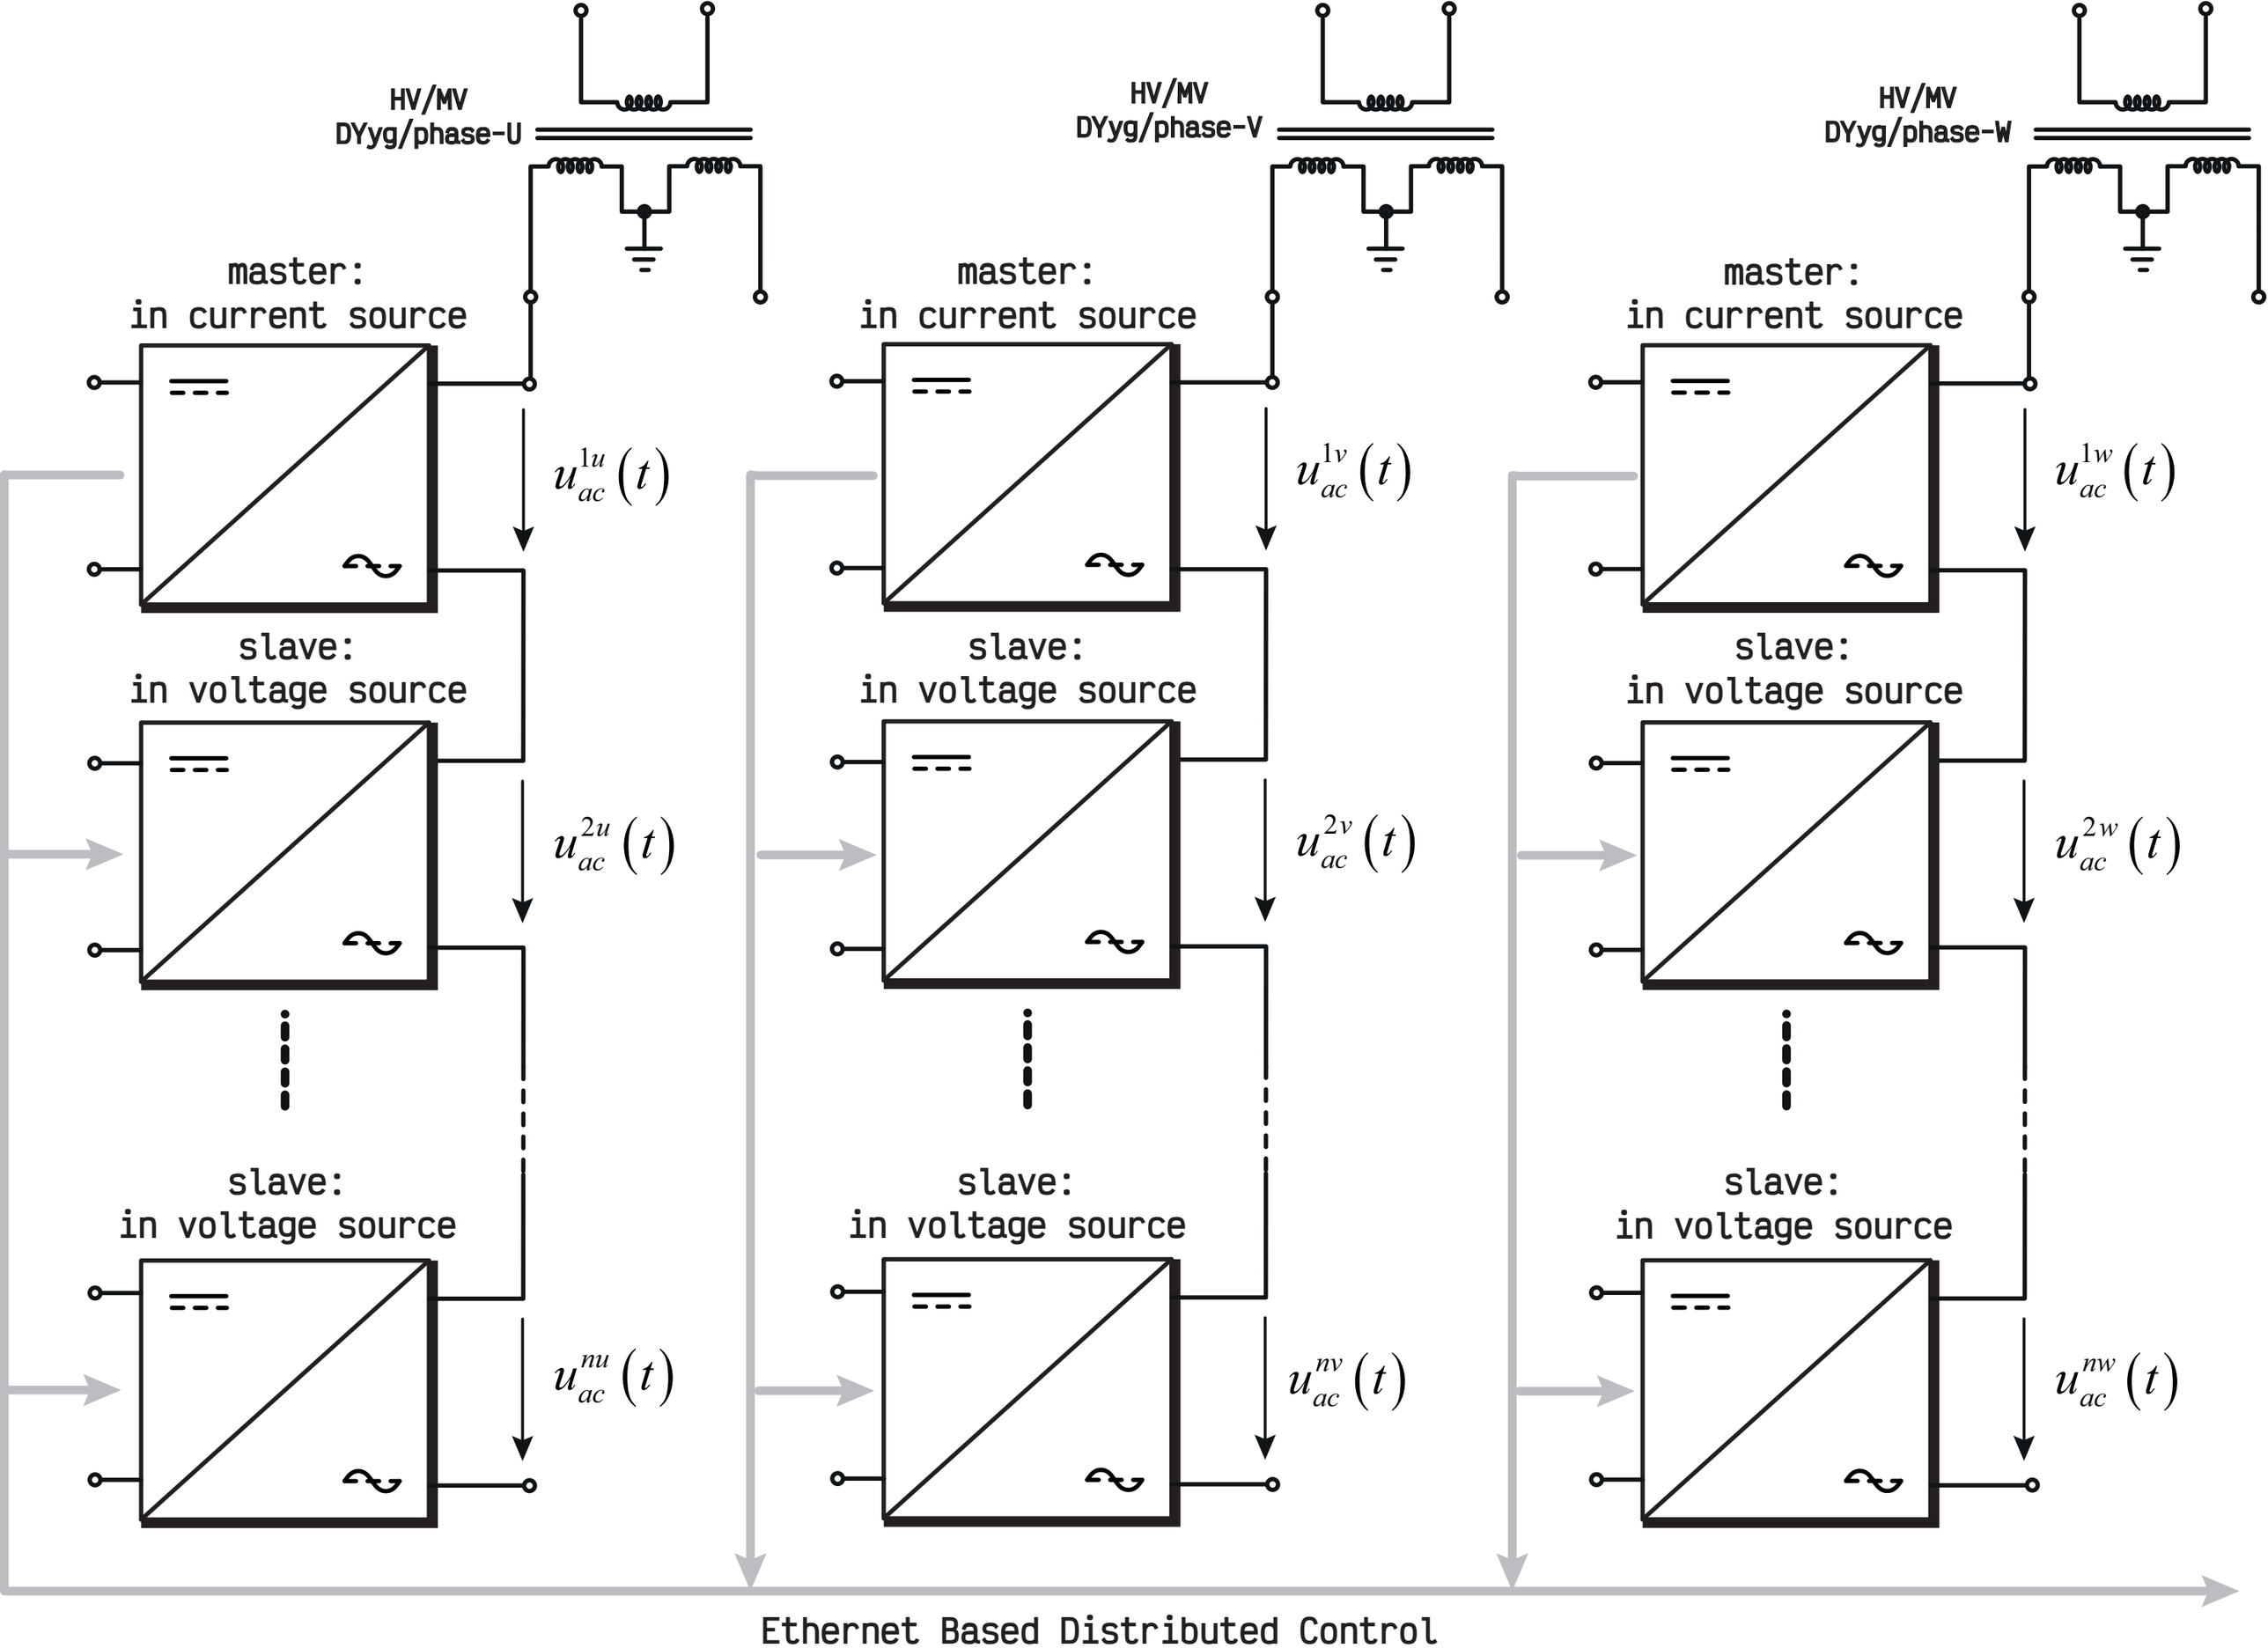
HV/MV
DYyg/phase-U
master:
in current source
$u_{ac}^{1u}(t)$
slave:
in voltage source
$u_{ac}^{2u}(t)$
slave:
in voltage source
$u_{ac}^{nu}(t)$
HV/MV
DYyg/phase-V
master:
in current source
$u_{ac}^{1v}(t)$
slave:
in voltage source
$u_{ac}^{2v}(t)$
slave:
in voltage source
$u_{ac}^{nv}(t)$
HV/MV
DYyg/phase-W
master:
in current source
$u_{ac}^{1w}(t)$
slave:
in voltage source
$u_{ac}^{2w}(t)$
slave:
in voltage source
$u_{ac}^{nw}(t)$
Ethernet Based Distributed Control