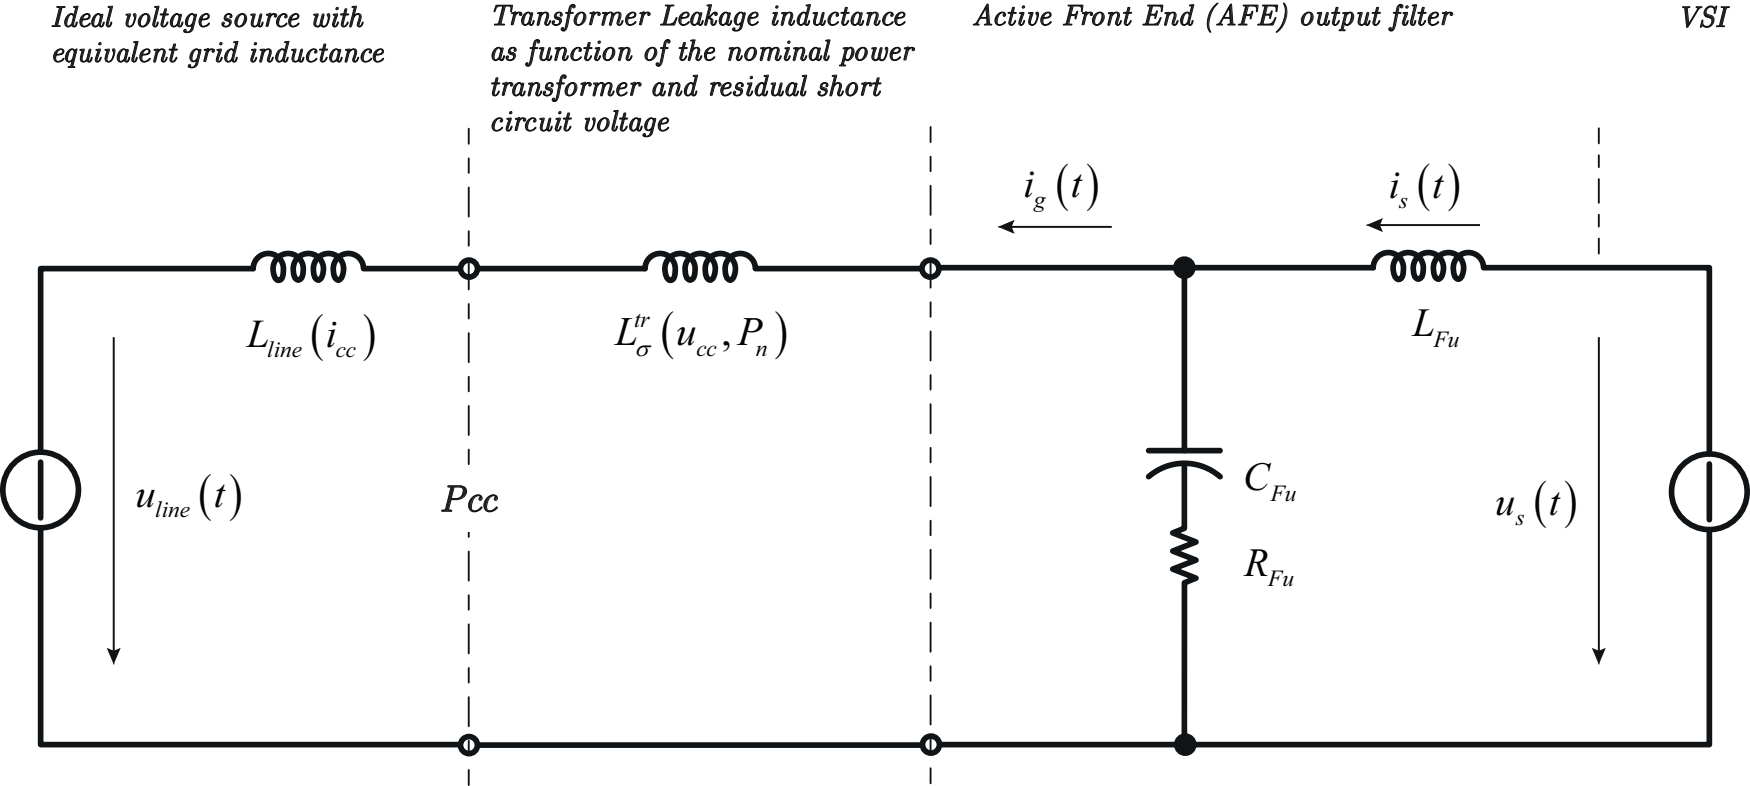

Ideal voltage source with equivalent grid inductance
Transformer Leakage inductance as function of the nominal power transformer and residual short circuit voltage
Active Front End (AFE) output filter
VSI
$i_g(t)$
$i_s(t)$
$L_{line}(i_{cc})$
$L_\sigma^{tr}(u_{cc}, P_n)$
$L_{Fu}$
$u_{line}(t)$
Pcc
$C_{Fu}$
$R_{Fu}$
$u_s(t)$