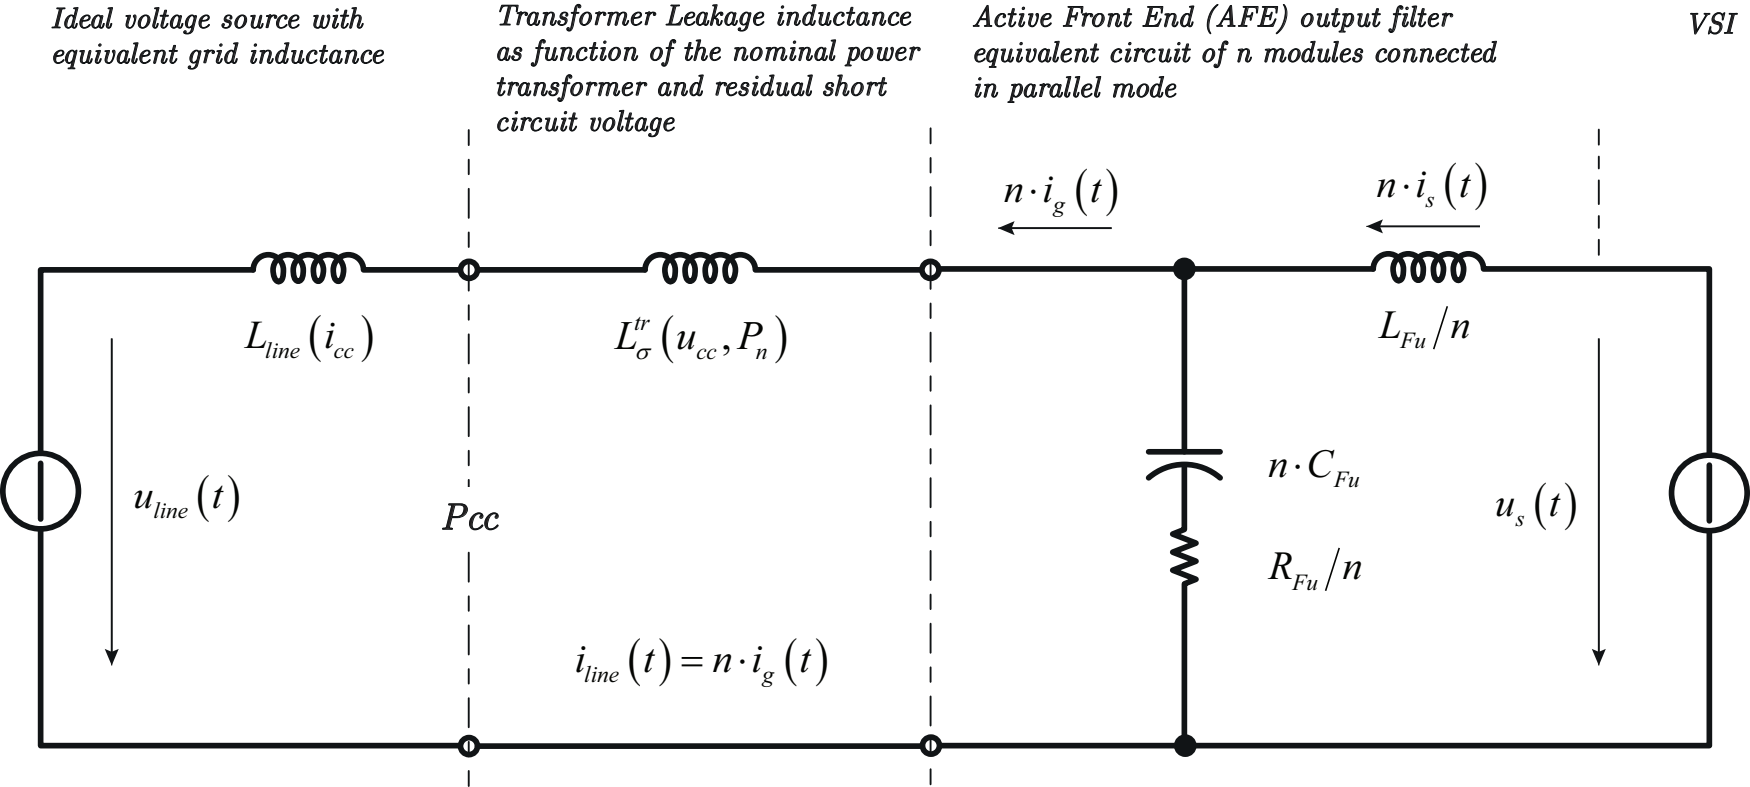

Ideal voltage source with equivalent grid inductance
Transformer Leakage inductance as function of the nominal power transformer and residual short circuit voltage
Active Front End (AFE) output filter equivalent circuit of n modules connected in parallel mode
VSI
$n \cdot i_g(t)$
$n \cdot i_s(t)$
$L_{line}(i_{cc})$
$L_{\sigma}^{tr}(u_{cc}, P_n)$
L_{Fu}/n
$u_{line}(t)$
Pcc
$n \cdot C_{Fu}$
R_{Fu}/n
$u_s(t)$
$i_{line}(t) = n \cdot i_g(t)$