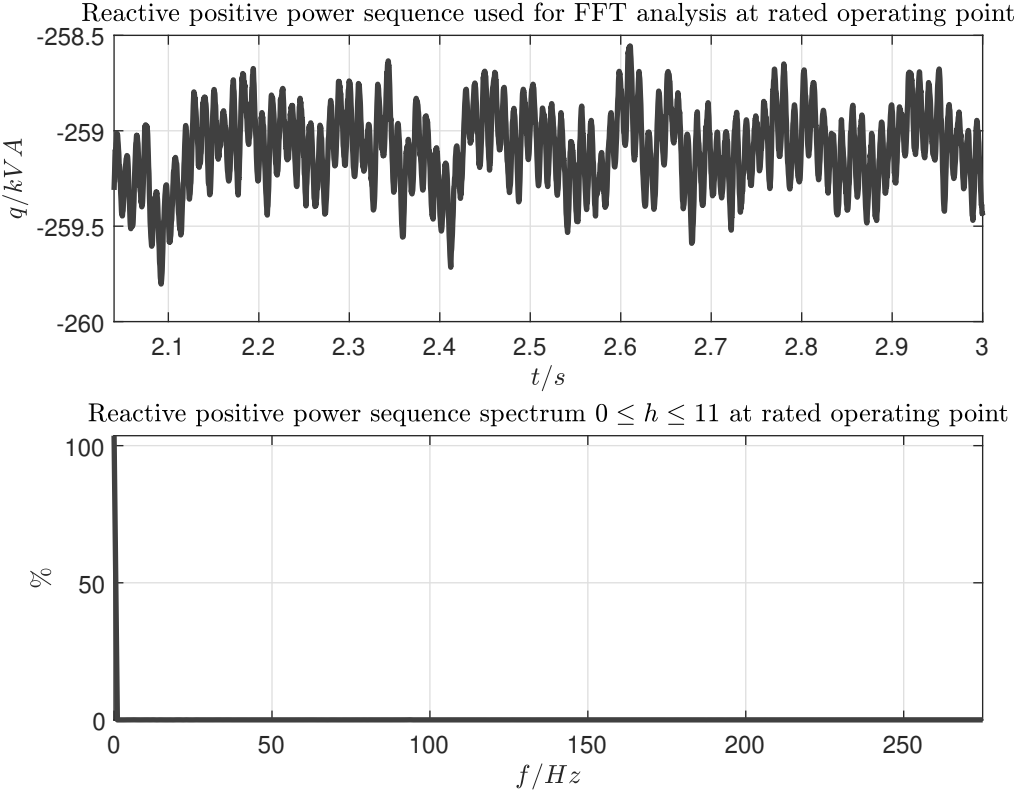

Reactive positive power sequence used for FFT analysis at rated operating point
-258.5
-259
-259.5
-260
q/kVA
2.1
2.2
2.3
2.4
2.5
2.6
2.7
2.8
2.9
3
t/s
Reactive positive power sequence spectrum 0 ≤ h ≤ 11 at rated operating point
100
50
0
%
0
50
100
150
200
250
f/Hz