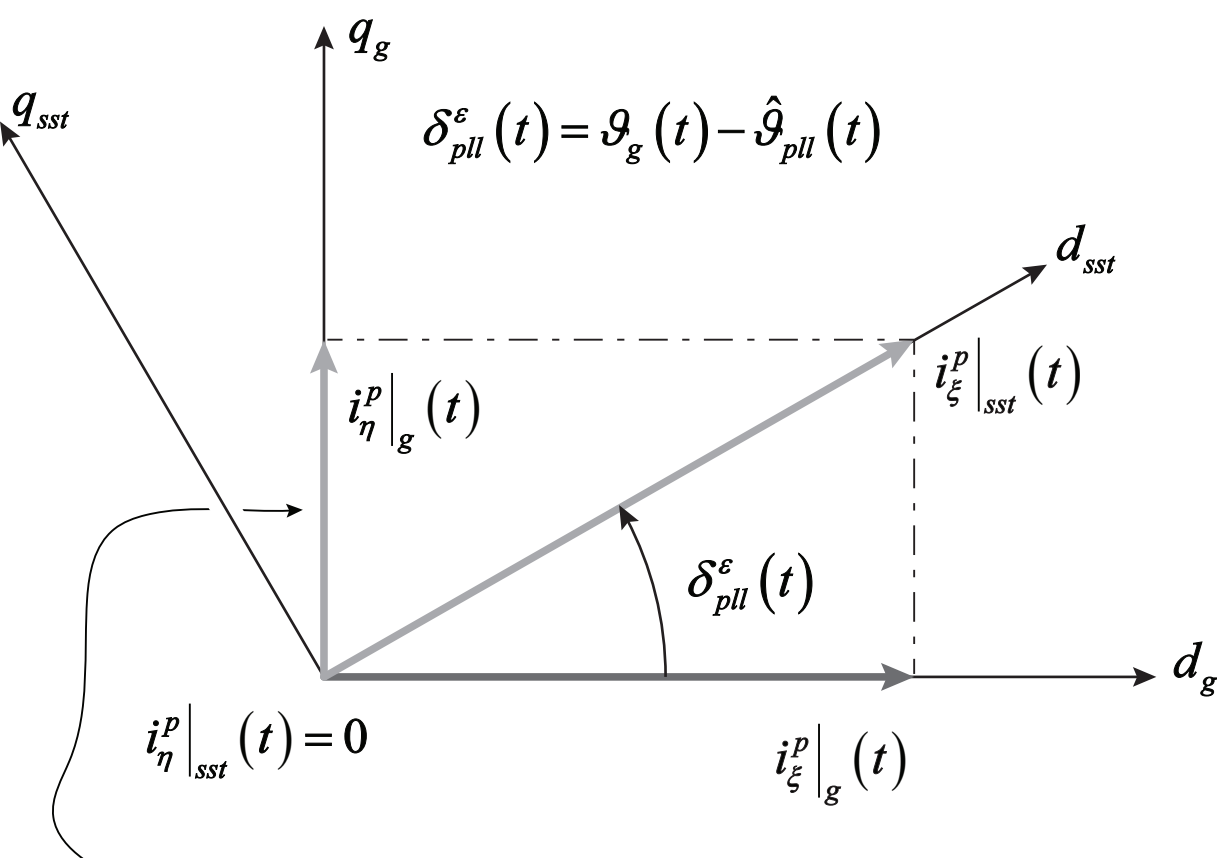


Presence of an unwanted reactive power into the grid would be an indicator of pll phase mismatch