


FLOOR PLAN NOTES




1. ALL GLAZING SHALL MEET THE REQUIREMENTS OF **C.R.C. 308**. SAFETY GLAZING SHALL BE PROVIDED IN ALL OF THE FOLLOWING LOCATIONS:
- GLAZING IN DOORS SHALL BE CONSIDERED A HAZARDOUS LOCATION EXCEPT GLAZING PANELS THROUGH WITH A 3 INCH DIAMETER SPHERE IS UNABLE TO PASS AND DECORATIVE GLAZING.
- GLAZING IN WALLS, ENCLOSURES, OR FENCES FACING HOT TUBS, SPAS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS, SHOWERS AND INDOOR OR OUTDOOR SWIMMING POOLS WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES MEASURED VERTICALLY ABOVE ANY STANDING OR WALKING SURFACE SHALL BE CONSIDERED A HAZARDOUS LOCATION. THIS SHALL APPLY TO SINGLE GLAZING AND ALL PANES IN MULTIPLE GLAZING.
- GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE BOTTOM EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE THE FLOOR OR WALKING SURFACE AND WHERE THE GLAZING IS WITHIN 24 INCHES OF EITHER SIDE OF THE DOOR IN THE PLANE OF THE DOOR IN A CLOSED POSITION OR WHERE THE GLAZING IS ON A WALL PERPENDICULAR TO THE PLANE OF THE DOOR IN A CLOSED POSITION AND WITHIN 24 INCHES OF THE HINGE SIDE OF AN IN-SWINGING DOOR.
- GLAZING WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 36 INCHES ABOVE THE PLANE OF THE ADJACENT WALKING SURFACE OF STAIRWAYS, LANDINGS BETWEEN FLIGHTS OF STAIRS AND RAMPS SHALL BE CONSIDERED A HAZARDOUS LOCATION.
2. CAULK ALL DOORS, WINDOWS, JOINTS AND AREAS REQUIRED TO PROVIDE A WEATHERPROOF SEAL.
3. DRYWALL NAILING SHALL BE IN ACCORDANCE WITH C.B.C. REQUIREMENTS FOR THE TYPES AND THICKNESSES BEING USED UNLESS OTHERWISE NOTED.
4. NO WATER CLOSET OR BIDET SHALL BE SET CLOSER THAN 15 INCHES FROM ITS CENTER TO A SIDE WALL OR OBSTRUCTION OR CLOSER TO CENTER TO A SIMILAR FIXTURE. THE CLEAR SPACE IN FRONT OF A WATER CLOSET, LAVATORY, OR BIDET SHALL BE NOT LESS THAN 24 INCHES. **C.P.C. 402.5**
5. BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NONABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 6 FEET ABOVE THE FLOOR. **C.R.C. 307.2**
6. WINDOW/FALL PROTECTION SHALL BE PROVIDED IN ACCORDANCE WITH **C.R.C. 312.2.1-312.2.2**
7. EGRESS WINDOW IN BEDROOM TO PROVIDE 5.7 SQUARE FEET OF CLEAR OPENING AND A MINIMUM CLEAR NET OPENING HEIGHT OF 24" AND WIDTH OF 20" **PER C.R.C. 310.2.1**

PLUMBING NOTES

1. ALL PLUMBING FOR THIS PROJECT IS NEW
2. SHOWERS AND TUB-SHOWER COMBINATIONS SHALL BE PROVIDED WITH INDIVIDUAL CONTROL VALVES OF THE PRESSURE BALANCE, THERMOSTATIC, OR COMBINATION PRESSURE BALANCE/THERMOSTATIC MIXING VALVE TYPE THAT PROVIDE SCALD AND THERMAL SHOCK PROTECTION FOR THE RATED FLOW RATE OF THE INSTALLED SHOWERHEAD. THESE VALVES SHALL BE INSTALLED AT THE POINT OF USE AND IN ACCORDANCE WITH ASSE 1016, OR ASME A112.1016/CSA B125.16 OR ASME A112.18.1/CSA B125.1. HANDLE POSITION STOPS SHALL BE PROVIDED ON SUCH VALVES AND SHALL BE ADJUSTED PER THE MANUFACTURER'S INSTRUCTIONS TO DELIVER A MAXIMUM MIXED WATER SETTING OF 120°F (49°C). **C.P.C. 408.3**
3. CONTROL VALVES AND SHOWERHEADS SHALL BE LOCATED ON THE SIDEWALL OF SHOWER COMPARTMENTS OR OTHERWISE ARRANGED SO THAT THE SHOWERHEAD DOES NOT LIE AT THE ENTRANCE TO THE SHOWER COMPARTMENT SO THAT THE BATHER CAN ADJUST THE VALVES BEFORE STEPPING INTO THE SHOWER SPRAY. **C.P.C. 408.9**
4. WATER HEATERS INSTALLED ON THIS PROJECT SHALL BE ANCHORED OR STRAPPED TO RESIST HORIZONTAL DISPLACEMENT DUE TO EARTHQUAKE MOTION. STRAPPING SHALL BE AT POINTS WITHIN THE UPPER ONE-THIRD AND LOWER ONE-THIRD OF ITS VERTICAL DIMENSIONS. AT THE LOWER POINT, A MINIMUM DISTANCE OF 4 IN. SHALL BE MAINTAINED ABOVE THE CONTROLS WITH THE STRAPPING. **C.P.C. 507.2** THIS APPLIES TO ALL NEW AND EXISTING WATER HEATERS PER THE CALIFORNIA HEALTH AND SAFETY CODE SECTION 19211(a)
5. WHERE A WATER HEATER IS INSTALLED PIPING SHALL BE INSULATED AS REQUIRED IN. **C.E.C. 150(J) 2**
6. POTABLE WATER OUTLETS WITH HOSE ATTACHMENTS OTHER THAN WATER HEATER DRAINS, BOILER DRAINS, AND CLOTHES WASHER CONNECTIONS. SHALL BE PROTECTED BY A NON REMOVABLE HOSE-BIB-TYPE BACKFLOW PREVENTER, A NON REMOVABLE HOSE BIB TYPE VACUUM BREAKER, OR BY AN ATMOSPHERIC VACUUM BREAKER INSTALLED NOT LESS THAN 6 IN. ABOVE THE HIGHEST POINT OF USAGE LOCATED ON THE DISCHARGE SIDE OF THE LAST VALVE. **C.P.C. 603.5.7**
7. EACH PLUMBING VENT SHALL TERMINATE NOT LESS THAN 10 FEET FROM, OR NOT LESS THAN 3 FEET ABOVE, AN OPENABLE WINDOW, DOOR, OPENING, AIR INTAKE, OR VENT SHAFT, OR NOT LESS THAN 3 FEET FROM A LOT LINE, ALLEY AND STREET EXCEPTED. **C.P.C. 906.2**

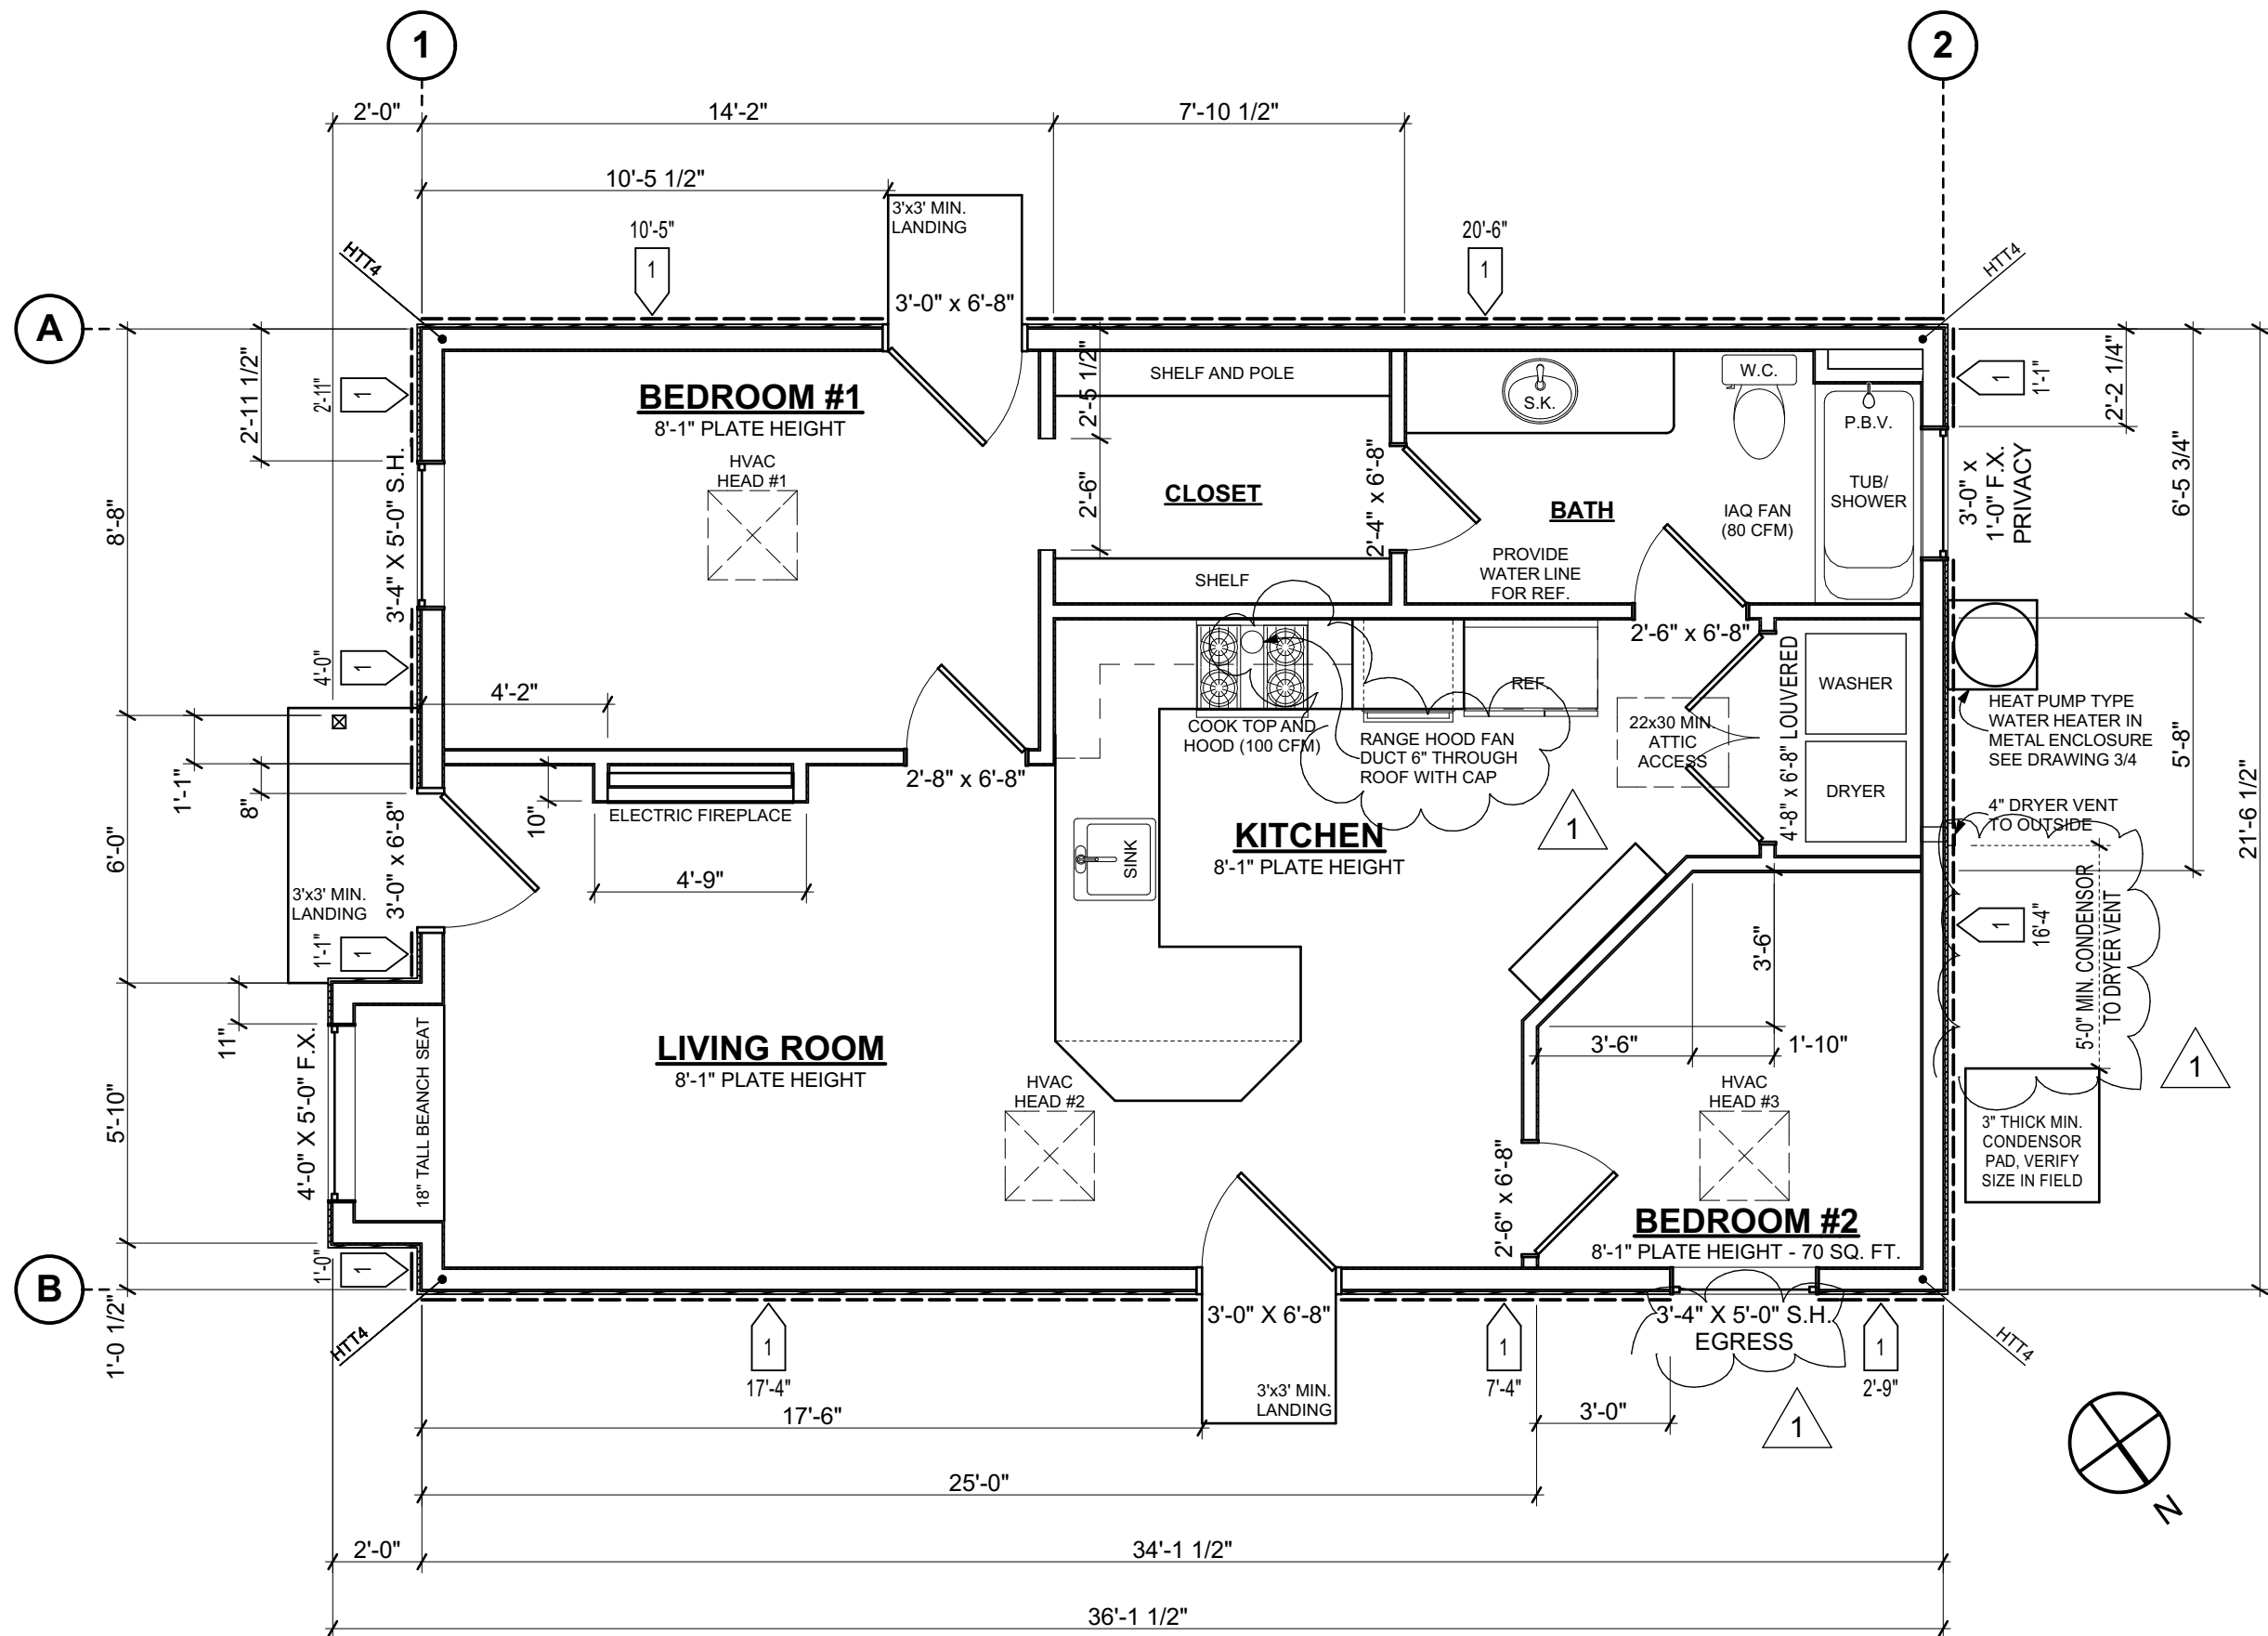

5 FLOOR PLAN
SCALE: 1/4" = 1'-0"

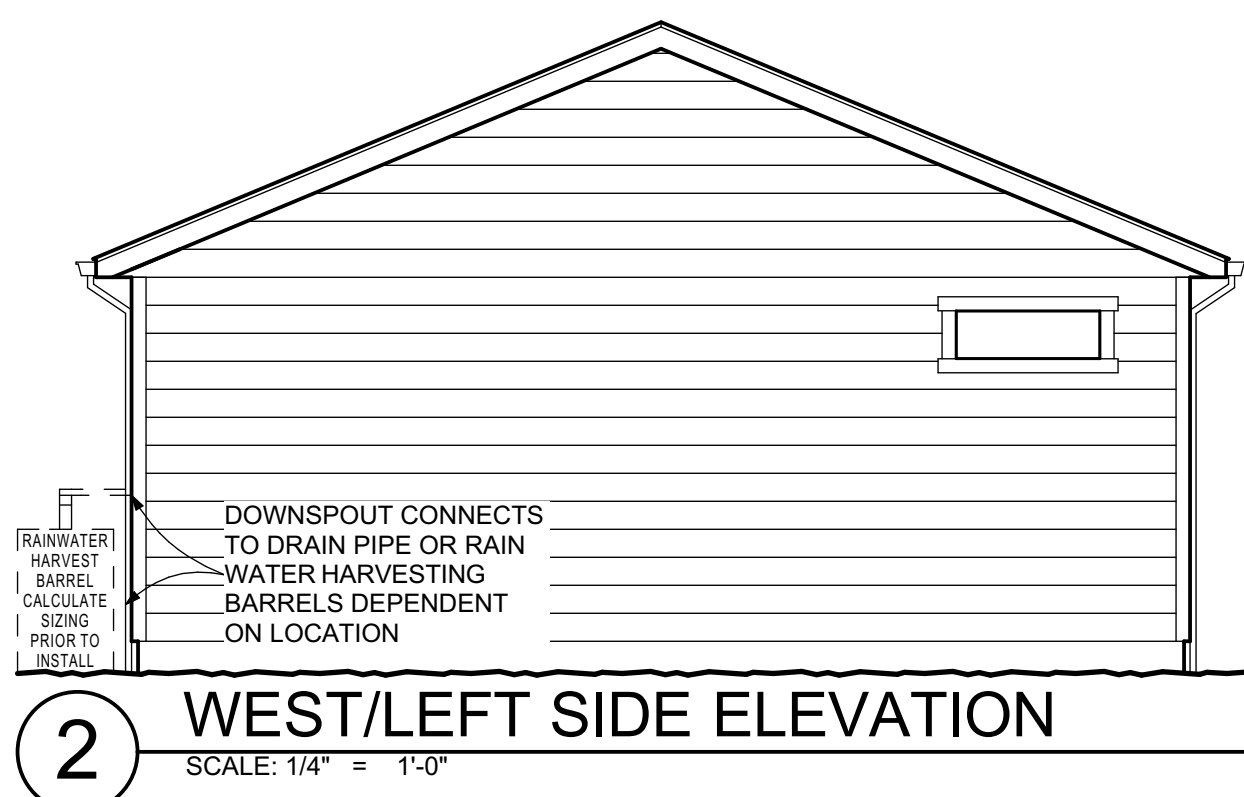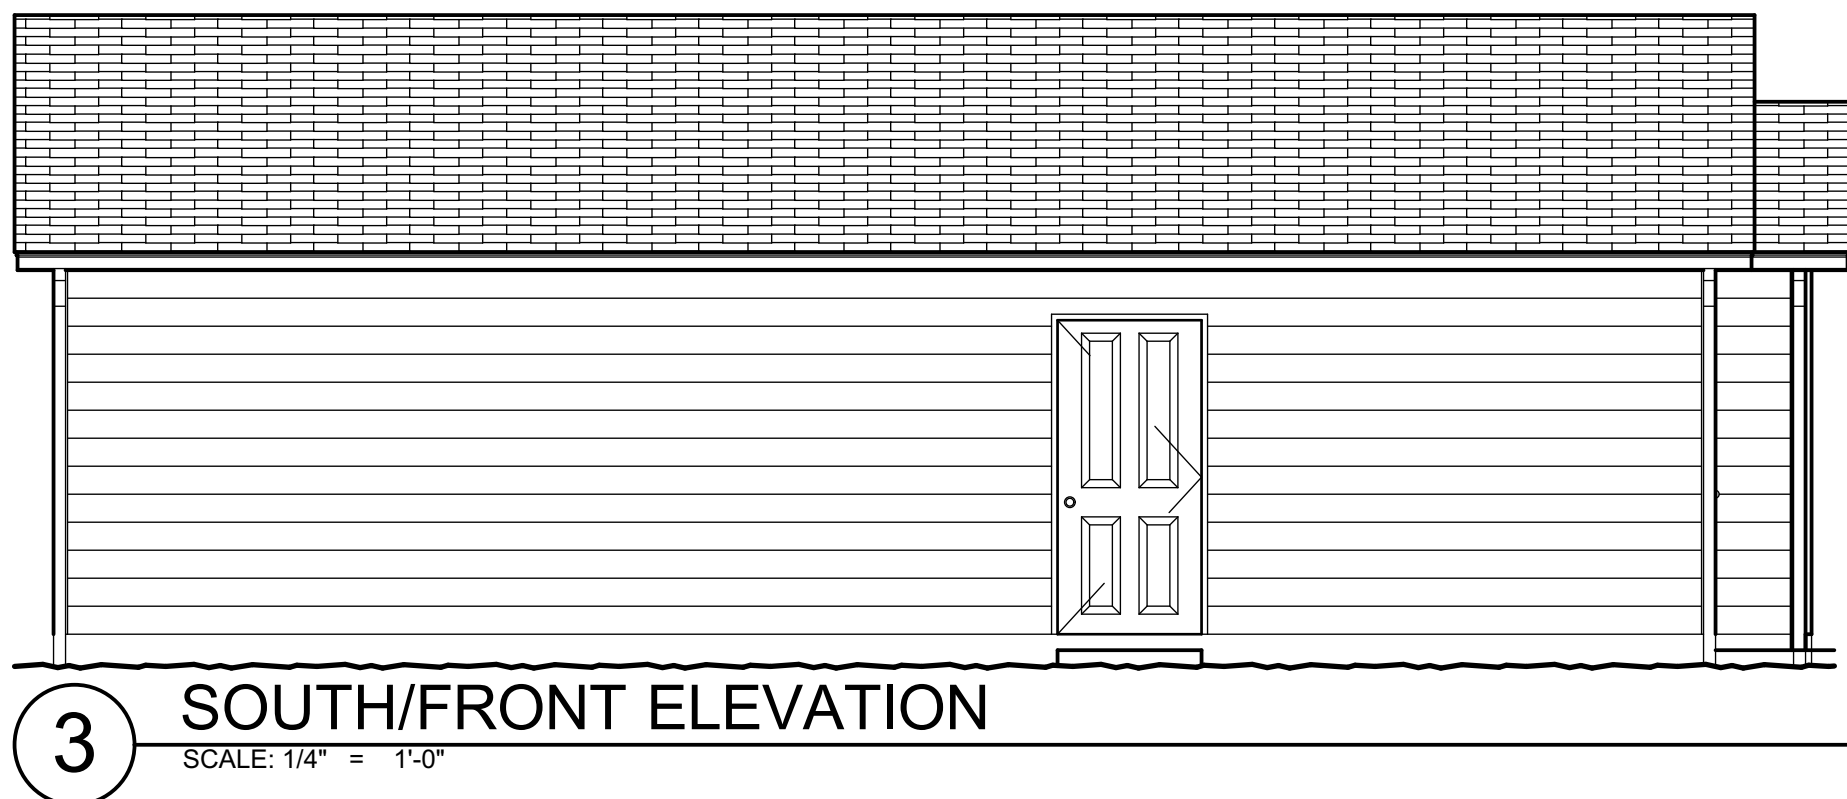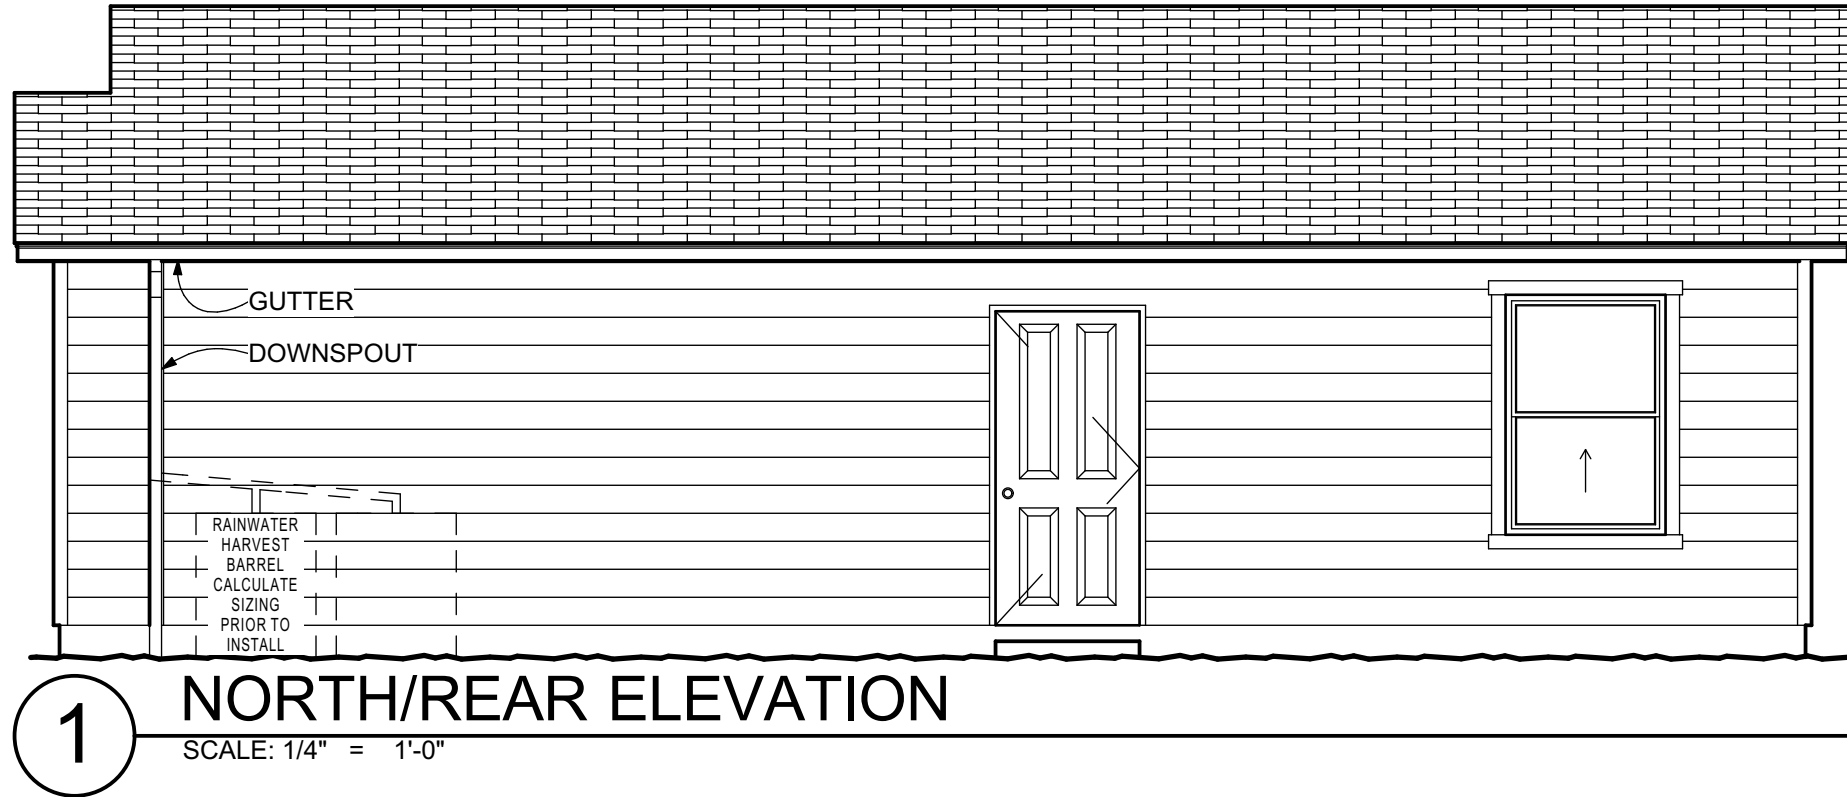

SHEAR WALL SCHEDULE

MARK	DESCRIPTION
1	15/32" C-C, C-D, OR OSB SHEATHING 8d COMMONS @ 6" O.C. AT ALL PANEL EDGES AND 12" O.C. IN THE FIELD. PLYWOOD SHALL BE ON ONE FACE WITH ALL EDGES BLOCKED. THE SILL PLATES SHALL BE ANCHORED WITH TWO 5/8"Ø A.B. MIN. PLACED AT 48" MAX. WITH 3" x 3" x 1/4" PLATE WASHERS AT FOUNDATION LEVEL FOR PLATES ANDCHORED TO FRAMING. SEE SHEAR WALL PANEL NOTES.
2	15/32" C-C, C-D, OR OSB SHEATHING 8d COMMONS @ 4" O.C. AT ALL PANEL EDGES AND 12" O.C. IN THE FIELD. PLYWOOD SHALL BE ON ONE FACE WITH ALL EDGES BLOCKED. THE SILL PLATES SHALL BE ANCHORED WITH TWO 5/8"Ø A.B. MIN. PLACED AT 32" MAX. WITH 3" x 3" x 1/4" PLATE WASHERS AT FOUNDATION LEVEL FOR PLATES ANDCHORED TO FRAMING. SEE SHEAR WALL PANEL NOTES.
3	15/32" C-C, C-D, OR OSB SHEATHING 10d COMMONS @ 3" O.C. AT ALL PANEL EDGES AND 12" O.C. IN THE FIELD. PLYWOOD SHALL BE ON ONE FACE WITH ALL EDGES BLOCKED. THE SILL PLATES SHALL BE ANCHORED WITH TWO 5/8"Ø A.B. MIN. PLACED AT 24" MAX. WITH 3" x 3" x 1/4" PLATE WASHERS AT FOUNDATION LEVEL FOR PLATES ANDCHORED TO FRAMING. SEE SHEAR WALL PANEL NOTES.
4	15/32" C-C, C-D, OR OSB SHEATHING 10d COMMONS @ 2" O.C. STAGGERED AT ALL PANEL EDGES AND 12" O.C. IN THE FIELD. PLYWOOD SHALL BE ON ONE FACE WITH ALL EDGES BLOCKED DOUBLE 2x FRAMING AT ALL PANEL EDGES. THE SILL PLATES SHALL BE ANCHORED WITH TWO 5/8"Ø A.B. MIN. PLACED AT 18" MAX. WITH 3" x 3" x 1/4" PLATE WASHERS AT FOUNDATION LEVEL FOR PLATES ANDCHORED TO FRAMING. SEE SHEAR WALL PANEL NOTES.

SHEAR WALL NOTES:

- LENGTHS (L) SHOWN ARE MINIMUMS. THE CONTRACTOR IS RESPONSIBLE FOR MAKING ALL WALL LINES FLUSH.
- ANCHOR BOLTS SHALL HAVE 7" MIN. EMBEDMENT AND SHALL BE LOCATED NOT MORE THAN 12" OR CLOSER THAN 4" FROM THE SILL PLATE ENDS.
- No. 6x1-1/4" SCREWS MAY BE USED IN LIEU OF 5d COOLER NAILS.

FLOOR PLAN LEGEND


- 2x6 WALLS
- 2x4 WALLS

ABBREVIATIONS

- AT
DOUBLE
EXISTING
GARBAGE DISPOSAL
MINIMUM
ON CENTER
ORIENTED STRAND BOARD
OVERHANG
NEW
PRESSURE BALANCE VALVE
ROUGH OPENING
SINGLE HUNG
SINK
SLIDING WINDOW
TYPICAL
TANKLESS WATER HEATER
UNLESS OTHERWISE NOTED
WATER CLOSET
WITH
- @ DBL.
(E)
G.D.
MIN.
O.C.
O.S.B.
O.V.H.
(N)
P.B.V.
R.O.
S.H.
S.K.
S.L.
TYP
T.W.H.
U.O.N.
W.C.
W/


SHEAR WALL LEGEND

- INDICATES SHEAR WALL PANEL. SEE NOTES & SCHEDULE THIS SHEET
- INDICATES VERTICAL TIE DOWNSTRAP OR HOLDOWN. SEE SHEET 4 FOR DETAILS.

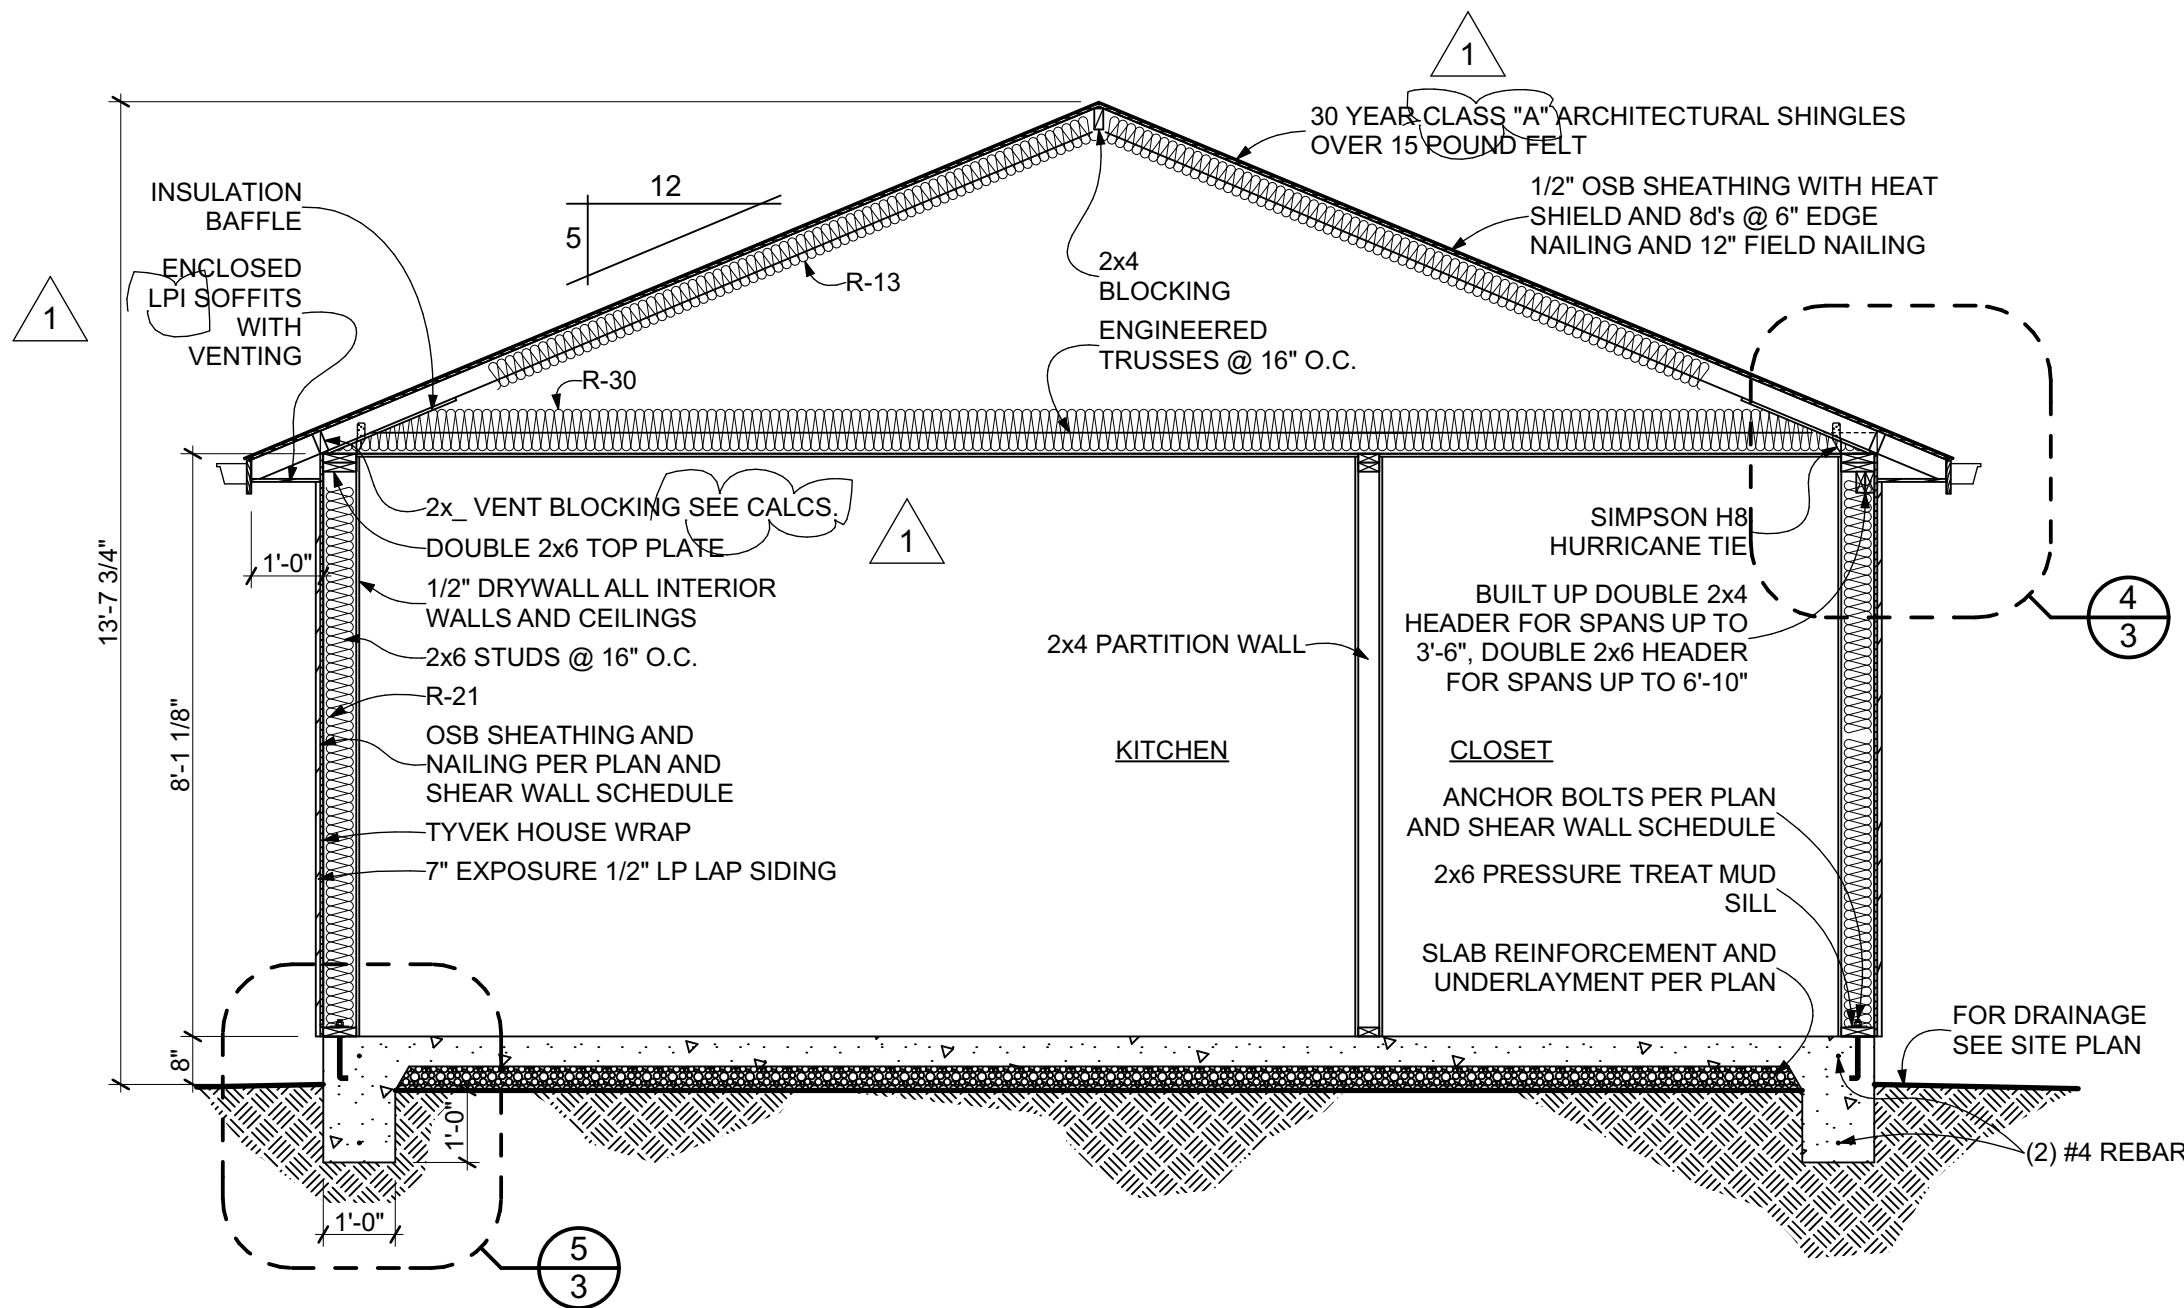


1 CROSS-SECTION
SCALE: 3/8" = 1'-0"

- FOUNDATION NOTES:**
- SEE CONCRETE NOTES ON SHEET 4.
 - ANCHOR BOLTS PER SHEAR SCHEDULE SHEET 2.
 - BOTTOMS OF ALL FOUNDATIONS SHALL BE LEVEL. SHED WILL BE LOCATED ON LEVEL GROUND, AND IT IS NOT ANTICIPATED THAT ANY STEP FOOTINGS WILL BE REQUIRED.

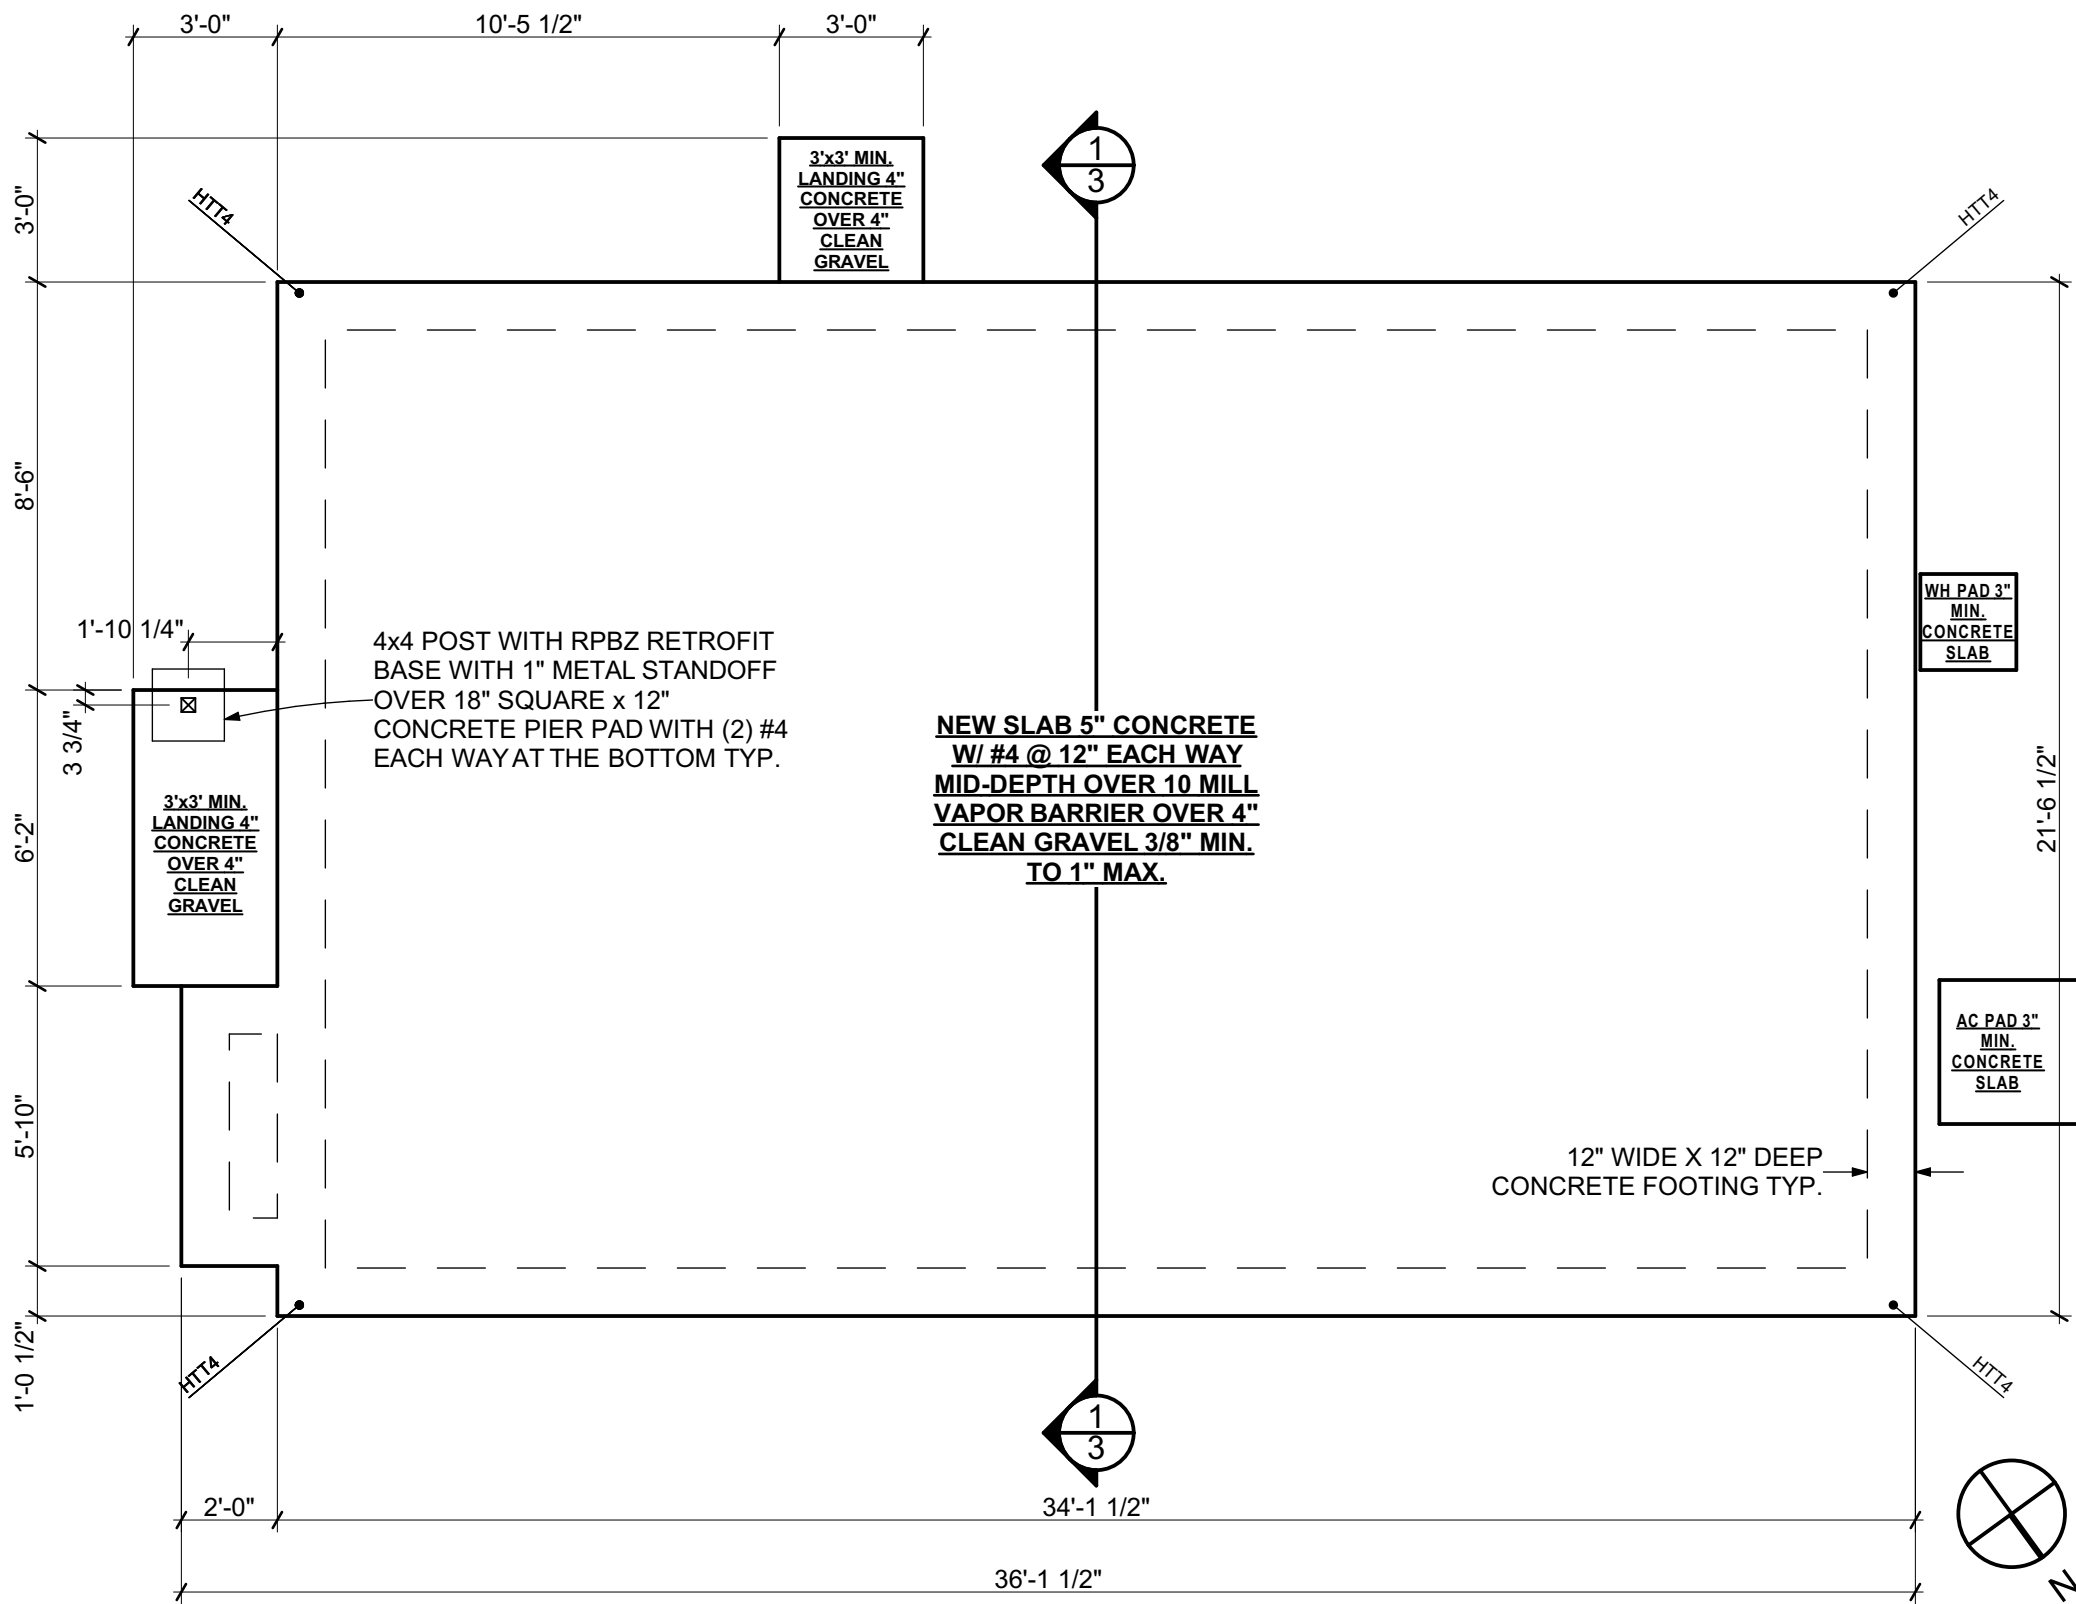


2 FOUNDATION PLAN
SCALE: 1/4" = 1'-0"

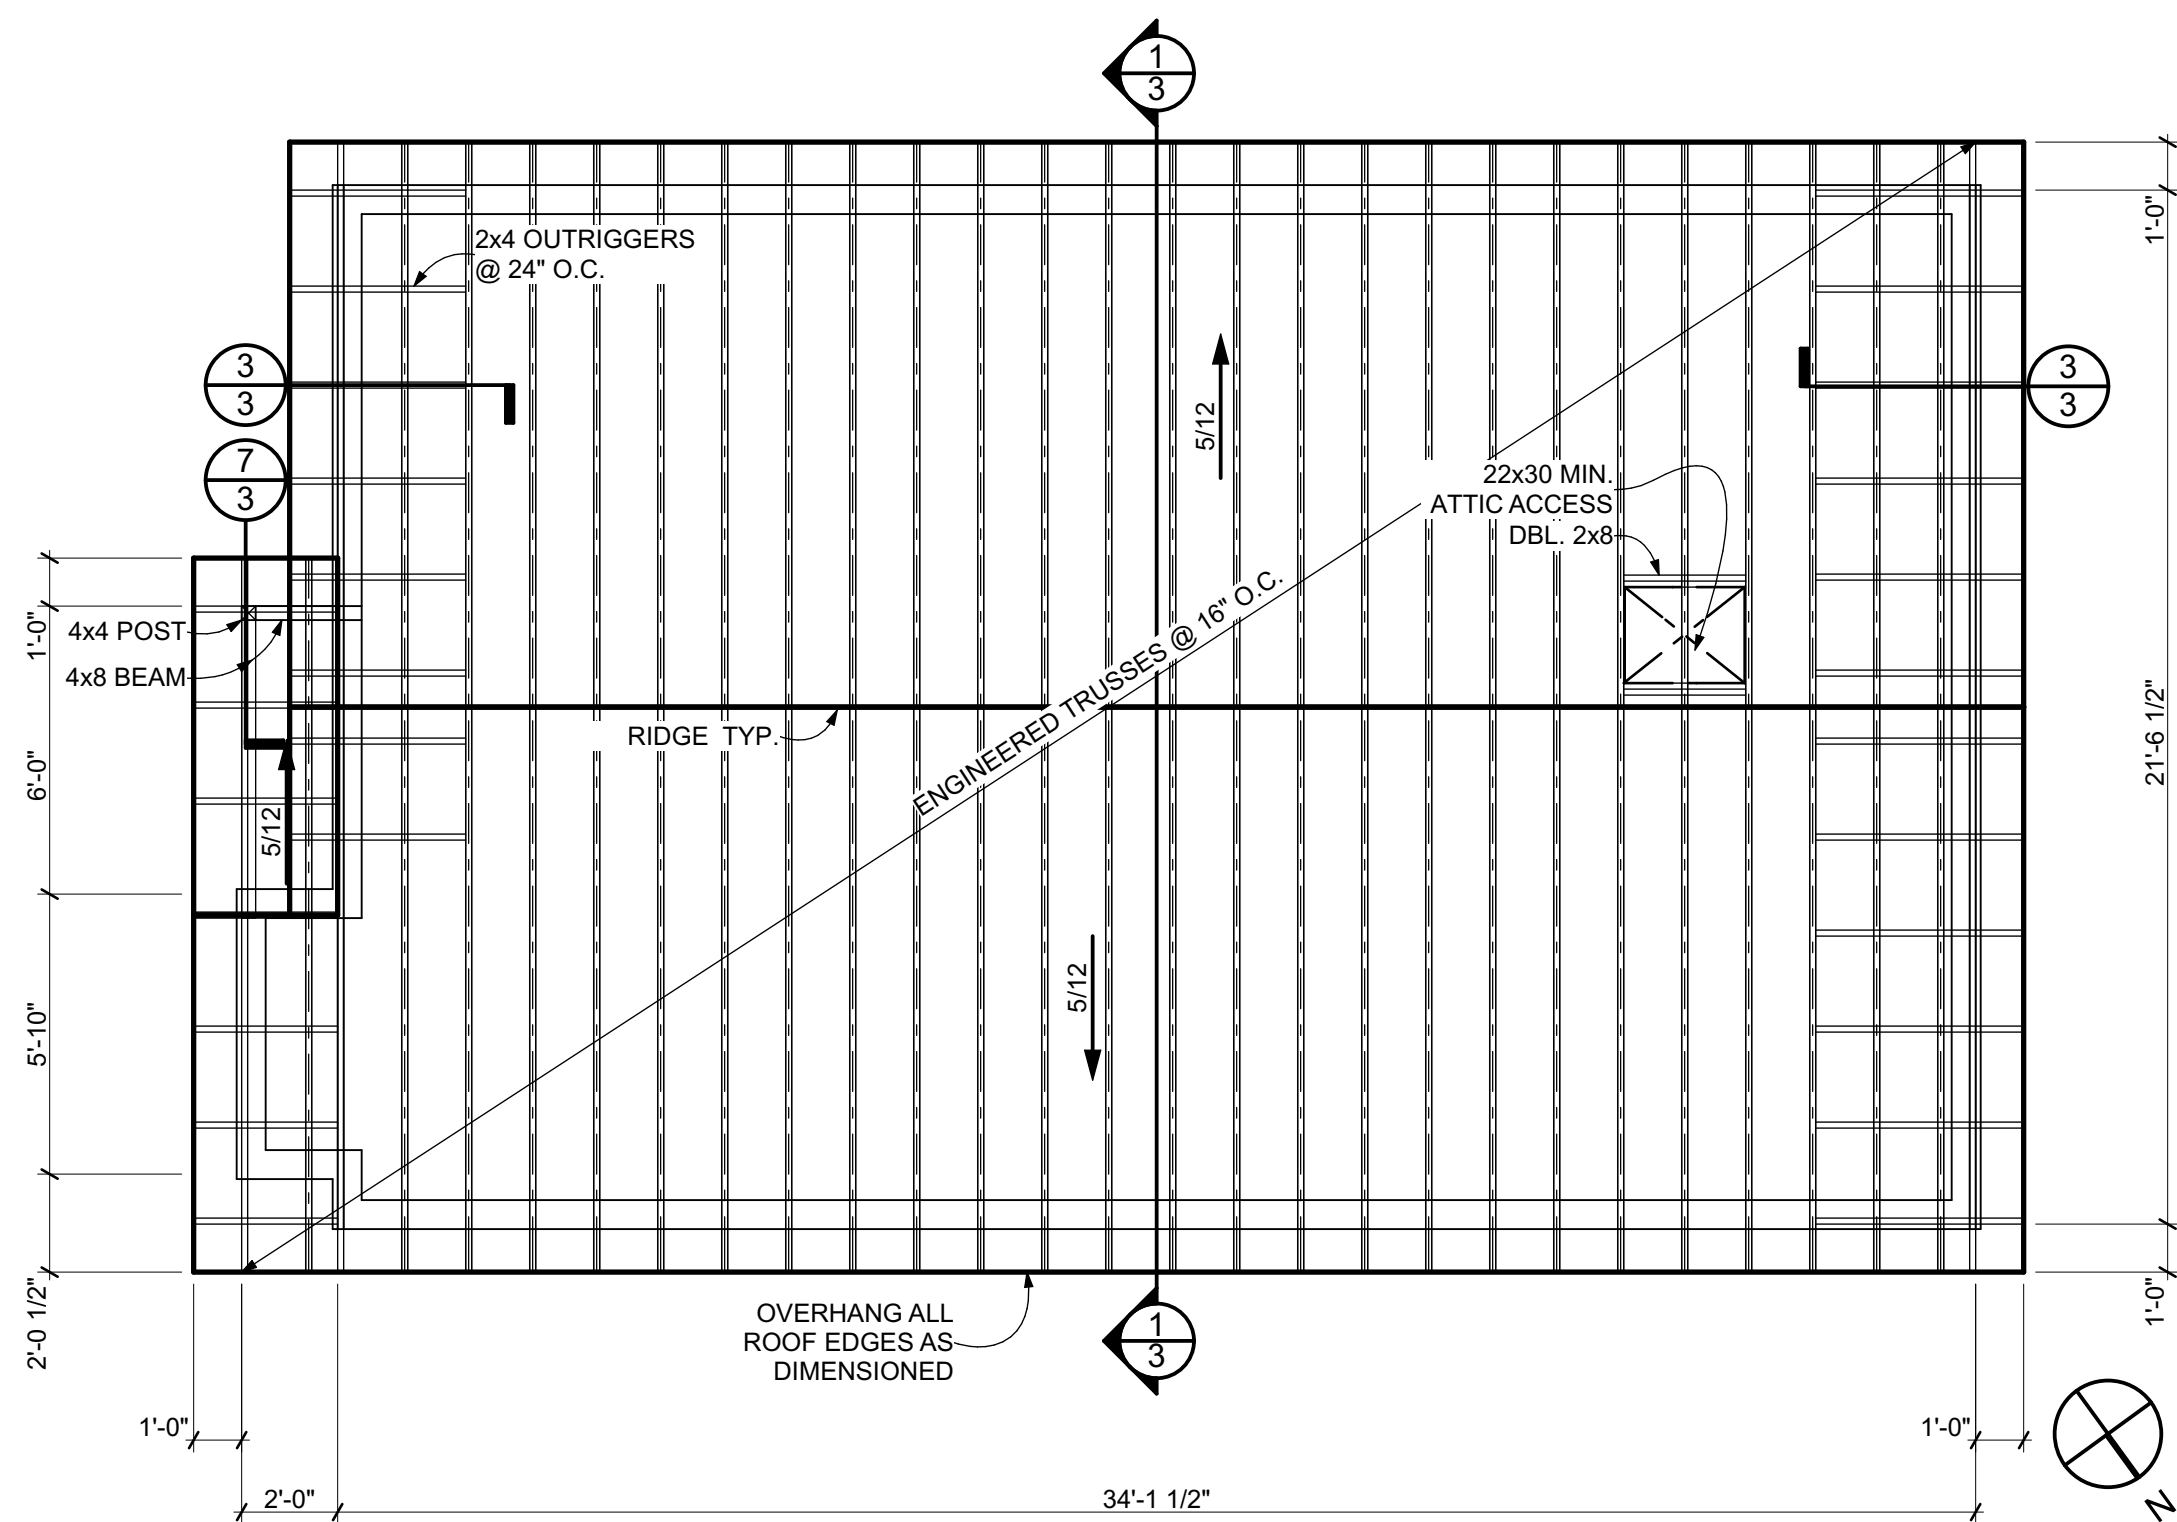


6 ROOF FRAMING PLAN
SCALE: 1/4" = 1'-0"

- ROOF NOTES:**
- NEW ROOF ATTIC AREA VENTILATION IS THE FOLLOWING: ATTIC AREA IS 761 SQUARE FEET / 150 = 731 SQUARE INCHES OF VENTILATION, OR 761/300 = 381 SQUARE INCHES OF VENTILATION IF EVENLY DISTRIBUTED BETWEEN THE RIDGE AND THE EAVE.
OR 27 VENT BLOCKS WITH (3) 2" DIAMETER HOLES AND 1/4" MESH AT THE EAVES WITH 22" MIN GAF COBRA 8" RIDGE VENT (OR EQUAL) AT THE RIDGE. SOFFIT INCLUDES LPI SOFFIT WITH CONTINUOUS VENT, 10 SQUARE INCHES PER LINEAR FOOT, 20" MINIMUM.
 - ENCLOSED ATTICS AND ENCLOSED RAFTER SPACES FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS SHALL HAVE CROSS VENTILATION FOR EACH SEPARATE SPACE BY VENTILATING OPENINGS PROTECTED AGAINST THE ENTRANCE OF RAIN OR SNOW. VENTILATION OPENINGS SHALL HAVE A LEAST DIMENSION OF 1/16 INCH MINIMUM AND 1/4 INCH MAXIMUM. VENTILATION OPENINGS HAVING A LEAST DIMENSION LARGER THAN 1/4 INCH SHALL BE PROVIDED WITH CORROSION-RESISTANT WIRE CLOTH SCREENING, HARDWARE CLOTH, PERFORATED VINYL, OR SIMILAR MATERIAL WITH OPENINGS HAVING A LEAST DIMENSION OF 1/16 INCH MINIMUM AND 1/4 INCH MAXIMUM. REQUIRED VENTILATION OPENINGS SHALL OPEN TO THE OUTSIDE AIR AND SHALL BE PROTECTED TO PREVENT THE ENTRY OF BIRDS, RODENTS, SNAKES, AND OTHER SIMILAR CREATURES C.R.C. 806.1
 - THE MINIMUM NET FREE VENTILATING AREA SHALL BE 1/100 OF THE AREA OF THE VENTED SPACE, EXCEPT THAT THE MINIMUM NET FREE VENTILATION AREA SHALL BE 1/300 OF THE VENTED SPACE PROVIDED BOTH OF THE FOLLOWING CONDITIONS ARE MET:
A. IN CLIMATE ZONES 14 AND 16, A CLASS I OR II VAPOR RETARDER IS INSTALLED ON THE WARM-IN-WINTER SIDE OF THE CEILING.
B. NOT LESS THAN 40 PERCENT AND NOT MORE THAN 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE ATTIC OR RAFTER SPACE. UPPER VENTILATORS SHALL BE LOCATED NOT MORE THAN 3 FEET (914 MM) BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE, MEASURED VERTICALLY. THE BALANCE OF THE REQUIRED VENTILATION PROVIDED SHALL BE LOCATED IN THE BOTTOM ONE-THIRD OF THE ATTIC SPACE, WHERE THE LOCATION OF WALL OR ROOF FRAMING MEMBERS CONFLICTS WITH THE INSTALLATION OF UPPER VENTILATORS. INSTALLATION MORE THAN 3 FEET (914 MM) BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE SHALL BE PERMITTED. C.R.C. 806.2


- ROOF FRAMING NOTES:**
- SEE WOOD NOTES ON SHEET 4.
 - ALL BEAM SUPPORTING POSTS ARE TO BE AT LEAST THE WIDTH OF THE BEAM BEING SUPPORTED.
 - ROOF SHEATHING SHALL BE 1/2" OSB WITH HEAT SHIELD AND 8d's @ 6" O.C. EDGE NAILING & 12" O.C. FIELD NAILING
 - TOP PLATE SPLICE AT LINES A AND B SHALL BE 48" MIN. LENGTH AND NAILED WITH (10) 16d'S EACH SIDE OF SPLICE, LINES 1 AND 2 SHALL HAVE 120" MIN. LENGTH WITH (25) 16 d's.

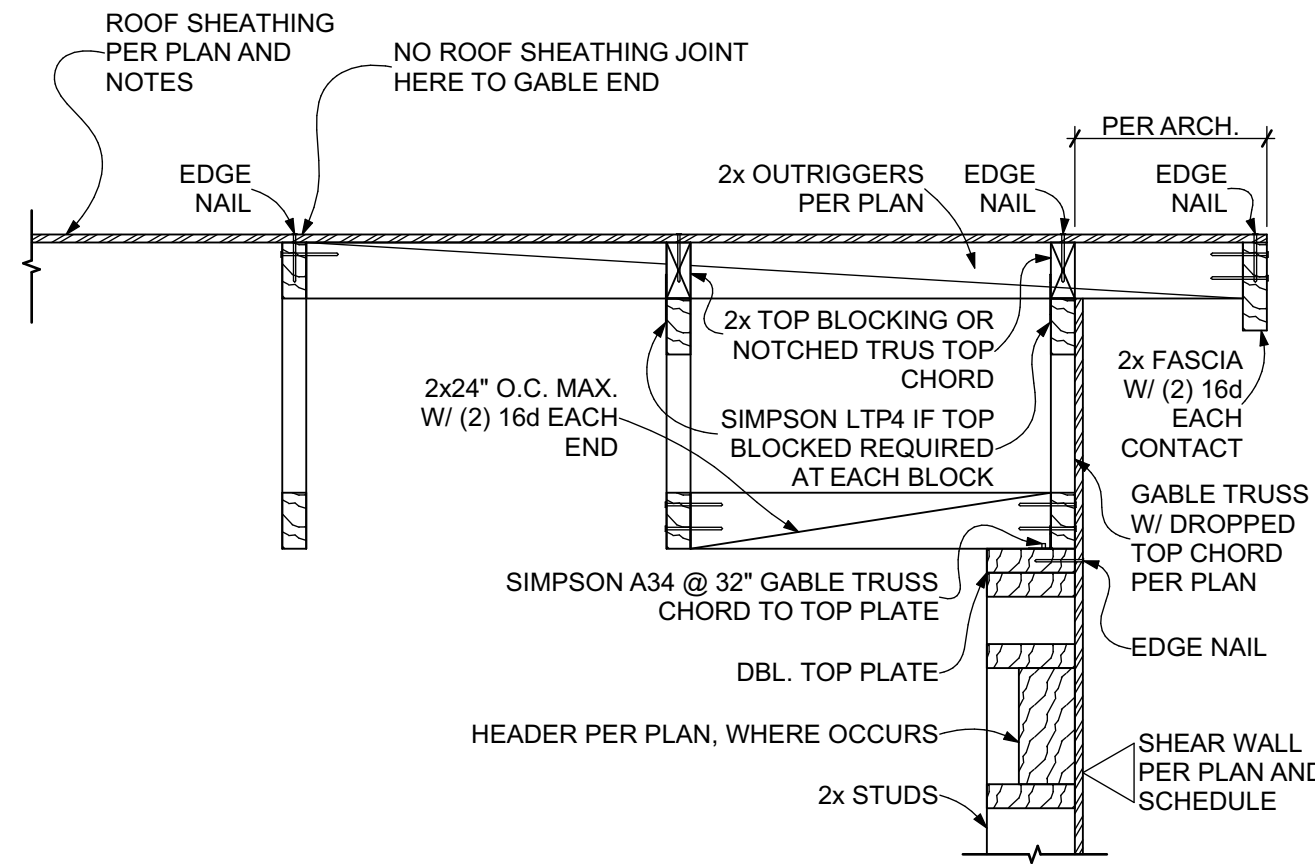


3 GABLE END DETAIL
SCALE: 1" = 1'-0"

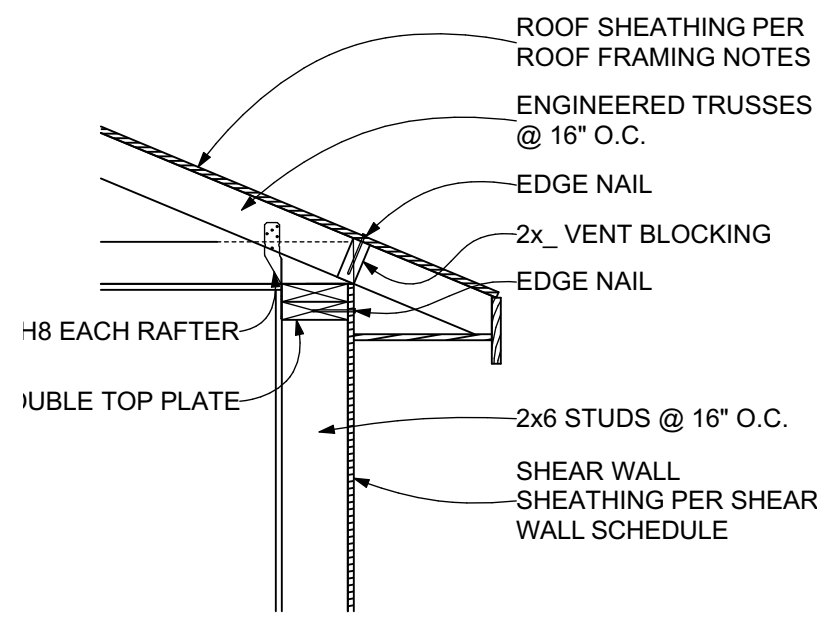

4 SHEAR TRANSFER@ EAVES
SCALE: 3/4" = 1'-0"

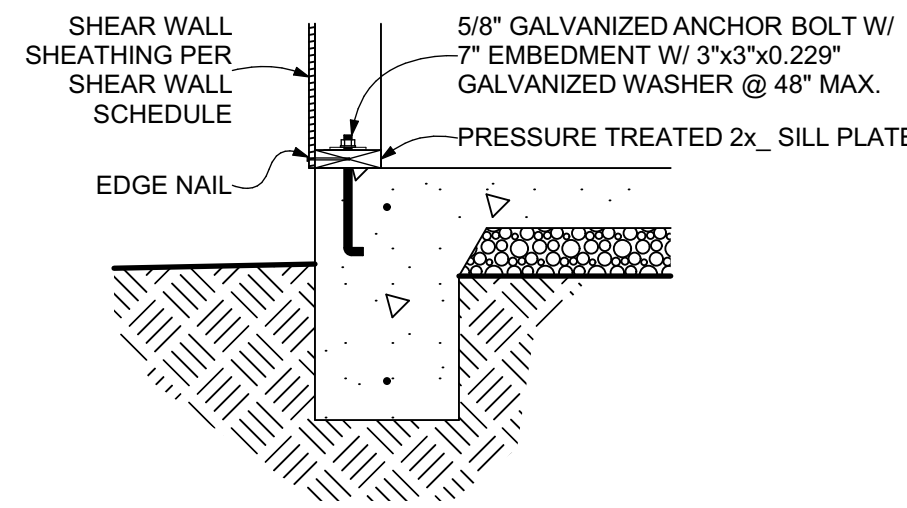

5 SHEAR TRANSFER @ FOUNDATION
SCALE: 3/4" = 1'-0"

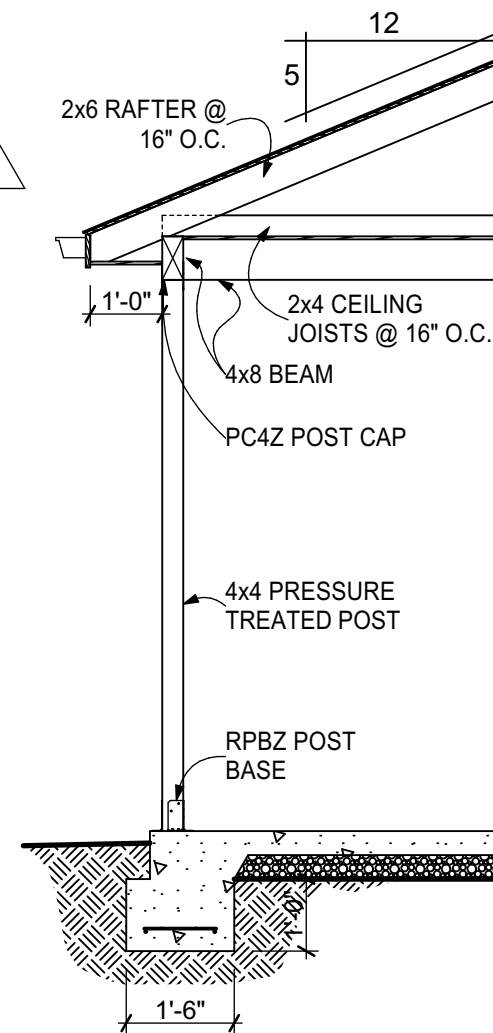

7 POST DETAIL
SCALE: 3/8" = 1'-0"

Revisions:	By:
2/6/21	JC
3/4/21	JC

Backyard
UNLIMITED
4765 Pacific Street
Rocklin, CA 95677
PH: (916) 630-5870

22x36 ACCESSORY DWELLING UNIT FOR:
GENEREUX
PROJECT ADDRESS: 121 Payran Street,
Petaluma, California 94952-3205
APN: 007-021-006-000

STRUCTURAL PLANS


Date:	11/11/20
Scale:	NOTED
Drawn:	JC
Job:	
Sheet Number:	3
Total sheet count:	7

WOOD NOTES:


1. ALL STRUCTURAL WOOD SHALL CONFORM WITH THE FOLLOWING SPECIFICATIONS: ALL LUMBER SPECIES, GRADED VISUALLY OR MECHANICALLY, SHALL COMPLY WITH THE NDS BY AF+PA, AND THE AMERICAN SOFTWOOD LUMBER STANDARD' (PS-20-05) BY THE U.S. DEPARTMENT OF COMMERCE.
- THE MINIMUM GRADE AND SPECIES FOR POSTS, BEAMS, HEADERS, AND OTHER PRIMARY STRUCTURAL MEMBERS SHALL BE DENSE SELECTED SOUTHERN PINE, U.O.N.
- LUMBER USED FOR SECONDARY FRAMING SHALL BE #1 SOUTHERN PINE OR BETTER
- PLYWOOD - US PRODUCT STANDARD P.S. 2-10 FOR SOFT PLYWOOD STRUCTURAL 1 @ WALLS; CDX @ FLOORS AND ROOF U.O.N.
- PRESSURE TREATED DOUGLAS FIR - AWP (AMERICAN WOOD PRESERVERS' ASSOCIATION) U1.
2. ALL WOOD IN DIRECT CONTACT WITH EARTH OR CONCRETE SHALL BE PRESSURE TREATED.
3. BEARING/BRACE/SHEAR WALLS SHALL HAVE DOUBLE TOP PLATES, LAPPED AT WALL AND PARTITION INTERSECTION WITH (3) 16d's.
4. PROVIDE SOLID BLOCKING BETWEEN JOISTES AND RAFTERS AT ALL SUPPORTS.
5. LAY ALL STRUCTURAL PLYWOOD ON ROOF AND FLOORS WITH FACE GRAIN PERPENDICULAR TO SUPPORT U.O.N.
6. CONNECTOR HARDWARE MODEL NUMBERS ARE FOR SIMPSON STRON-TIE COMPANY. EQUIVALENT CONNECTORS WITH ICBO ACCEPTANCE MAY BE SUBSTITUTED.
7. FASTENERS FOR PRESERVATIVE TREATED & FIRE RETARDANT TREATED WOOD SHALL BE OF HOT DIPPED ZINC COATED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER. THE COATING WEIGHTS FOR ZINC COATED FASTENERS SHALL BE IN ACCORDANCE WITH ASTM A 153

NAILING NOTES:

- ALL NAILS FOR STRUCTURAL WORK SHALL BE COMMON WIRE NAILS CONFORMING TO THE FOLLOWING MINIMUM SIZES
- | | |
|-----|--------------------------|
| 8d | 0.131" DIAMETER X 2 1/2" |
| 10d | 0.148" DIAMETER X 3" |
| 16d | 0.162" DIAMETER X 3 1/2" |
- HOLES SHALL BE SUBDRILLED WHERE NECESSARY TO PREVENT SPLITTING. NAILING NOT NOTED BELOW OR ON PLANS SHALL BE A MINIMUM OF TWO NAILS AT EACH CONTACT. 8d NAILS FOR 1" MATERIAL AND 16d NAILS FOR 2" MATERIAL.
- JOISTES TO SILL OR GIRDER, TOE NAIL (3) 8d
 - SOLE PLATE TO JOIST OR BLOCKING, TYPICAL FACE NAIL 16d @ 16" O.C.
 - SOLE PLATE TO JOIST OR BLOCKING, AT BRACED WALL PANEL (3) 16d PER 16"
 - TOP PLATE TO STUD, END NAIL (2) 16d
 - STUD TO SOLE PLATE (4) 8d, TOENAIL OR (2) 16d, END NAIL
 - DOUBLE STUDS, FACE NAIL 16d @ 24" O.C.
 - DOUBLE TOP PLATES, TYPICAL FACE NAIL 16d @ 16" O.C.
 - DOUBLE TOP PLATES, LAP SPLICE , U.N.O. (8) 16d
 - BLOCKING BETWEEN JOISTES OR RAFTERS TO TOP PLATE, TOE NAIL (3) 8d
 - TOP PLATES, LAPS AND INTERSECTION, FACE NAIL (2)-16d
 - CONTINUOUS HEADER, TWO PIECES, TOENAIL 16d @ 16" O.C. ALONG EACH EDGE
 - RAFTER TO TOP PLATE, TOENAIL (3) 8d
 - BUILT UP CORNER STUDS 16d @ 24" O.C.

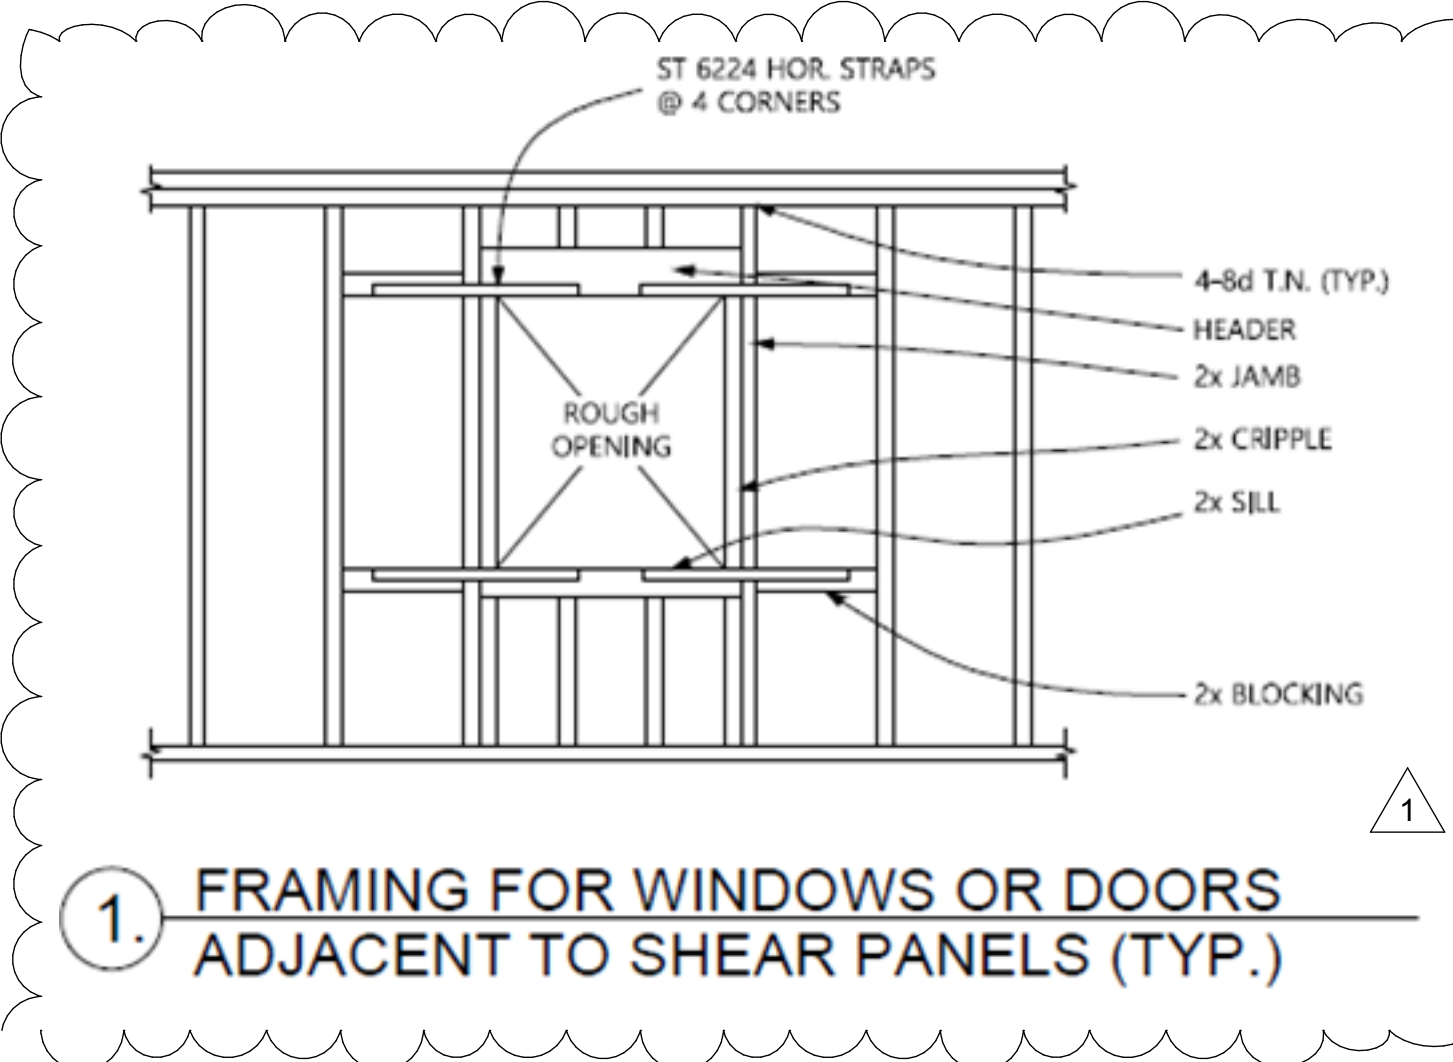


1. FRAMING FOR WINDOWS OR DOORS ADJACENT TO SHEAR PANELS (TYP.)

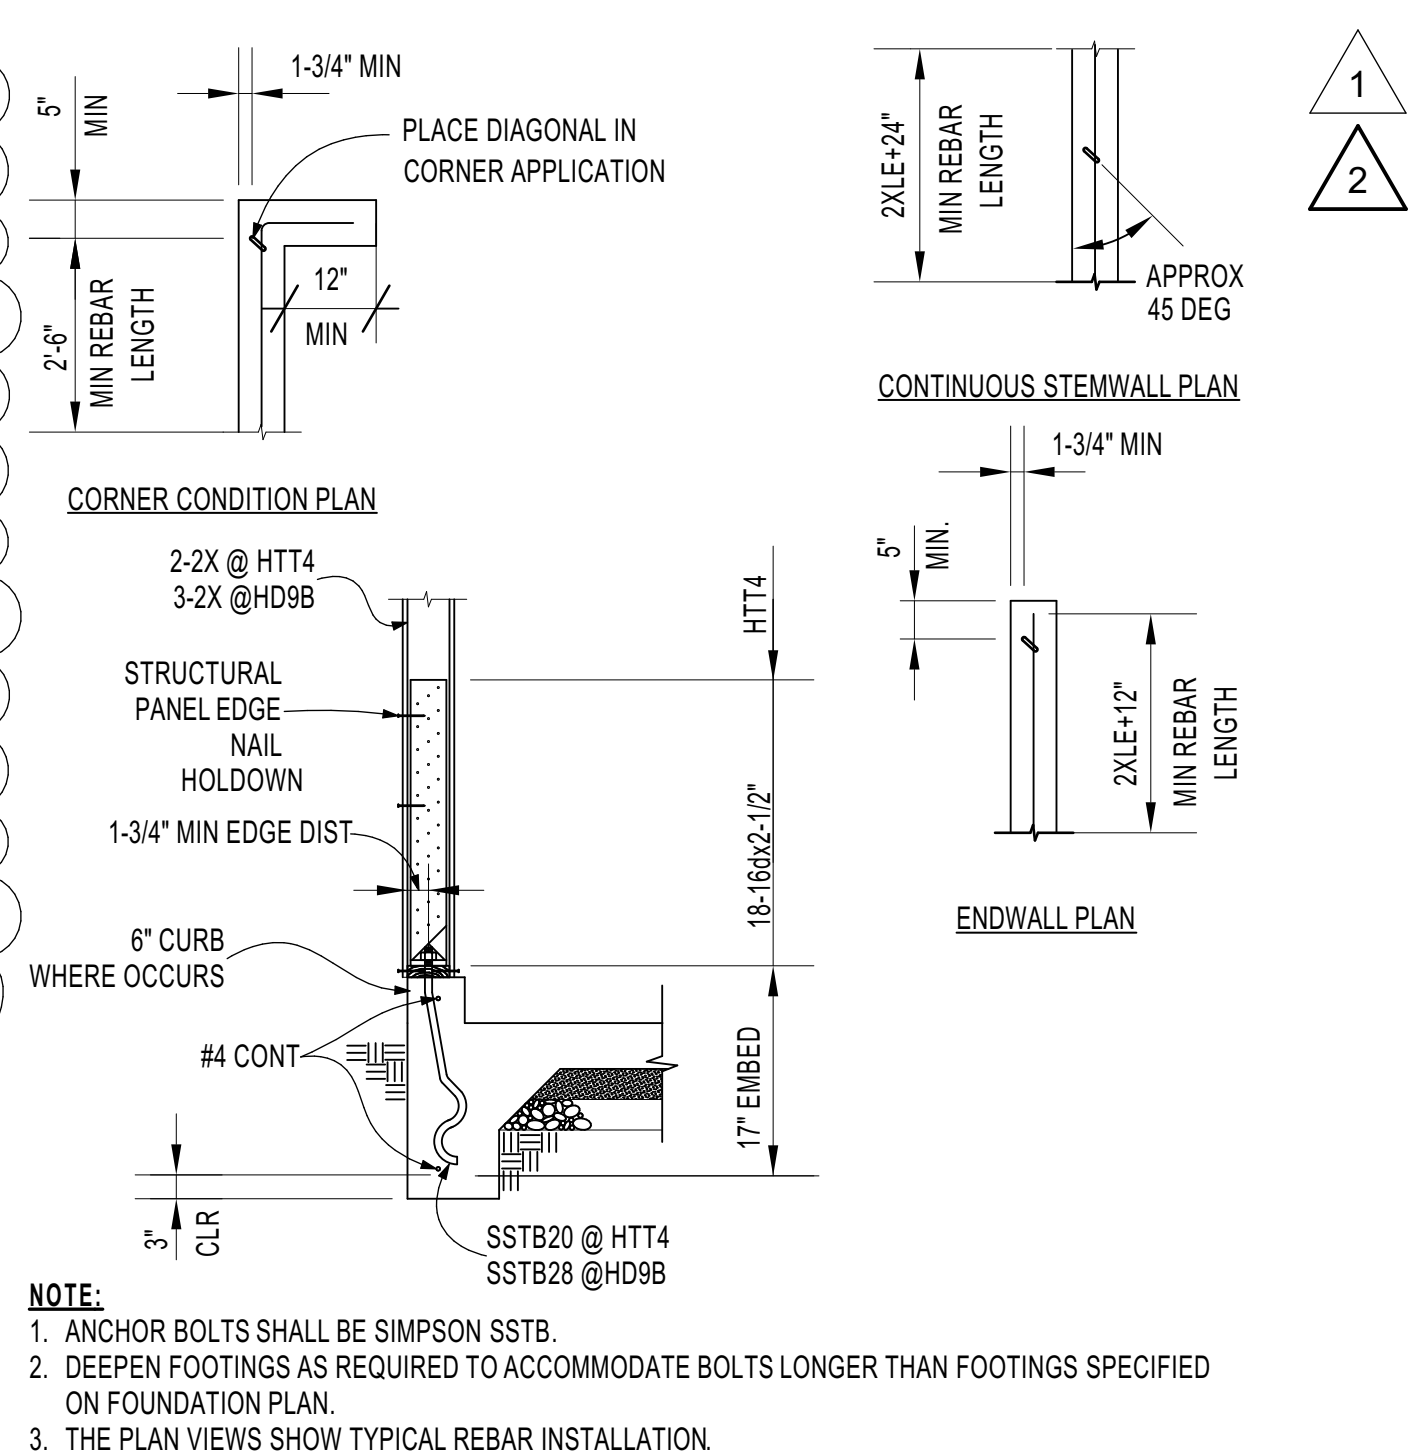

2. HOLDOWN INSTALLATION
SCALE: 3/4" = 1'-0"

PRODUCT SPECIFICATION DRAWING
QUICK SHED #E24/E24-B, #E26/E26-B, #E30/E30-B & #E36-B
Water Heater Enclosures for 24", 26", 30" & 36"
(-B Indicates Models that include Back Panel)

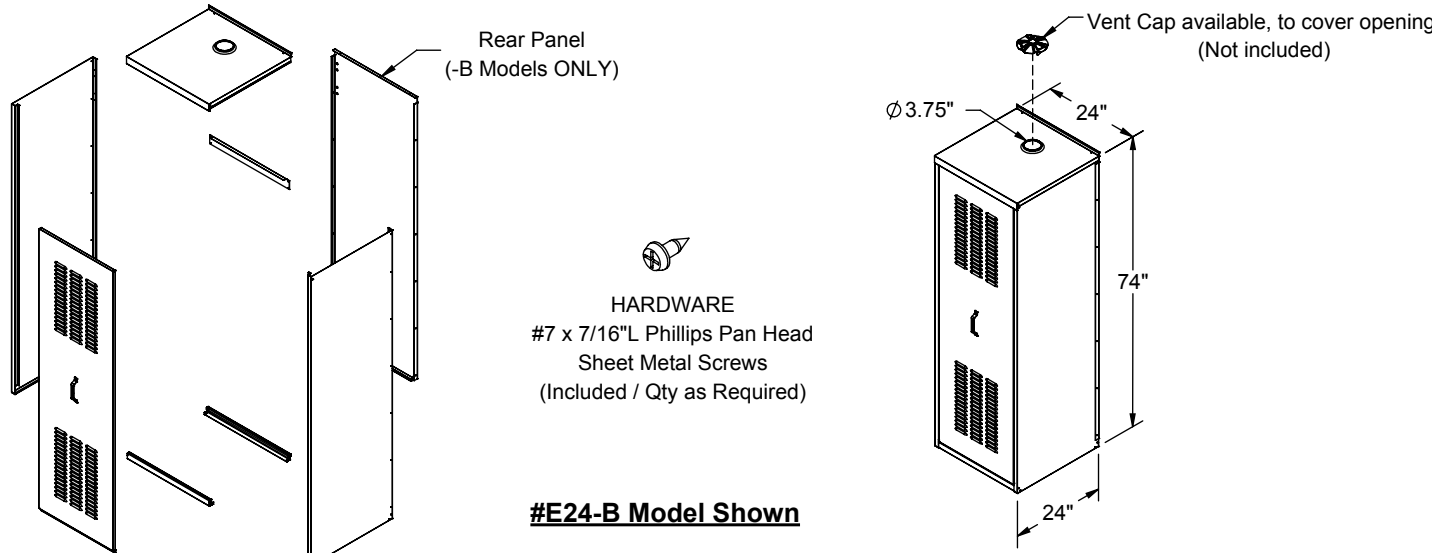

The **HOLDRITE® QUICK SHED™** Water Heater Enclosures are constructed of galvanized steel and provide protection for water heaters installed in outdoor locations. Anchor points at the rear of the enclosure allows for optional attachment to the adjacent building structure. Rear panel (-B version ONLY) provides a four-sided enclosure.

- Product Information:**
- Material:**
 - Top, Door, Left & Right Side and Rear Panel (Opt): .018" - .021" Thick, Galvanized CRS
 - Back Brace & Beam: .023" - .026" Thick, Galvanized CRS
 - Handle: 16GA, Galvanized CRS
 - Material (#E36-B ONLY):**
 - Top, Door, Left & Right Side and Rear Panel: .025" Thick, Galvanized CRS
 - Back Brace & Beam: .030" Thick, Galvanized CRS
 - Handle: 16GA, Galvanized CRS
 - Weight (without Packaging & Water Heater):**
 - Model #QS-E24 = 39 LBS / E24-B = 50 LBS
 - Model #QS-E26 = 42 LBS / E26-B = 54 LBS
 - Model #QS-E30 = 49 LBS / E30-B = 63 LBS
 - Model #QS-E36-B = 107 LBS
 - Outside dimensions:**
 - Model #QS-E24 = 24" x 24" x 74"
 - Model #QS-E26 = 26" x 26" x 74"
 - Model #QS-E30 = 30" x 30" x 74"
 - Model #QS-E36 = 36" x 36" x 84"
 - Water Heater Dimensions:**
 - QS-E24: Up to 40 gallons or 22" diameter by 68" high
 - QS-E26: Up to 40 gallons or 24" diameter by 68" high
 - QS-E30: Up to 80 gallons or 27" diameter by 68" high
 - QS-E36: Up to 120 gallons or 33" diameter by 78" high

THIS INFORMATION IS PROPRIETARY TO HOLDRITE AND IS SUBJECT TO CHANGE WITHOUT NOTICE. IT MAY NOT BE REPRODUCED IN PART OR WHOLE WITHOUT WRITTEN AUTHORIZATION.




800-321-0316 OR 760-744-6844 / FAX: 760-744-0607 / WWW.HOLDRITE.COM
Spec: QuickShed_E24-B_E26-B_E30-B_E36-B_Rev0

Product Submittal	
Job Name:	
Date:	
Part Number:	Qty.
Architect / Owner:	
Contractor:	
Notes:	


3. Water Heater Enclosure

CONCRETE NOTES:

- STRUCTURAL CONCRETE SHALL ATTAIN 28 DAY COMPRESSIVE STRENGTH F' C = 2500 P.S.I.
- CONCRETE MIX DESIGN SHALL BE PREPARED BY AN INDEPENDENT LABORATORY. SELECTION OF CONCRETE MIX PROPORTIONS SHALL BE PER THE CALIFORNIA BUILDING CODE.
- CEMENT SHALL CONFORM TO ASTM C-150 TYPE I OR II.
- CONCRETE AGGREGATES SHALL CONFORM TO ASTM C-33. AGGREGATES FOR LIGHTWEIGHT CONCRETE SHALL CONFORM TO ASTM C-330.
- REINFORCING STEEL SHALL CONFORM TO ASTM A615- GRADE 60 FOR NO. 5 AND LARGER, AND ASTM A615- GRADE 40 FOR NO. 4 AND SMALLER, EXCEPT REINFORCING STEEL TO BE WELDED SHALL CONFRM TO ASTM A706.
- REINFORCING STEEL SHALL BE FABRICATED ACCORDING TO "MANUAL OF STANDARD PRACTICE FOR REINFORCED CONCRETE CONSTRUCTION".
- WIRE FABRIC SHALL CONFORM TO ASTM A-185.
- DIMENSIONS SHOWN FOR LOCATION OF REINFORCING ARE TO THE FACE OF MAIN BARS AND DENOTE CLEAR COVERAGE. CONCRETE COVERAGE SHALL BE AS FOLLOWS: CONCRETE DEPOSITED AGAINST GROUND (EXCEPT SLABS) 3" MIN. CONCRETE EXPOSED TO GROUND BUT PLACED IN FORMS 2" MIN. SLABS (ON GROUND) 2" CLEAR FROM TOP U.O.N.
- SPLICES IN CONTINUOUS REINFORCEMENT SHALL BE 48 BAR DIAMETERS AND SPLICES IN ADJACENT BARS SHALL NOT BE LESS THAN 5'-0" APART. SPLICE CONTINUOUS BARS IN SPANDRELS, GRADE BEAMS, ETC., AS FOLLOWS: TOP BARS AT MID-SPAN; BOTTOM BARS AT CENTERLINE AT SUPPORT, U.O.N. SPLICES IN WELDED WIRE FABRIC SHALL BE 1.5 MESHES WIDE.
- REMOVE ALL DEBRIS FROM FORMS BEFORE CASTING ANY CONCRETE.
- REINFORCING, DOWELS, BOLTS, ANCHORS, SLEEVES, ETC., TO BE EMBEDDED IN CONCRETE SHALL BE TIED SECURELY IN POSITION BEFORE PLACING CONCRETE.
- MAXIMUM FREE FALL OF CONCRETE SHALL BE 8'-0"
- CONSOLIDATE CONCRETE PLACED IN FORMS BY MECHANICAL VIBRATING EQUIPMENT SUPPLEMENTED BY HAND SPADING, RODDING OR TAMPING. USE EQUIPMENT AND PROCEDURES FOR CONSOLIDATION OF CONCRETE IN ACCORDANCE WITH THE RECOMMENDED PRACTICES OF ACI 309 TO SUIT THE TYPE OF CONCRETE AND PROJECT CONDITIONS.
- NO WOOD SPREADERS ALLOWED. NO WOOD STAKES ALLOWED IN AREAS TO BE CONCRETED.

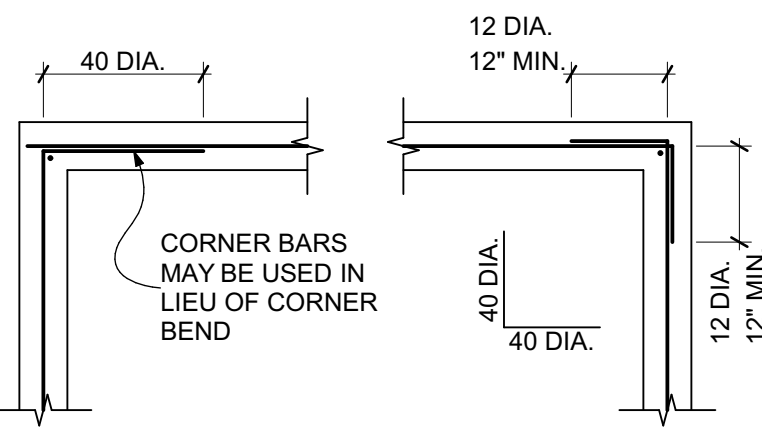

TYP. CORNER REINFORCING
SCALE: 1/2" = 1'-0"

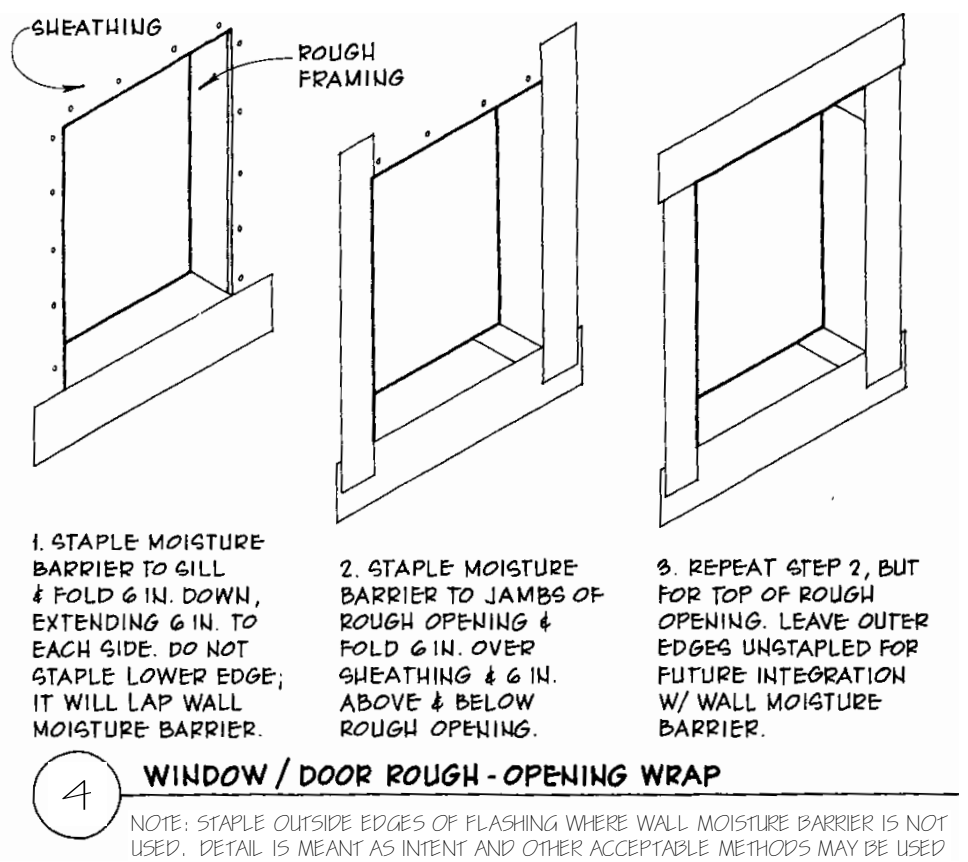

4. WINDOW / DOOR ROUGH - OPENING WRAP
NOTE: STAPLE OUTSIDE EDGES OF FLASHING WHERE WALL MOISTURE BARRIER IS NOT USED. DETAIL IS MEANT AS INTENT AND OTHER ACCEPTABLE METHODS MAY BE USED

Revisions:	By:
2/6/21	JC
3/4/21	JC

4765 Pacific Street
Rocklin, CA 95677
PH: (916) 630-SHED

22x36 ACCESSORY DWELLING UNIT FOR:
GENEREUX
PROJECT ADDRESS: 121 Payran Street,
Petaluma, California 94952-3205
APN: 007-021-006-000

STRUCTURAL NOTES AND
DETAILS

Date:	11/11/20
Scale:	NOTED
Drawn:	JC
Job:	
Sheet Number:	4
Total sheet count:	7