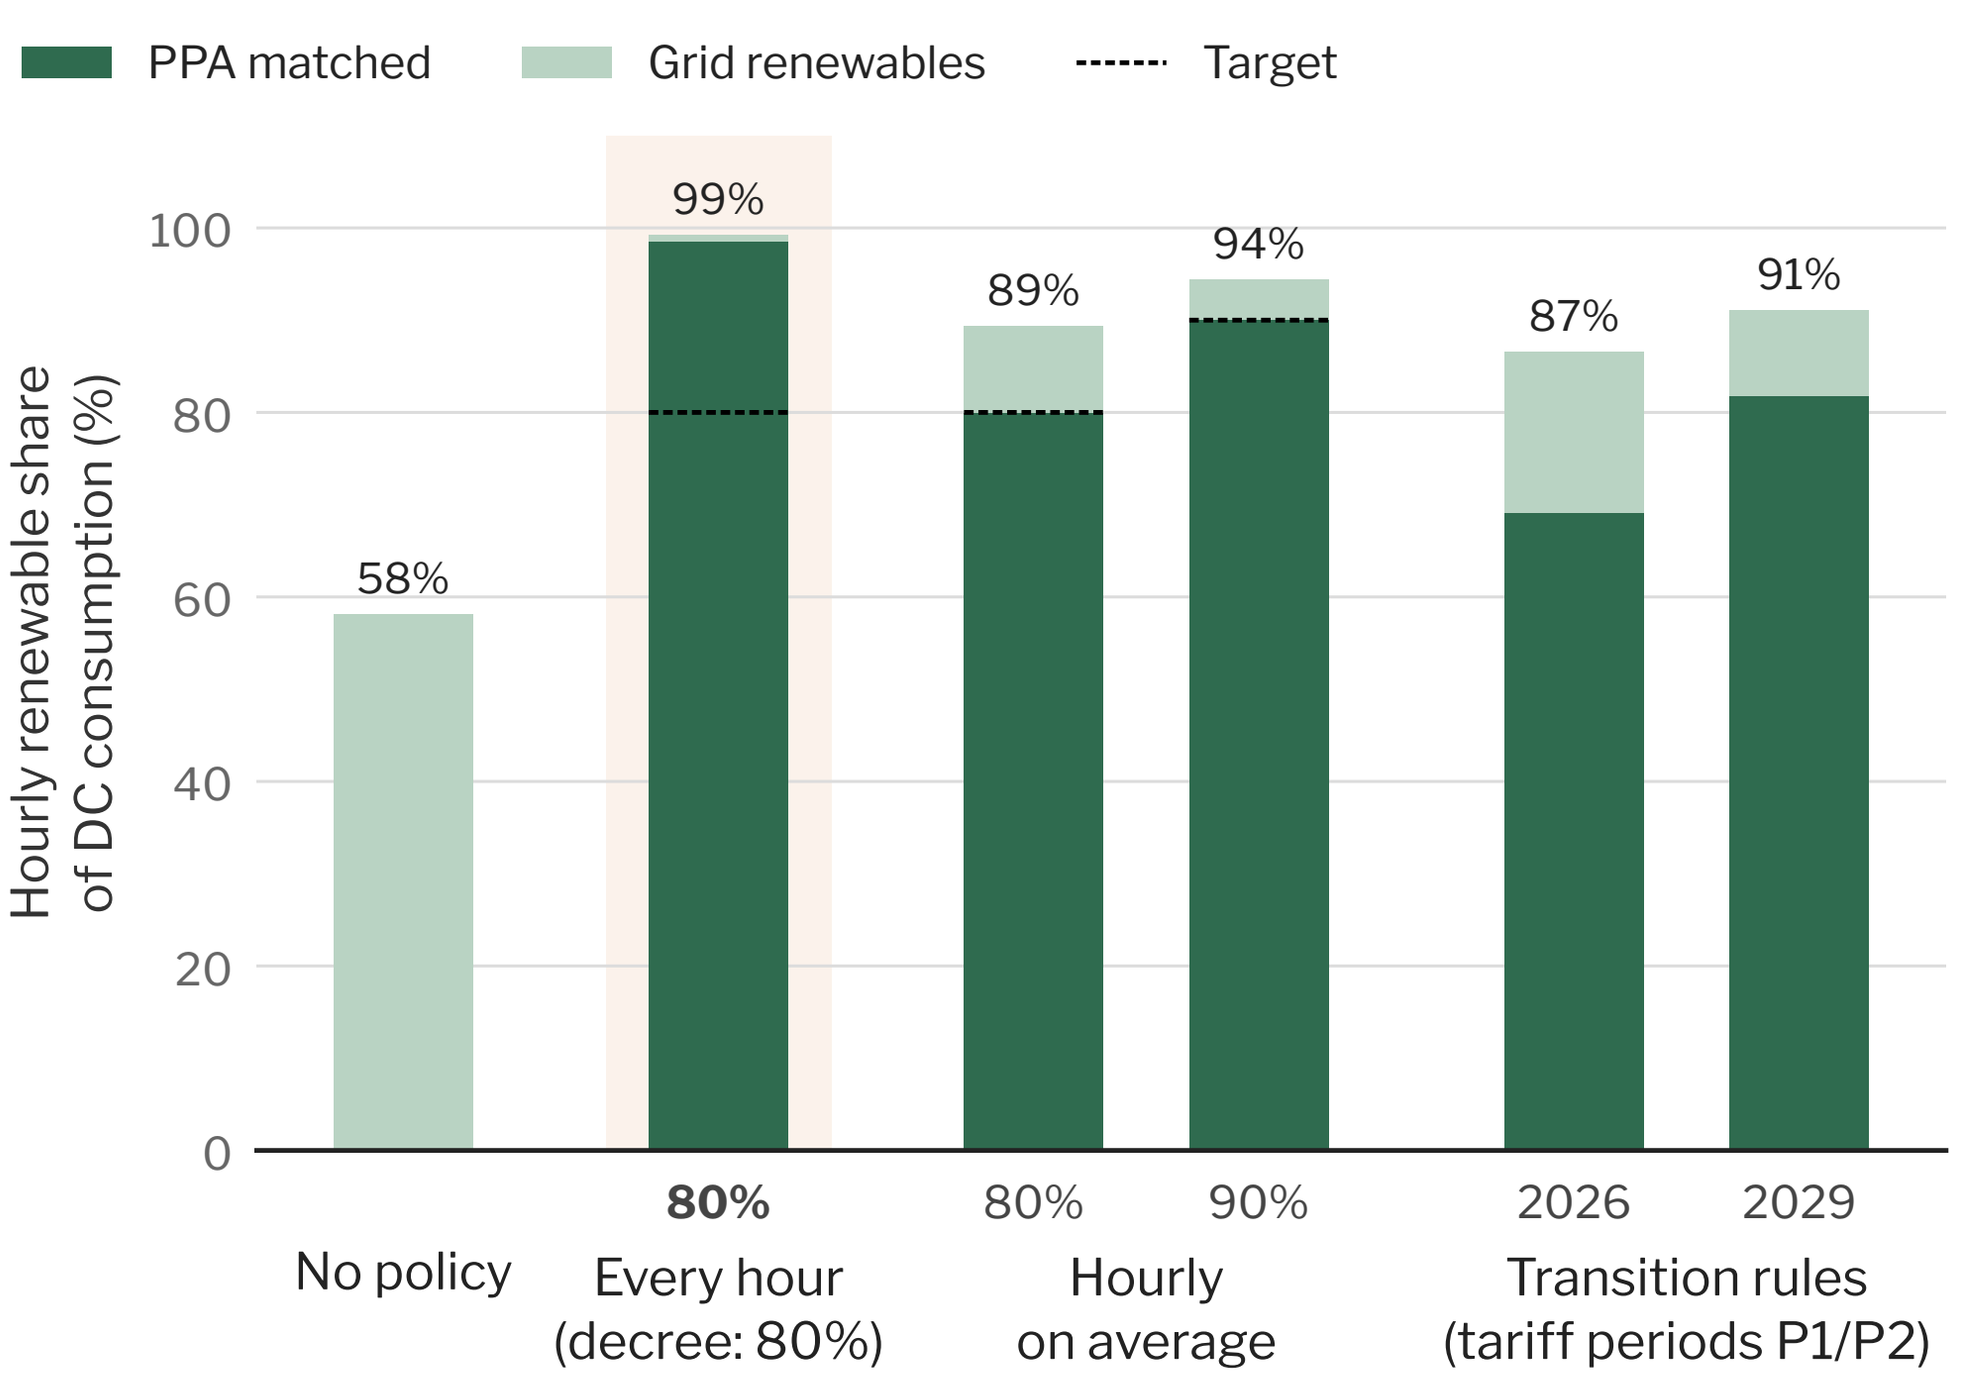

Share of the data center's consumption covered by renewables in the same hour: by its own PPAs and battery (dark), or by the renewable share of its grid purchases (light; import-traced, nuclear excluded). PPAs anywhere in mainland Spain. Transition rules: the revised draft's phase-in for data centers in the automatic load-reduction scheme, a floor in tariff periods P1 and P2 only, applied hour by hour as in Art. 9: 60% in P1 hours under the 2026 rules (to 2028), then 70% in P1 and 60% in P2 hours under the 2029 rules; all other hours are unconstrained (P1: 9–14 h and 18–22 h on weekdays in January, February, July and December; P2: 8–9, 14–18 and 22–24 h on those days, and 9–14 h and 18–22 h on weekdays in March and November; local time, national holidays excluded).