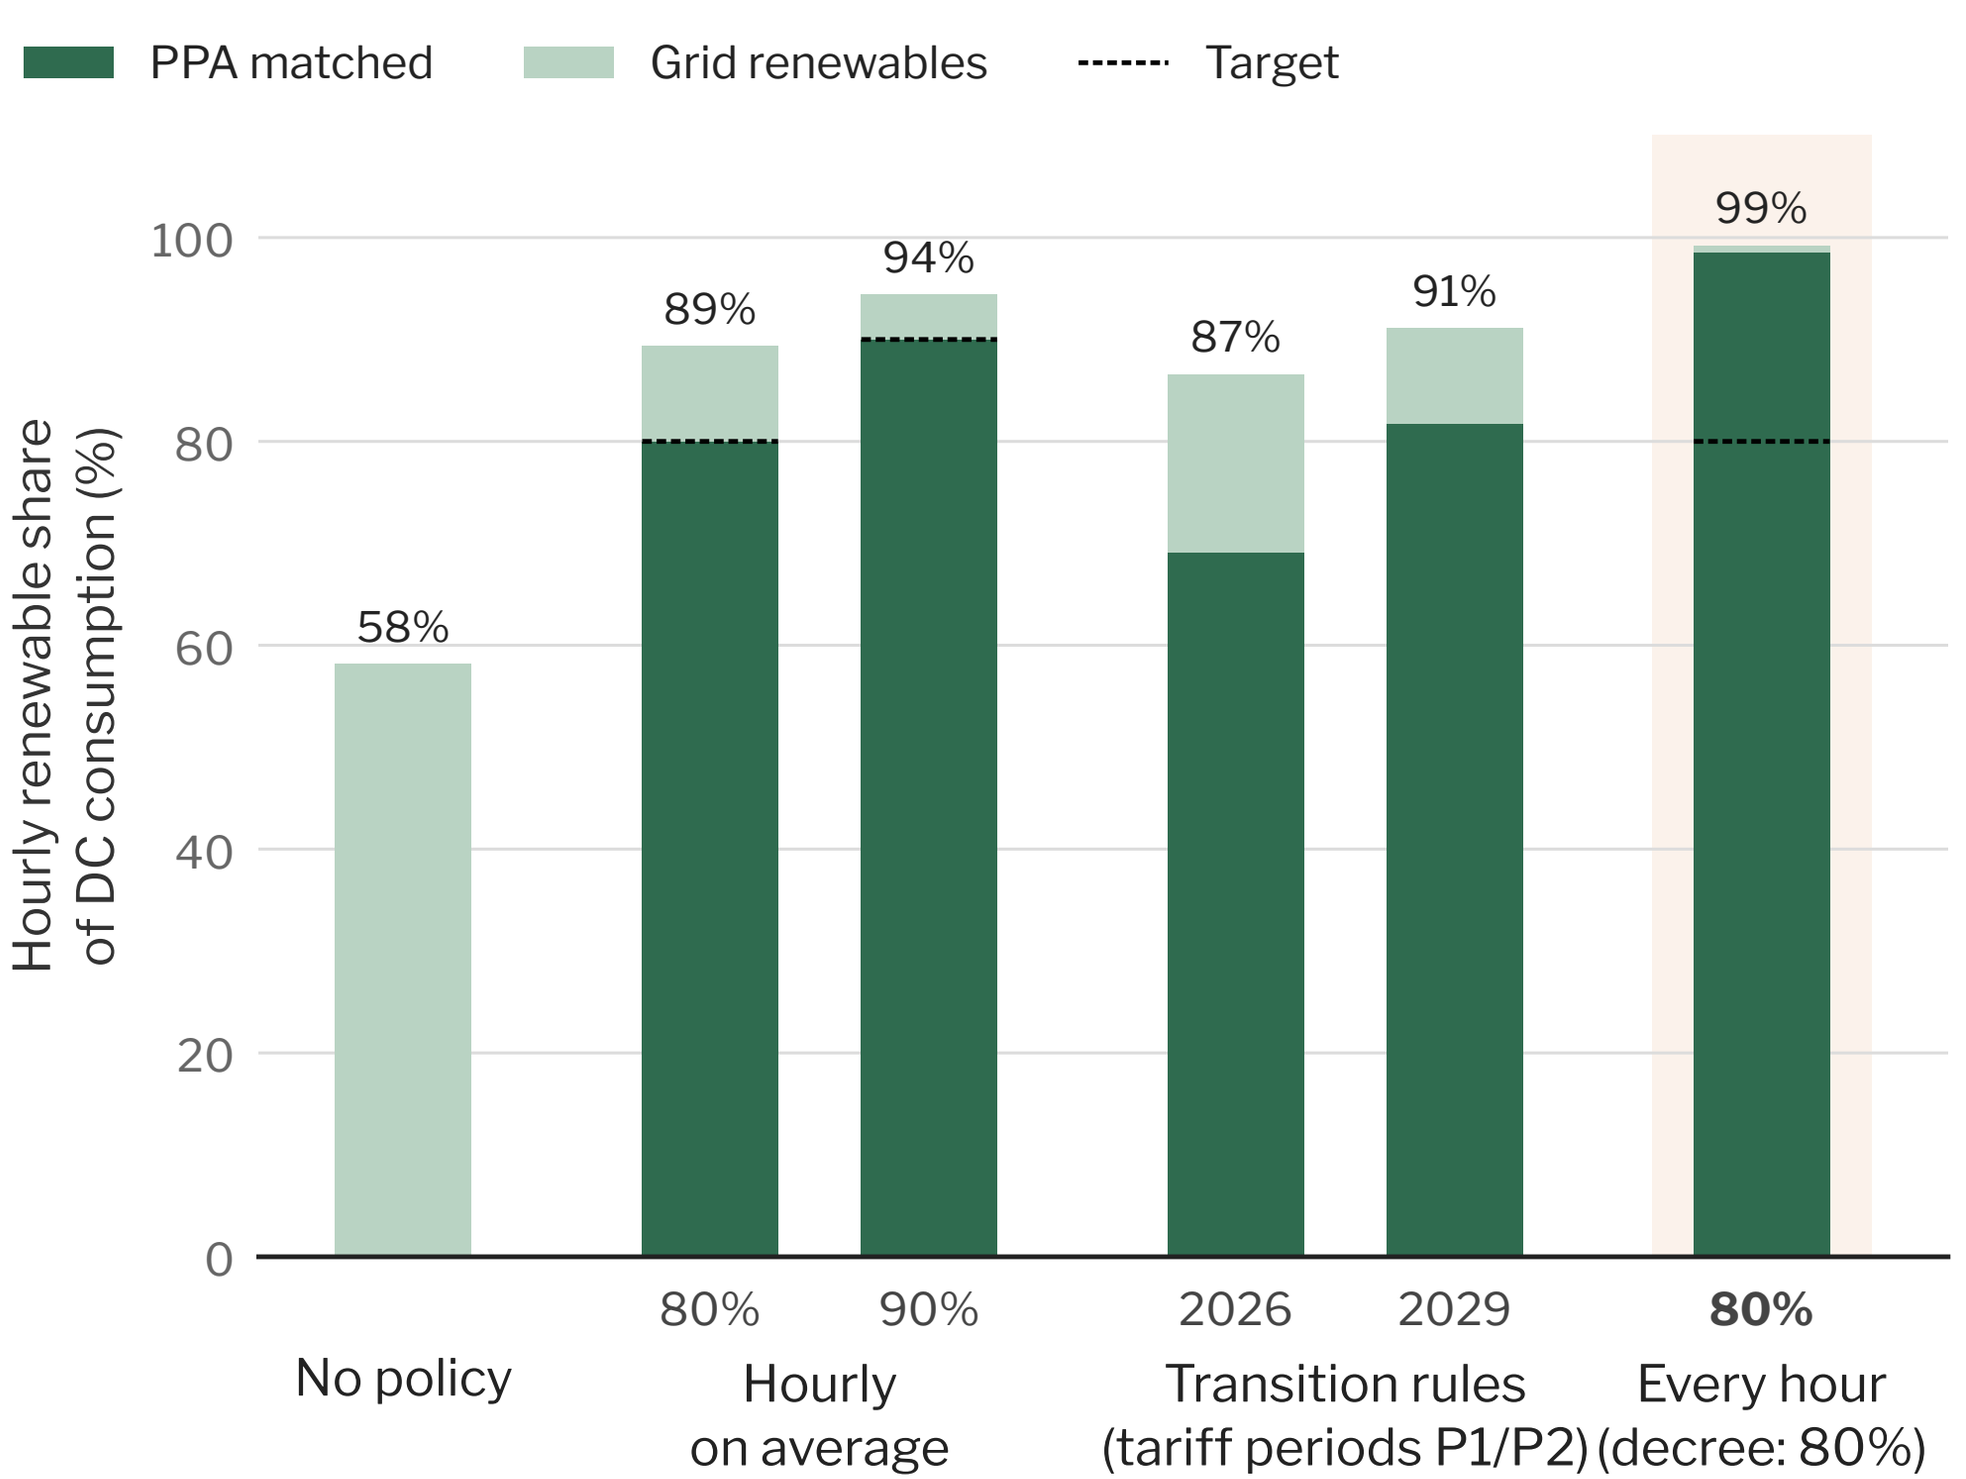

Share of the data center's consumption covered by renewables in the same hour: by its own PPAs and battery (dark), or by the renewable share of its grid purchases (light; import-traced, nuclear excluded). PPAs anywhere in mainland Spain. Transition rules: the revised draft's optional phase-in, a floor applied hour by hour only in peak tariff periods (P1: weekday daytime and evening hours in winter and July; P2: adjoining hours and March/November): 60% in P1 under the 2026 rules, then 70% in P1 and 60% in P2 from 2029. All other hours are unconstrained.