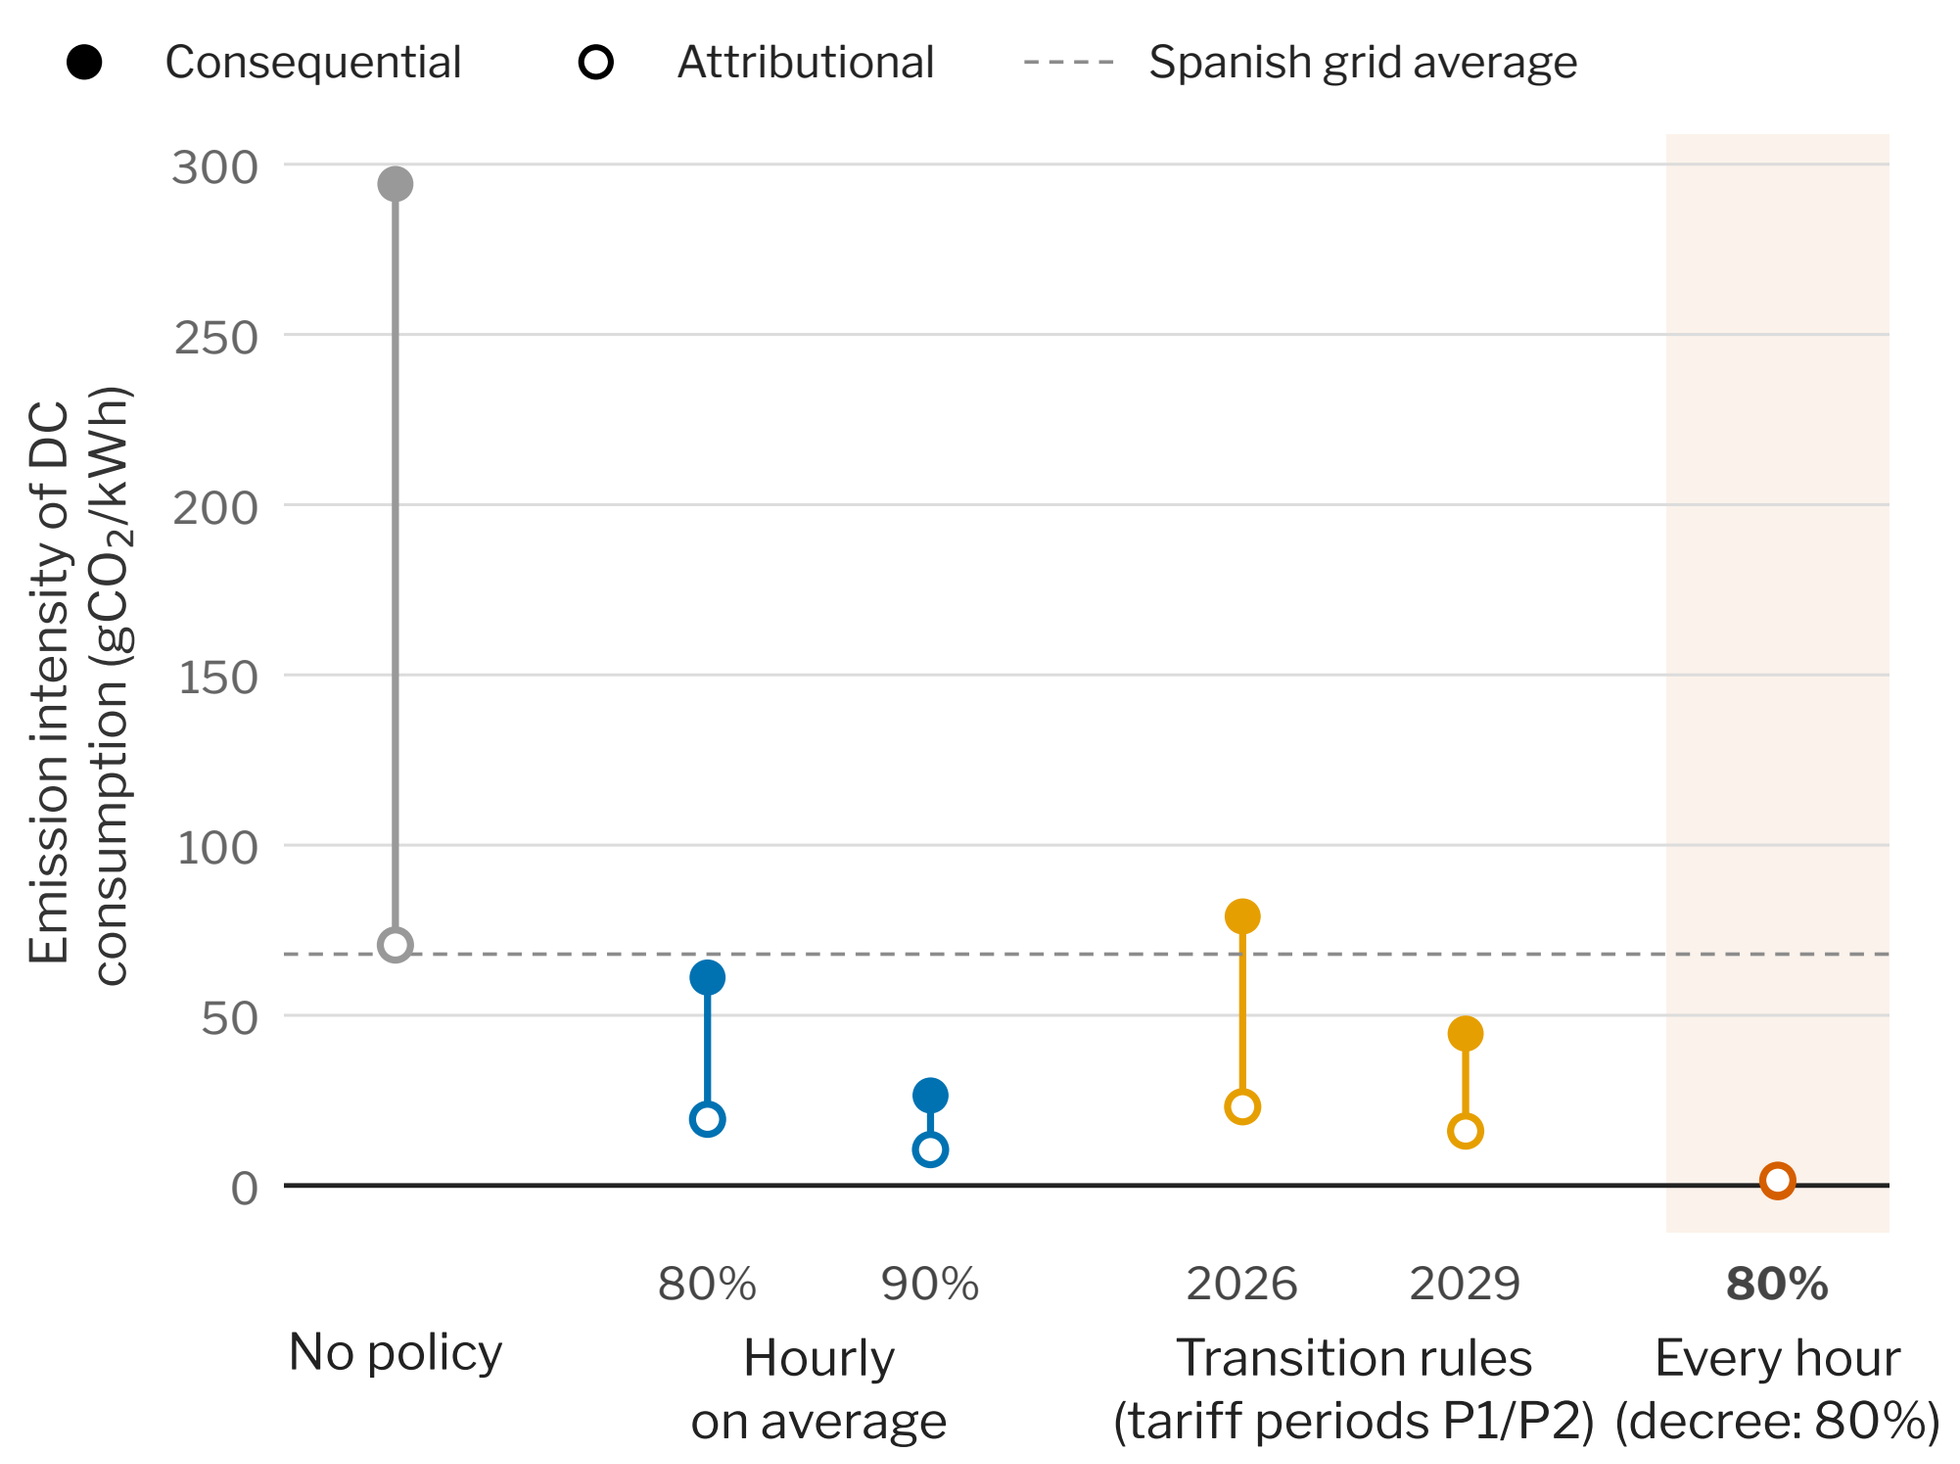

CO2 per kWh the data center consumes, measured two ways. Consequential (filled): the change in whole-model emissions against no data center, per kWh it consumes. Attributional (hollow): the emissions of its grid purchases, valued at the hourly emission factor of Spanish supply (imports traced to their exporter's mix), divided by all its consumption. PPAs anywhere in mainland Spain. Transition rules: the revised draft's optional phase-in, a floor applied hour by hour only in peak tariff periods (P1: weekday daytime and evening hours in winter and July; P2: adjoining hours and March/November): 60% in P1 under the 2026 rules, then 70% in P1 and 60% in P2 from 2029. All other hours are unconstrained.