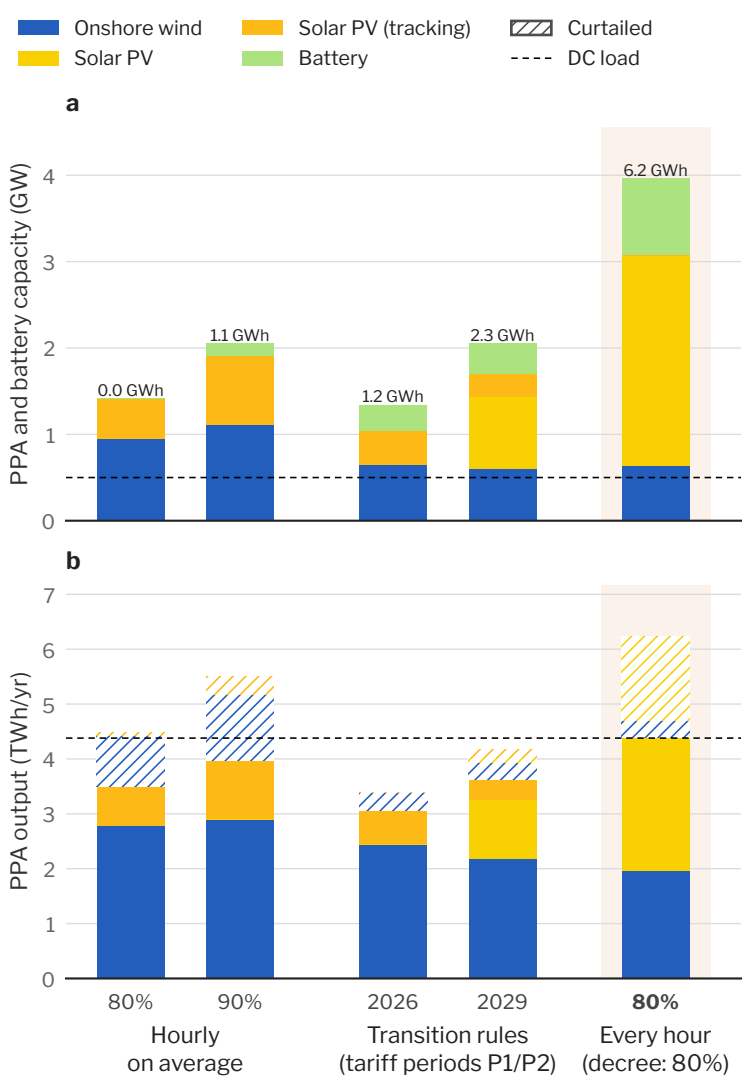

The data center's contracted assets (a) and their output (b); hatched: output curtailed, as surplus cannot be sold; dashed: the data center's load, as capacity (a) and annual consumption (b). PPAs anywhere in mainland Spain. Transition rules: the revised draft's optional phase-in, a floor applied hour by hour only in peak tariff periods (P1: weekday daytime and evening hours in winter and July; P2: adjoining hours and March/November): 60% in P1 under the 2026 rules, then 70% in P1 and 60% in P2 from 2029. All other hours are unconstrained.