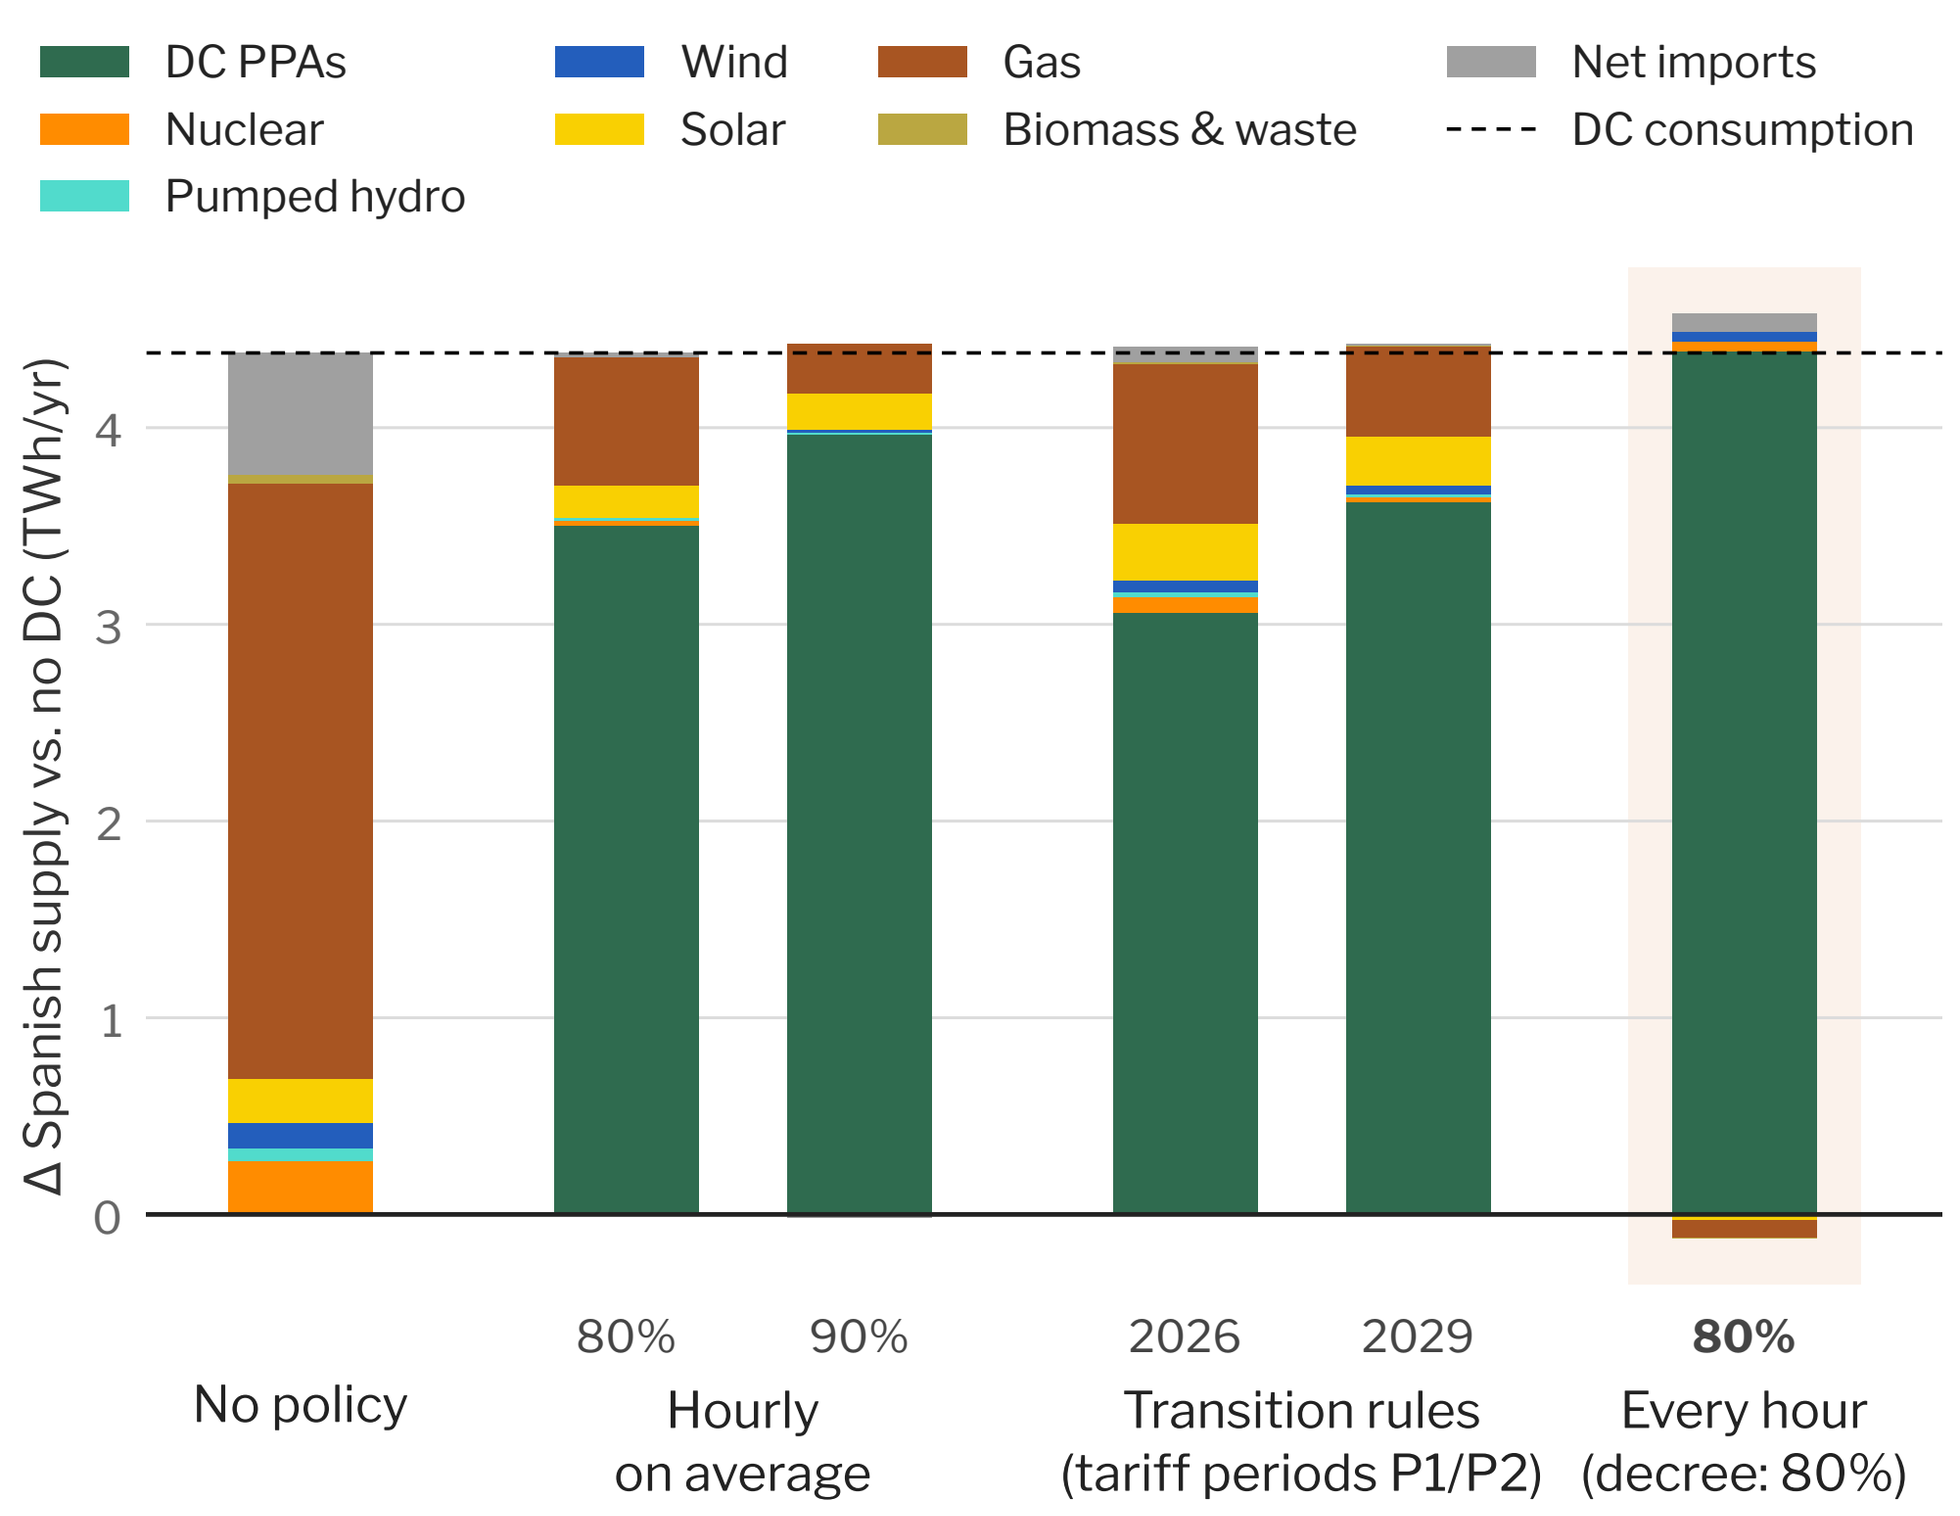

Change in Spanish electricity supply against no data center; dashed line: the data center's consumption. Surplus cannot be sold, so the data center's PPAs supply at most its own consumption (plus battery losses). PPAs anywhere in mainland Spain. Transition rules: the revised draft's optional phase-in, a floor applied hour by hour only in peak tariff periods (P1: weekday daytime and evening hours in winter and July; P2: adjoining hours and March/November): 60% in P1 under the 2026 rules, then 70% in P1 and 60% in P2 from 2029. All other hours are unconstrained.