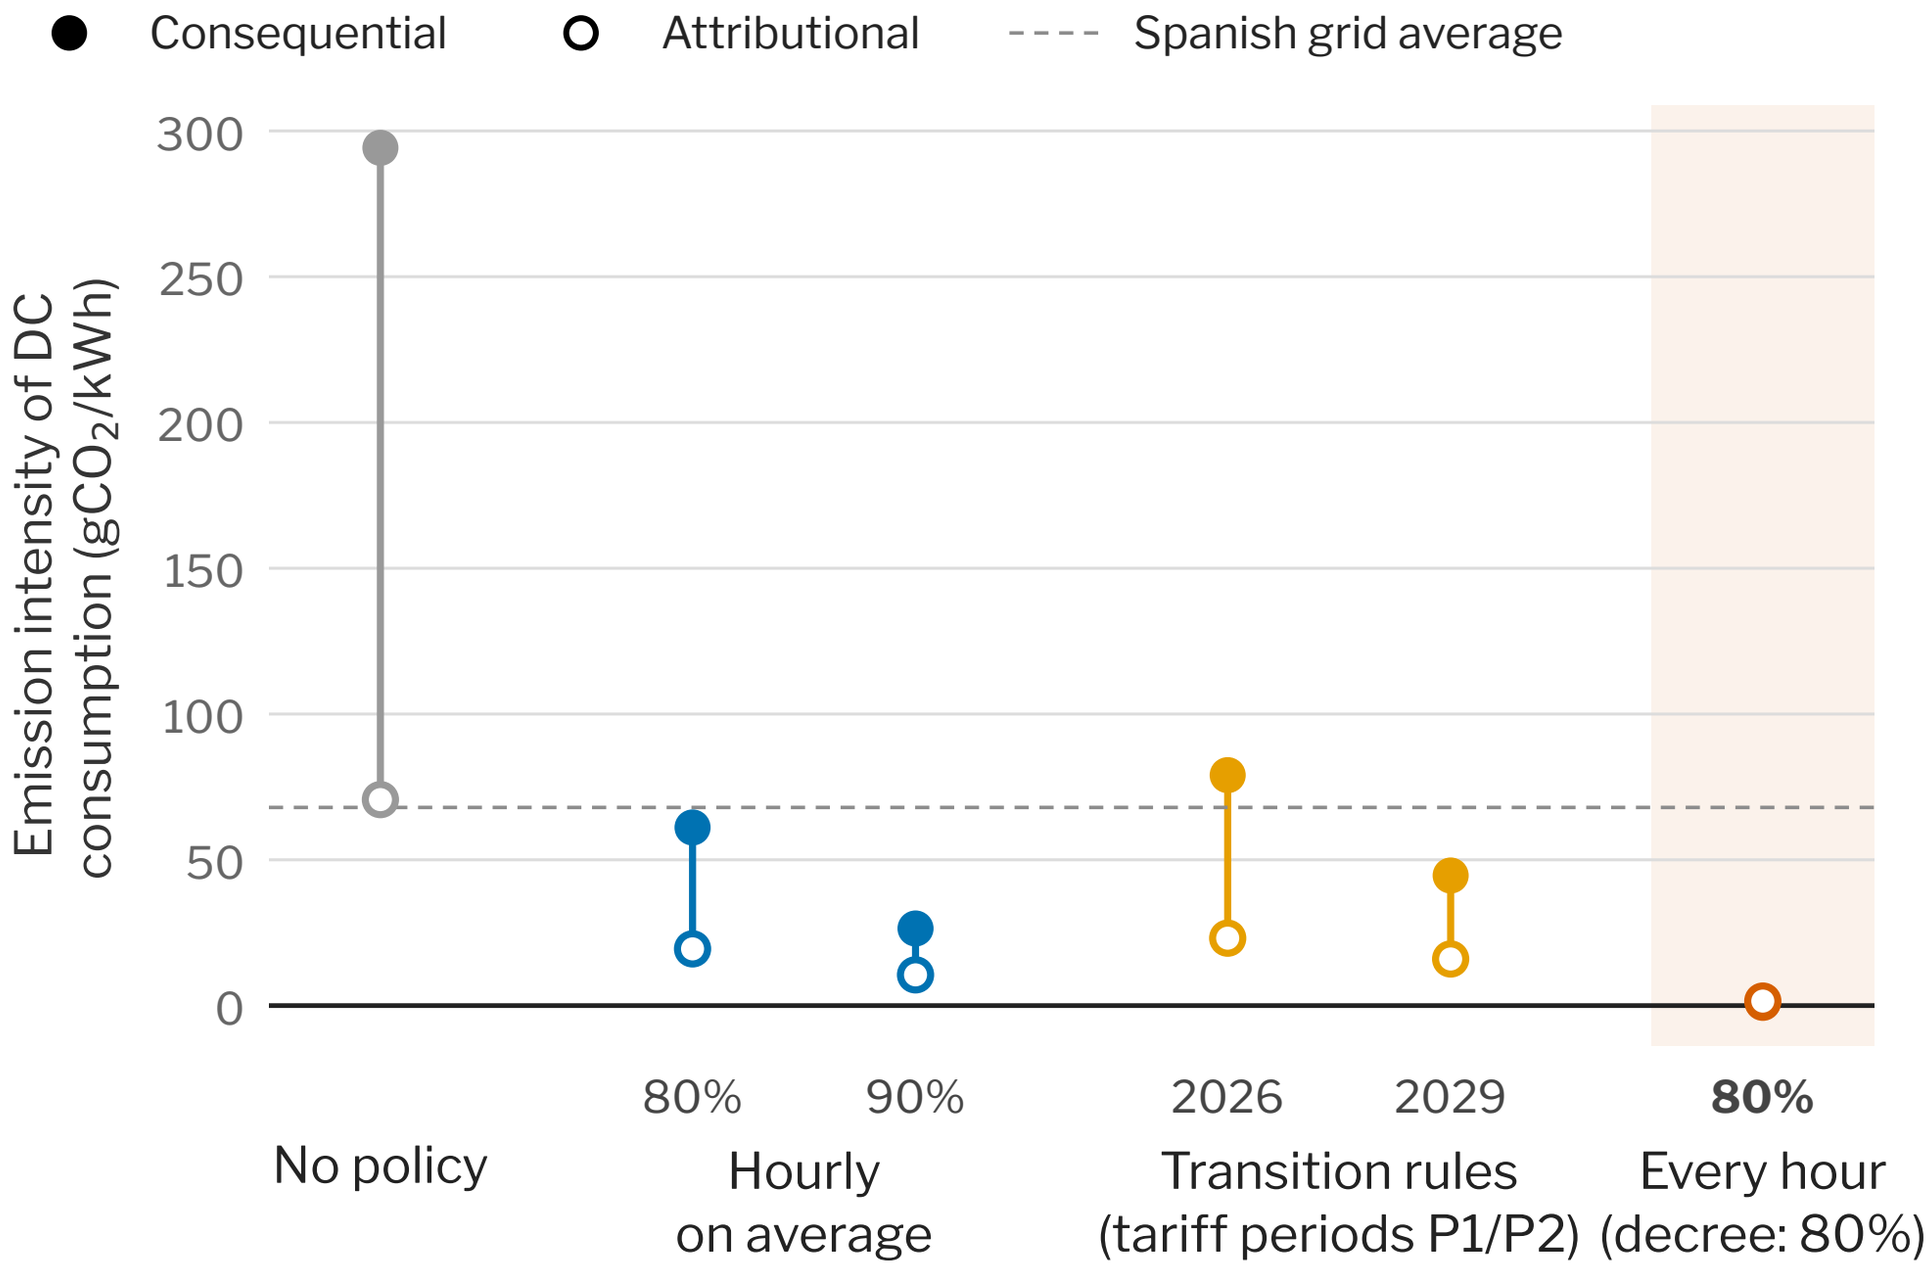

CO2 per kWh the data center consumes, measured two ways. Consequential (filled): the change in whole-model emissions against no data center, per kWh it consumes. Attributional (hollow): the emissions of its grid purchases, valued at the hourly emission factor of Spanish supply (imports traced to their exporter's mix), divided by all its consumption. PPAs anywhere in mainland Spain. Transition rules: the revised draft's phase-in for data centers in the automatic load-reduction scheme, a floor in tariff periods P1 and P2 only, applied hour by hour as in Art. 9: 60% in P1 hours under the 2026 rules (to 2028), then 70% in P1 and 60% in P2 hours under the 2029 rules; all other hours are unconstrained (P1: 9–14 h and 18–22 h on weekdays in January, February, July and December; P2: 8–9, 14–18 and 22–24 h on those days, and 9–14 h and 18–22 h on weekdays in March and November; local time, national holidays excluded).