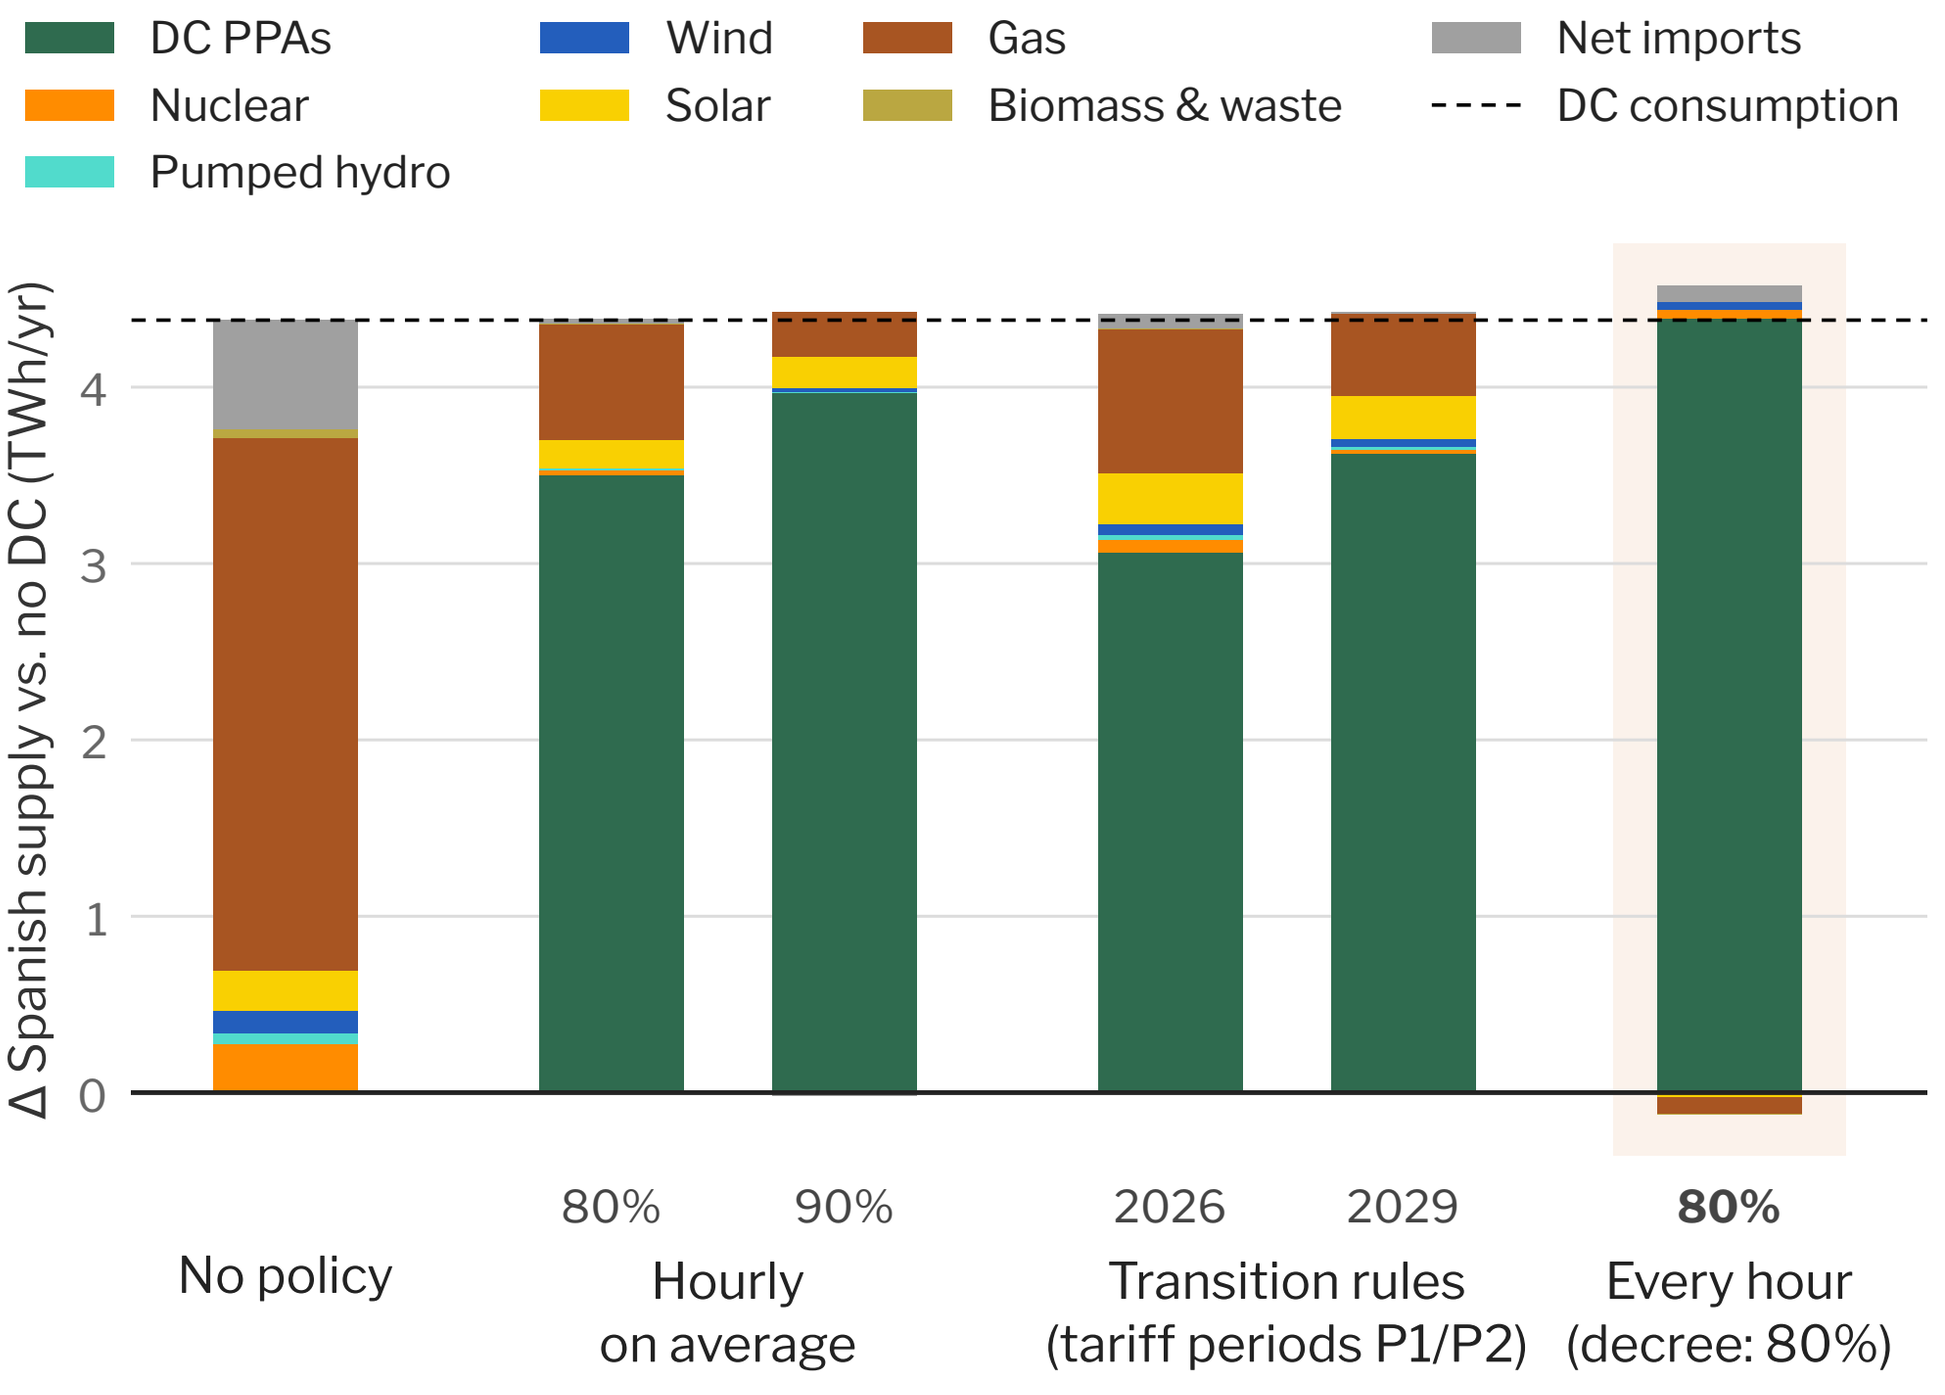

Change in Spanish electricity supply against no data center; dashed line: the data center's consumption. Surplus cannot be sold, so the data center's PPAs supply at most its own consumption (plus battery losses). PPAs anywhere in mainland Spain. Transition rules: the revised draft's phase-in for data centers in the automatic load-reduction scheme, a floor in tariff periods P1 and P2 only, applied hour by hour as in Art. 9: 60% in P1 hours under the 2026 rules (to 2028), then 70% in P1 and 60% in P2 hours under the 2029 rules; all other hours are unconstrained (P1: 9–14 h and 18–22 h on weekdays in January, February, July and December; P2: 8–9, 14–18 and 22–24 h on those days, and 9–14 h and 18–22 h on weekdays in March and November; local time, national holidays excluded).