



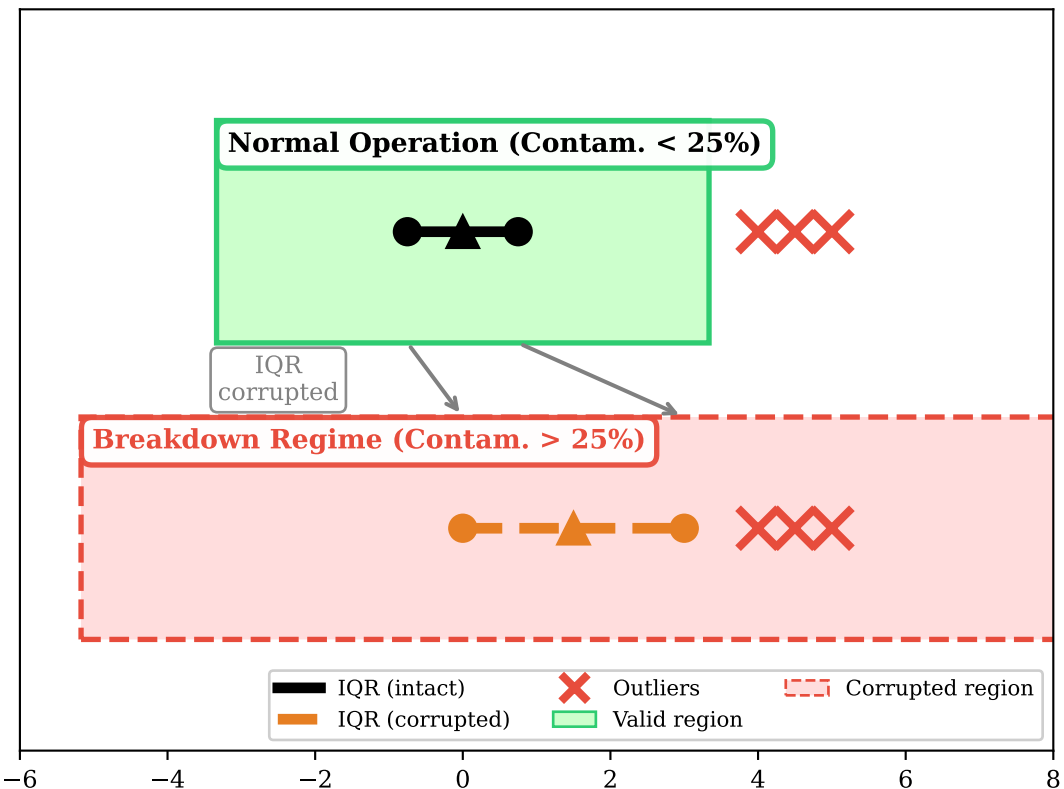

**(a) Mechanism of IQR Corruption
When Contamination Exceeds 25%**

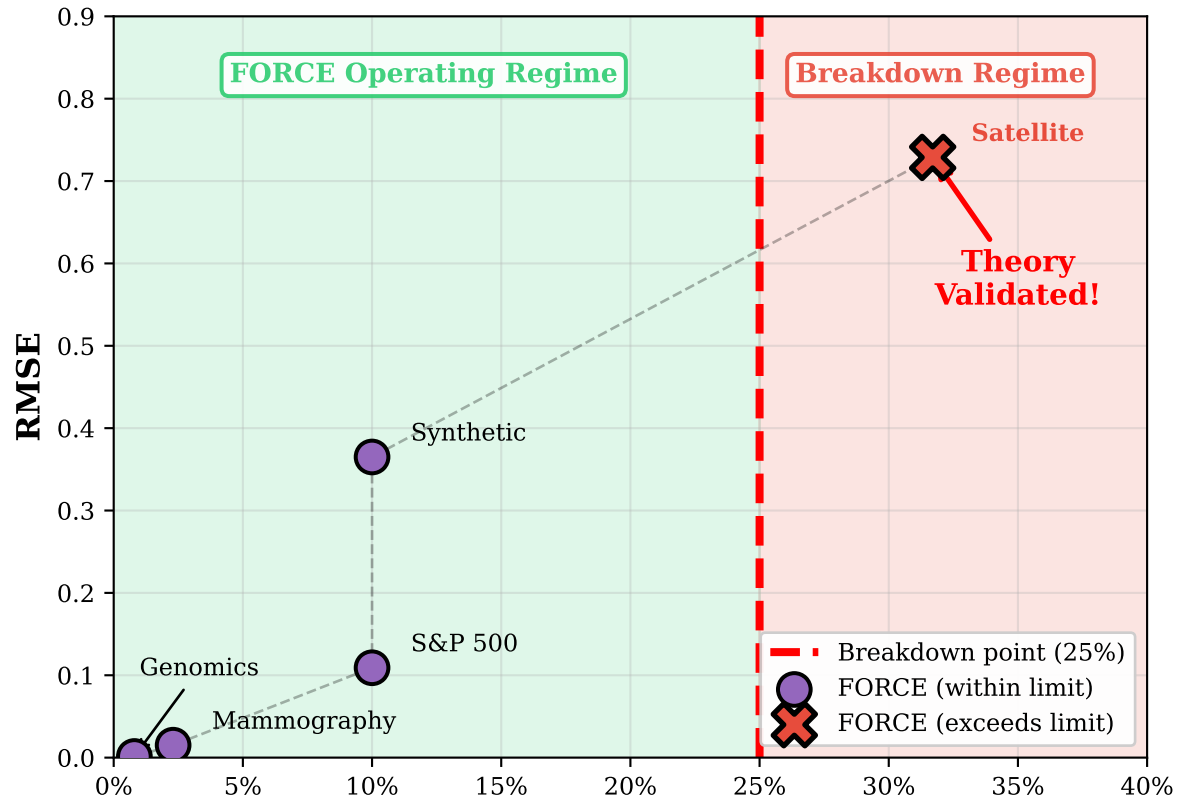

**(b) RMSE vs. Contamination Rate
Empirical Validation of Breakdown Point**