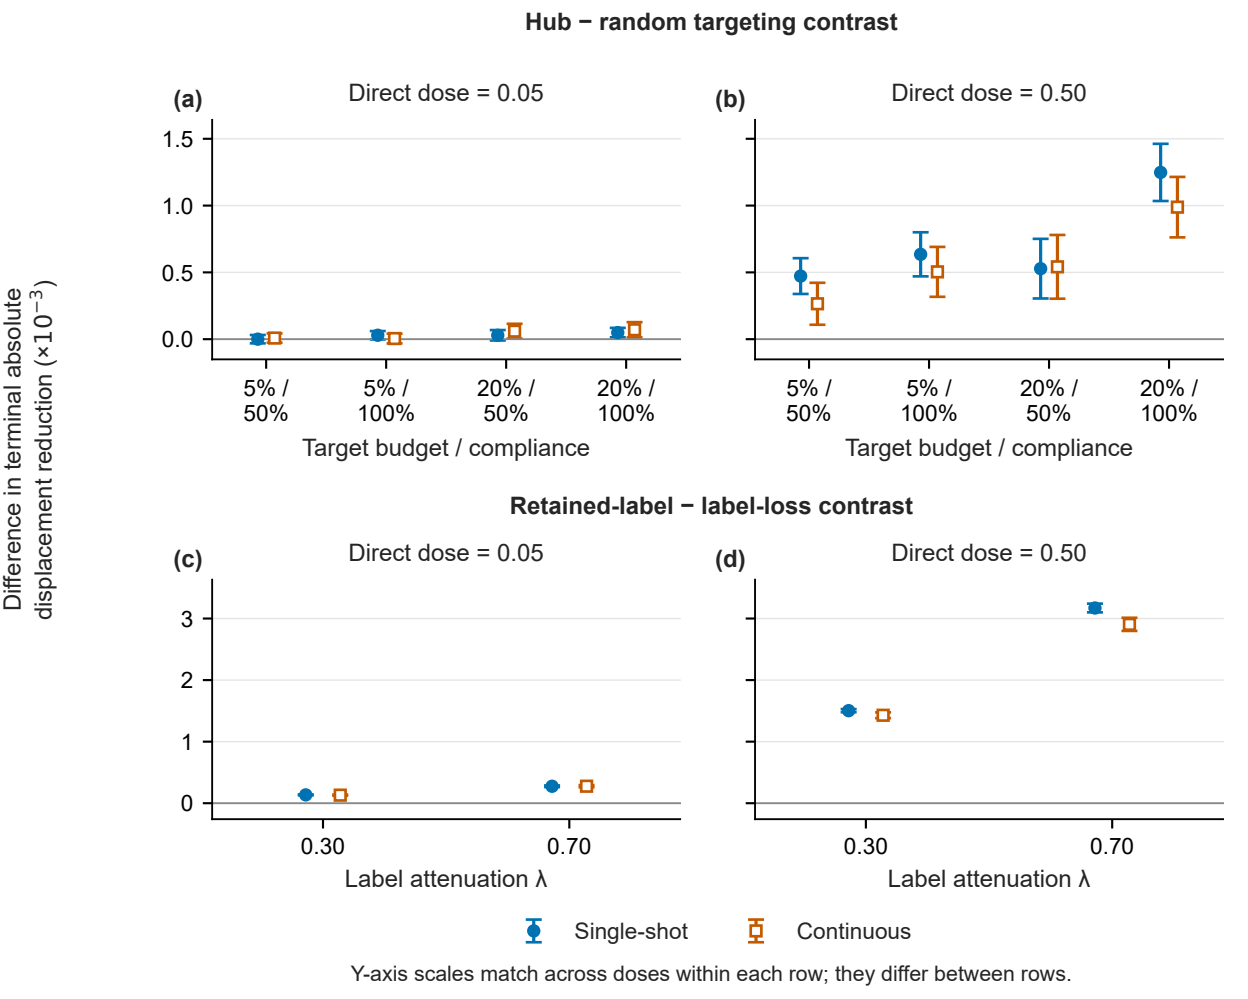
Hub − random targeting contrast
(a)
Direct dose = 0.05
(b)
Direct dose = 0.50
Difference in terminal absolute displacement reduction (×10⁻³)
1.5
1.0
0.5
0.0
5% / 50%
5% / 100%
20% / 50%
20% / 100%
Target budget / compliance
Retained-label − label-loss contrast
(c)
Direct dose = 0.05
(d)
Direct dose = 0.50
3
2
1
0
0.30
0.70
Label attenuation λ
Single-shot
Continuous
Y-axis scales match across doses within each row; they differ between rows.