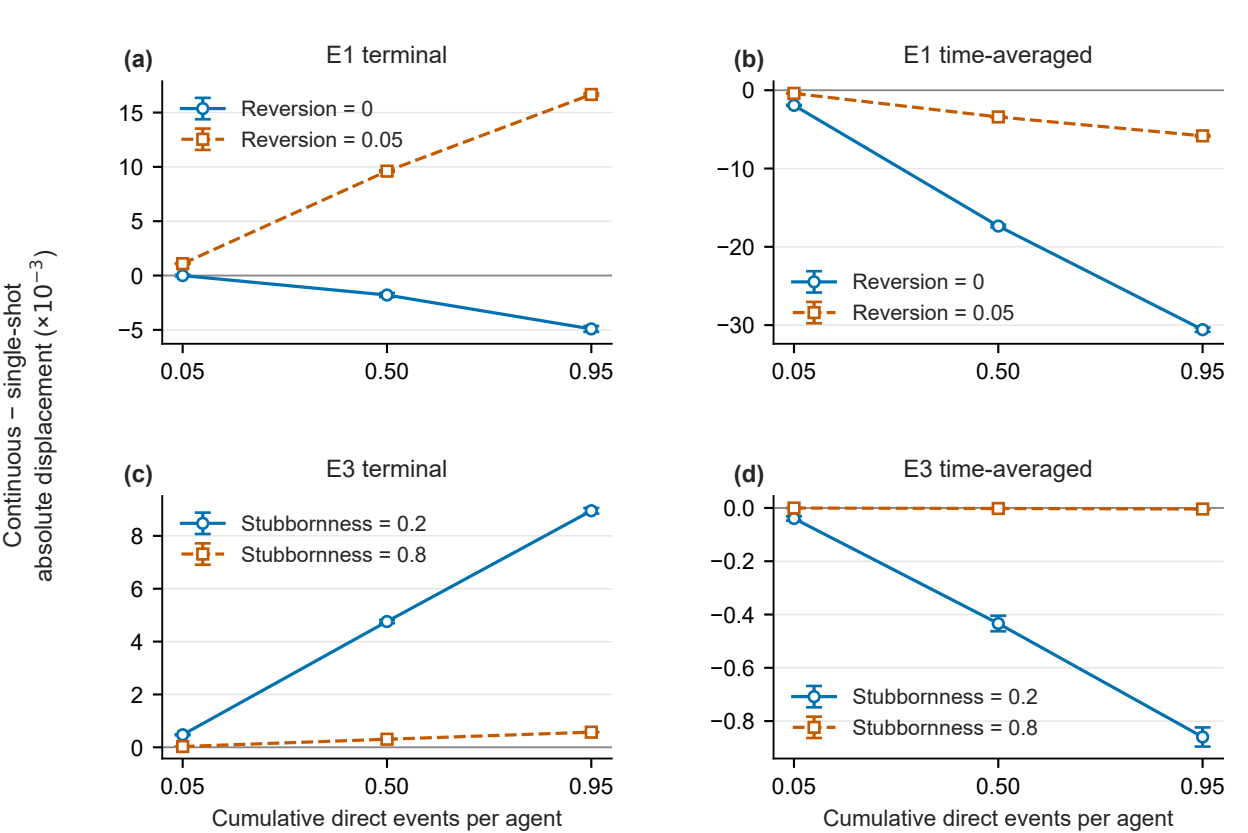
(a)
E1 terminal
Reversion = 0
Reversion = 0.05
(b)
E1 time-averaged
Reversion = 0
Reversion = 0.05
(c)
E3 terminal
Stubbornness = 0.2
Stubbornness = 0.8
(d)
E3 time-averaged
Stubbornness = 0.2
Stubbornness = 0.8
Continuous − single-shot
absolute displacement (×10⁻³)
Cumulative direct events per agent
Cumulative direct events per agent
Y-axis scales differ across panels; lines connect evaluated doses only.