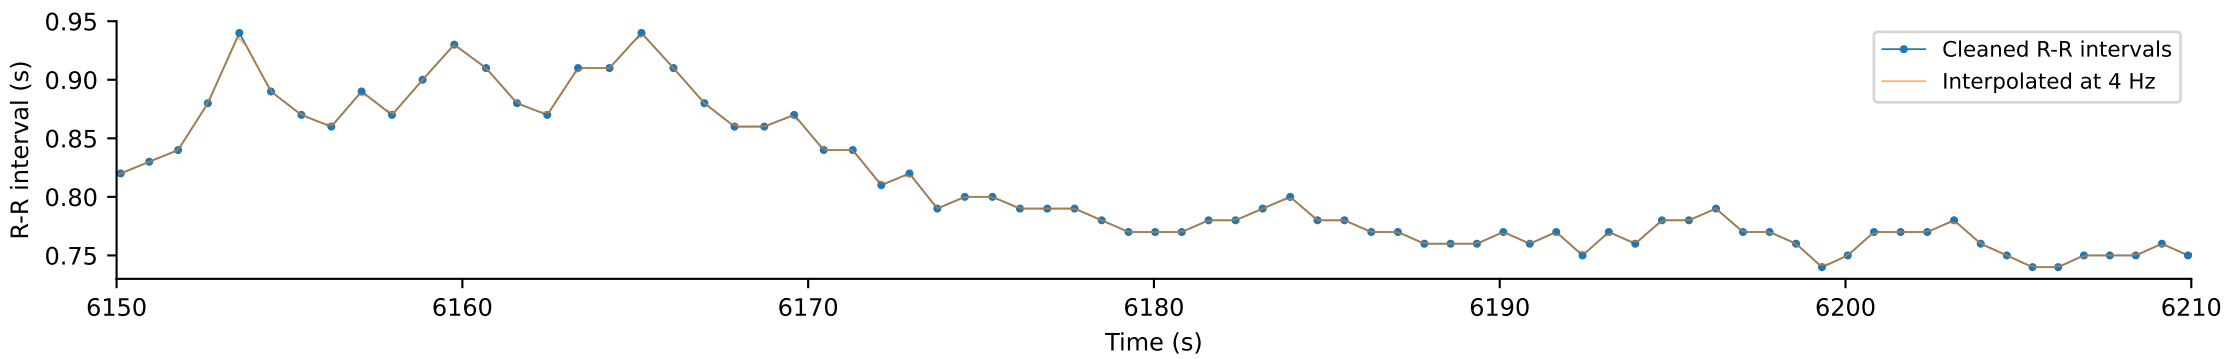
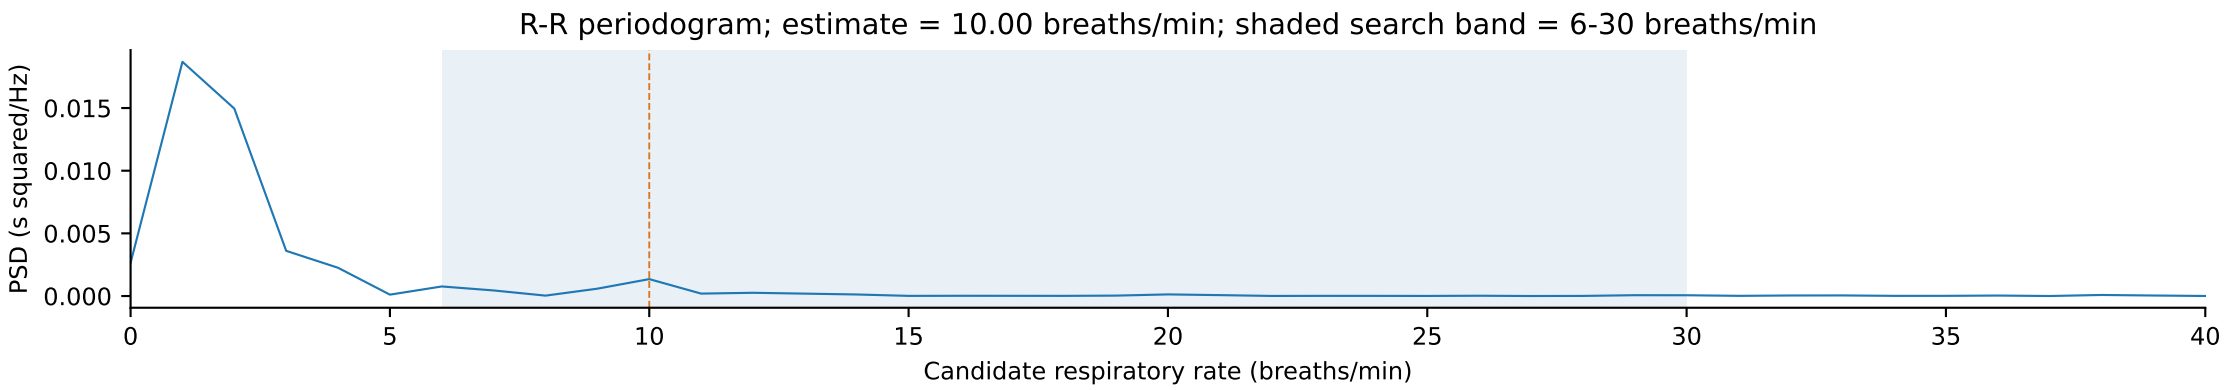
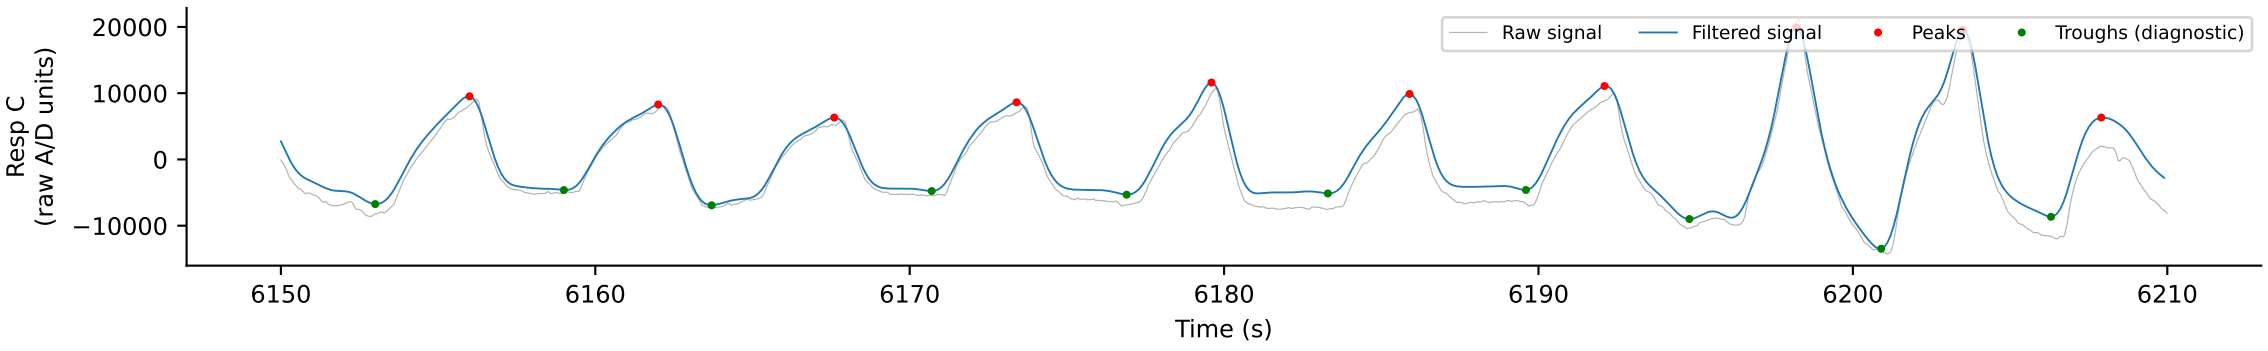
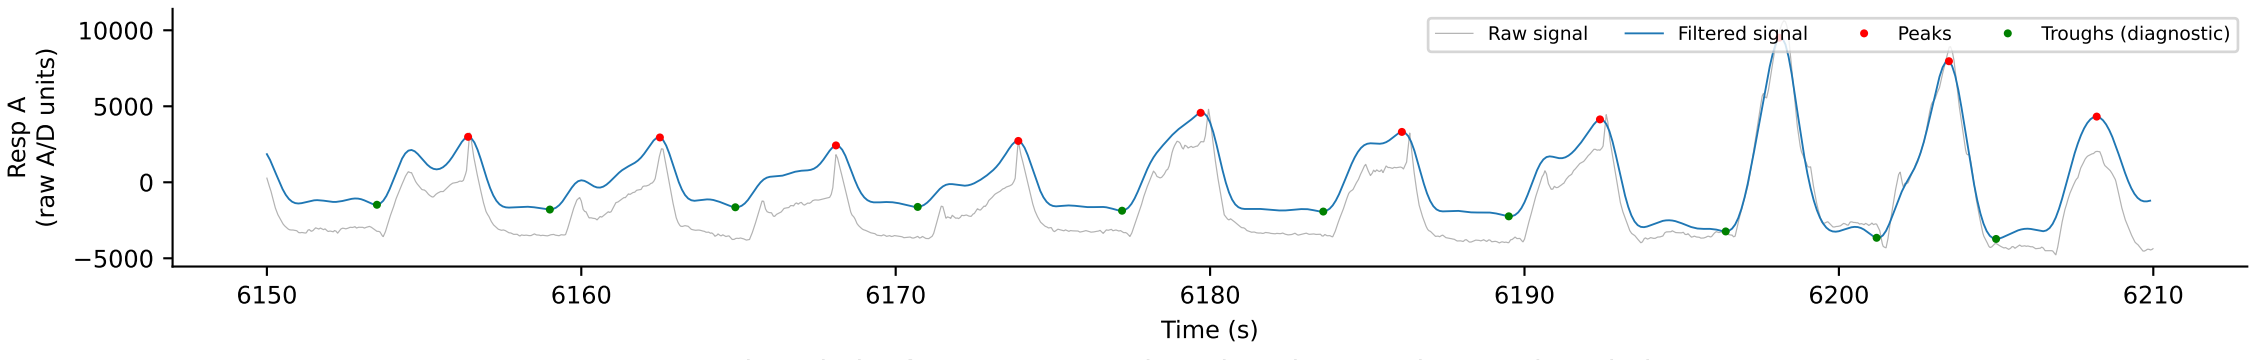
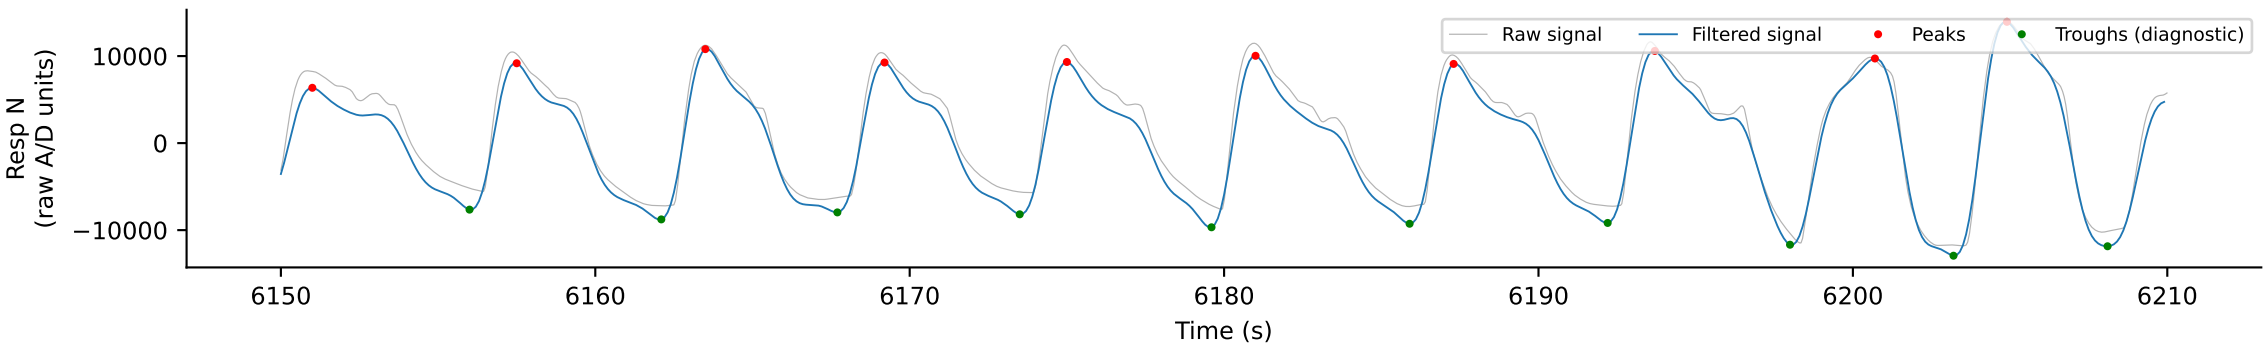

a03, 6150-6210 s: ECG and detected beats (n=74)
ECG (mV)
ECG
Detected beat landmarks
Time (s)


R-R interval (s)
Cleaned R-R intervals
Interpolated at 4 Hz
Time (s)


R-R periodogram; estimate = 10.00 breaths/min; shaded search band = 6-30 breaths/min
PSD (s squared/Hz)
Candidate respiratory rate (breaths/min)


Peak-period reference = 10.00 breaths/min; complete peak periods = 9
Resp C (raw A/D units)
Raw signal
Filtered signal
Peaks
Troughs (diagnostic)
Time (s)


Peak-period reference = 10.34 breaths/min; complete peak periods = 9
Resp A (raw A/D units)
Raw signal
Filtered signal
Peaks
Troughs (diagnostic)
Time (s)


Peak-period reference = 10.00 breaths/min; complete peak periods = 9
Resp N (raw A/D units)
Raw signal
Filtered signal
Peaks
Troughs (diagnostic)
Time (s)