

A-3000 / VENT GAS TREATMENT

Compatible wet-acid gas train • Source segregation • Major protective functions


NOT FOR CONSTRUCTION

CANDIDATE WET VENTS

A-100 / A-140 / A-160
Normal compatible wet-acid vents only.
A-200 / A-300: confirm conditioning.
A-1000: qualify each vessel vent.
A-400 / A-500: proposed additions [P].

Every connection remains subject to
source analysis and compatibility.
A-160 dryer exhaust assessed separately.

HD-3100 [P] — qualified-source header
No area-wide blanket connection.
Normal vent duty does not include emergency relief.

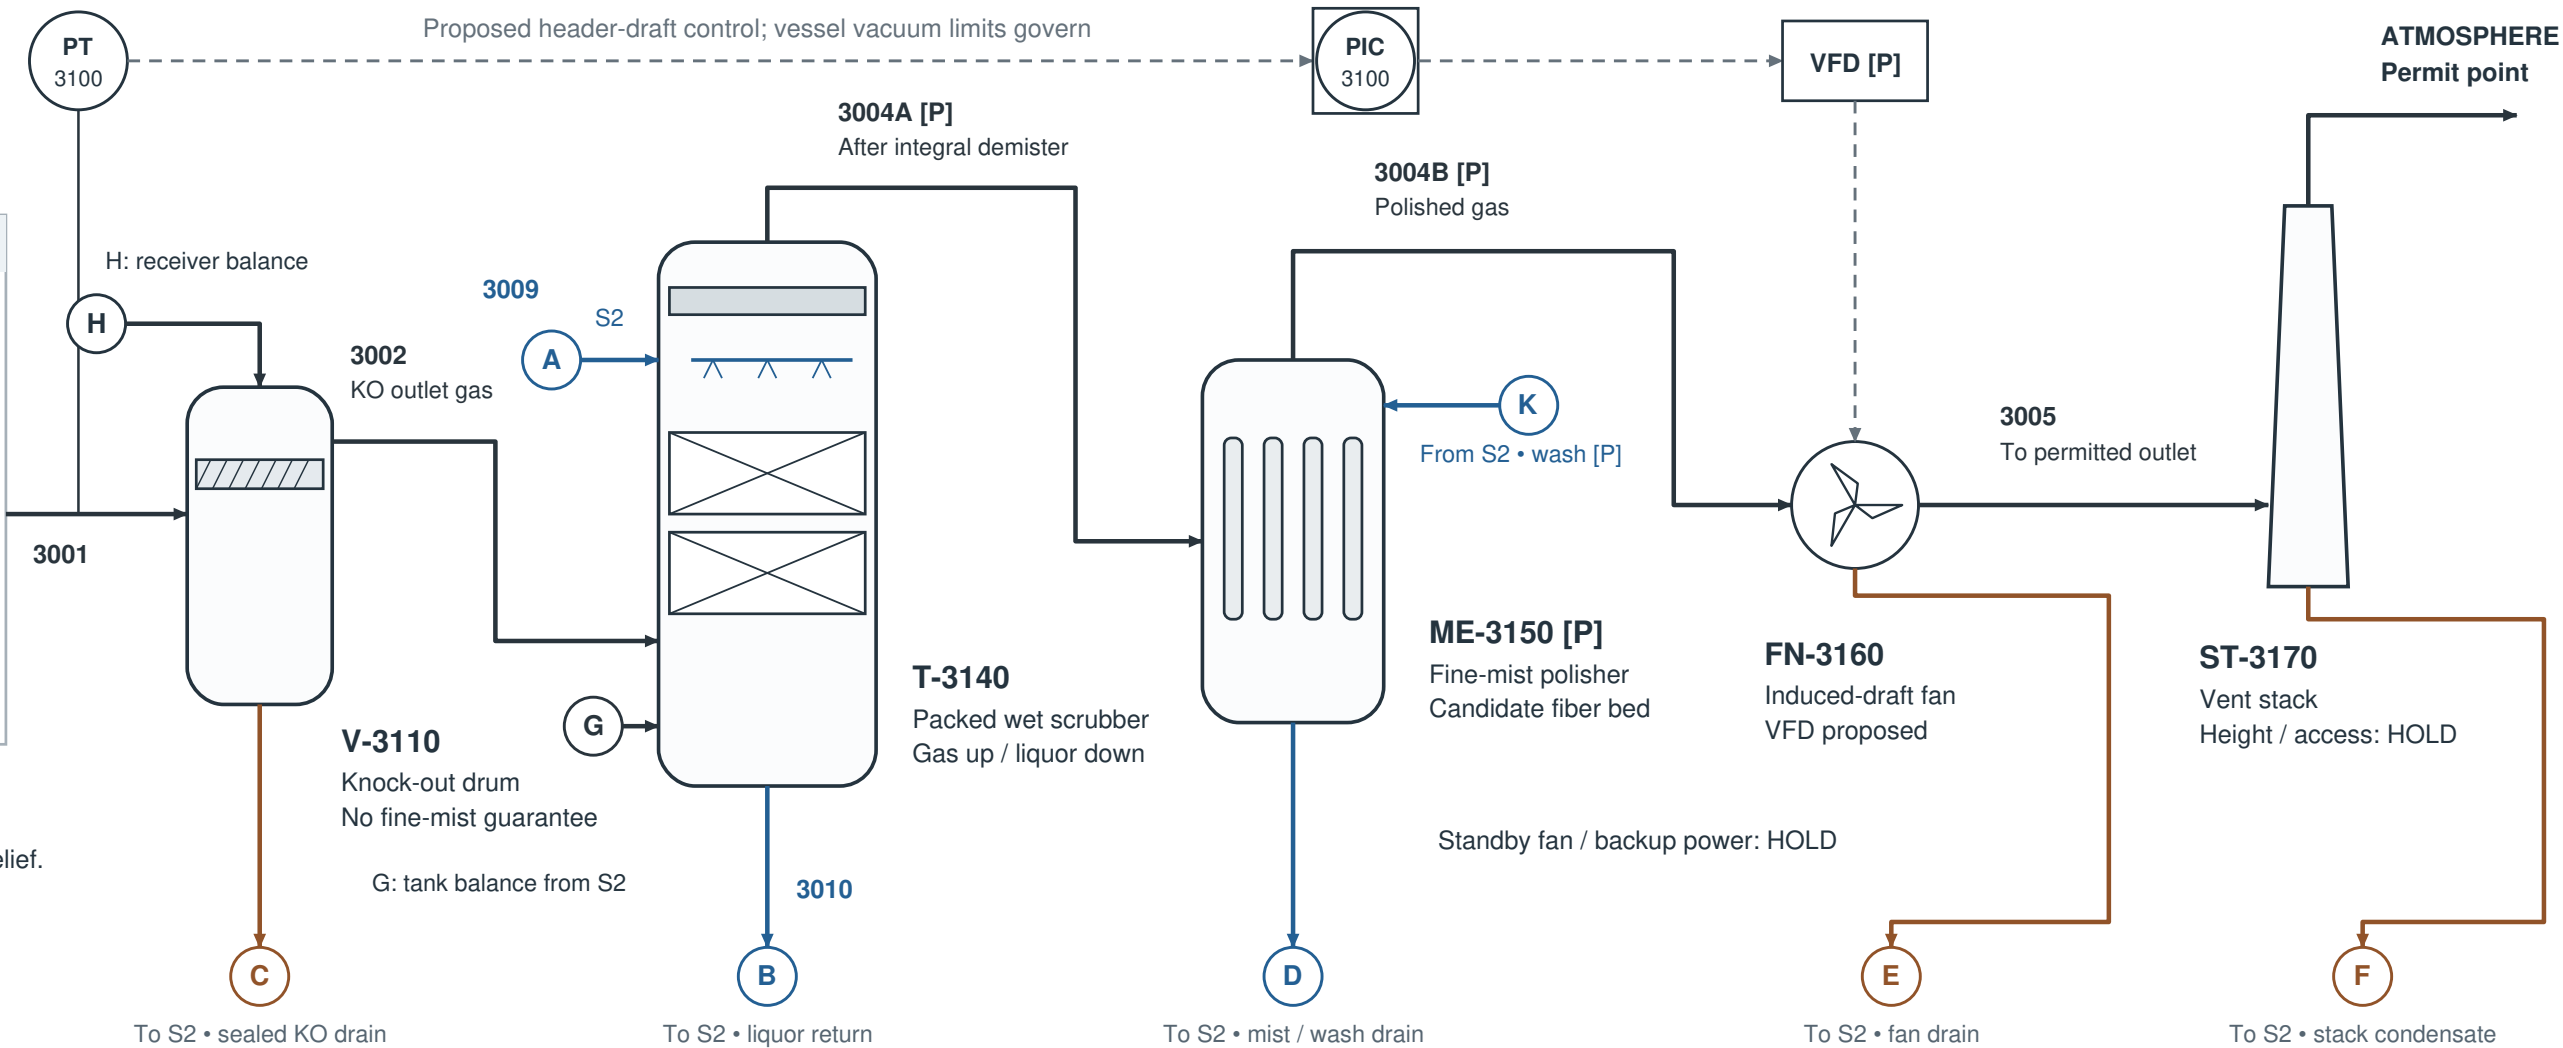

REVIEW CHANGES AND OPERATING BOUNDARIES

01 / SEPARATE SERVICES — NO CONNECTION HERE

A-600: review treated drying exhaust and existing SC-601.
A-700 / A-800: thermal / reactive gases; dedicated study.
A-900: cartridge filling / dust duty to confirm, not furnace.
Peroxide breathing, oxidizer dust and carbon dust:
separate compatible systems; do not interconnect.
Emergency relief: independent assessed destination.
This absorber is not credited for H2 / CO destruction.

02 / BYPASS AND FAILURE RESPONSE

Original stream 3003 operating bypass is deleted.
Maintenance: stop emission-generating operations and
provide qualified treatment of residual emissions.
Loss of draft / liquor flow, high differential pressure or
pH outside the qualified range: alarm and inhibit new
feed / heat as defined by the hazard review. Maintain
available treatment; do not blanket-close vessel vents.

03 / REQUIRED DESIGN BASIS — HOLD

Normal / peak / upset flow, composition, temperature,
moisture, aerosol size, solids and pressure envelope.
Fan pressure budget, capture performance, cooling
need, materials and mist-polisher selection: unqualified.
No assigned capacity, efficiency or emission limit.
Confirm BC air authorization and site jurisdiction;
WorkSafeBC ventilation / exposure review required.

Gas / balance Liquor / water Closed waste / drain Control signal Matched sheet connector

[P] = proposed addition; retained tag does not indicate equipment is installed or approved. 3004 split into proposed suffixes A / B.
Field instrument: circle. DCS controller: circle in square. Other instruments, isolations, relief devices and setpoints belong on the P&ID.
G / H = dedicated pressure-balance paths to the dirty side. Liquid seals, elevations and pressure differentials require hydraulic verification.

A-3000 / VENT GAS TREATMENT

Scrubber liquor • Makeup and reagent supply • Segregated closed waste handling

NOT FOR CONSTRUCTION

