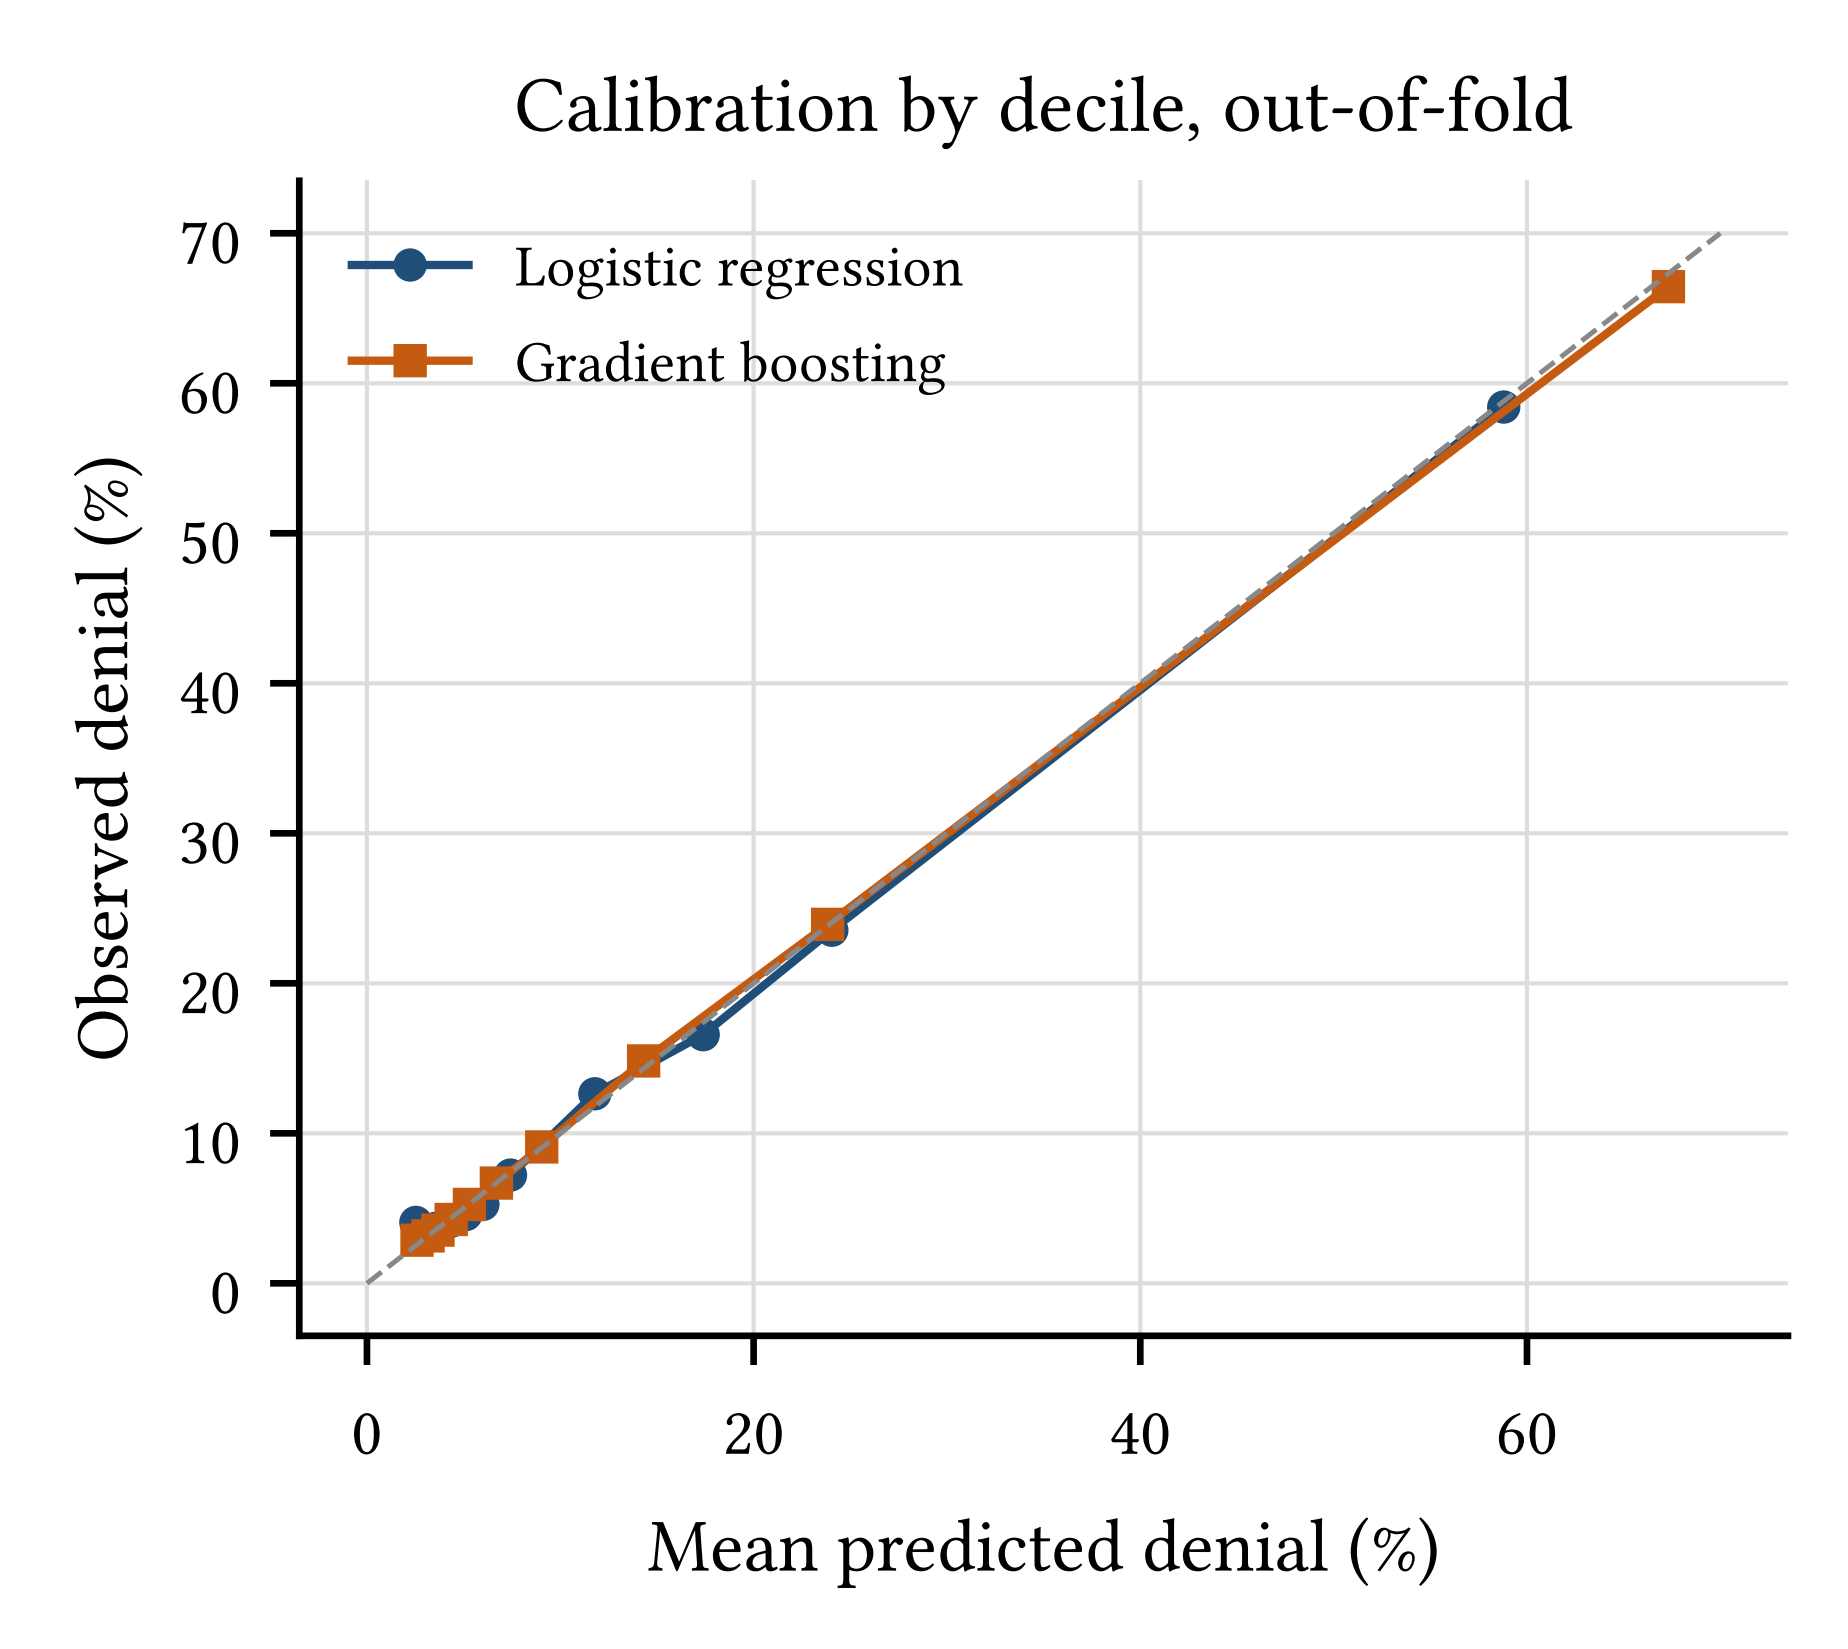
Calibration by decile, out-of-fold
Logistic regression
Gradient boosting
Observed denial (%)
Mean predicted denial (%)
0
10
20
30
40
50
60
70
0
20
40
60