




强电总向系统图

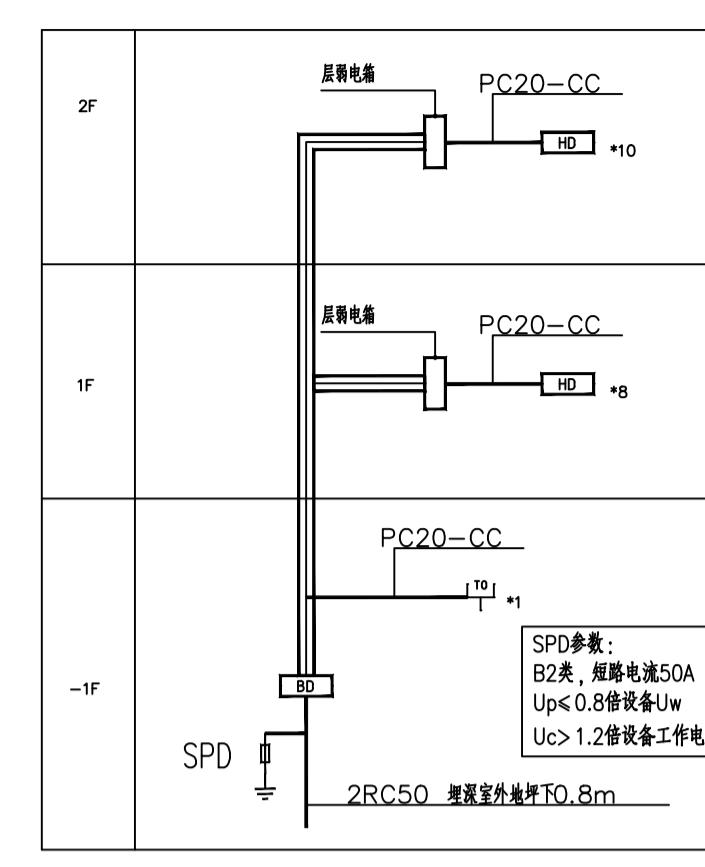


网络电话总向系统图

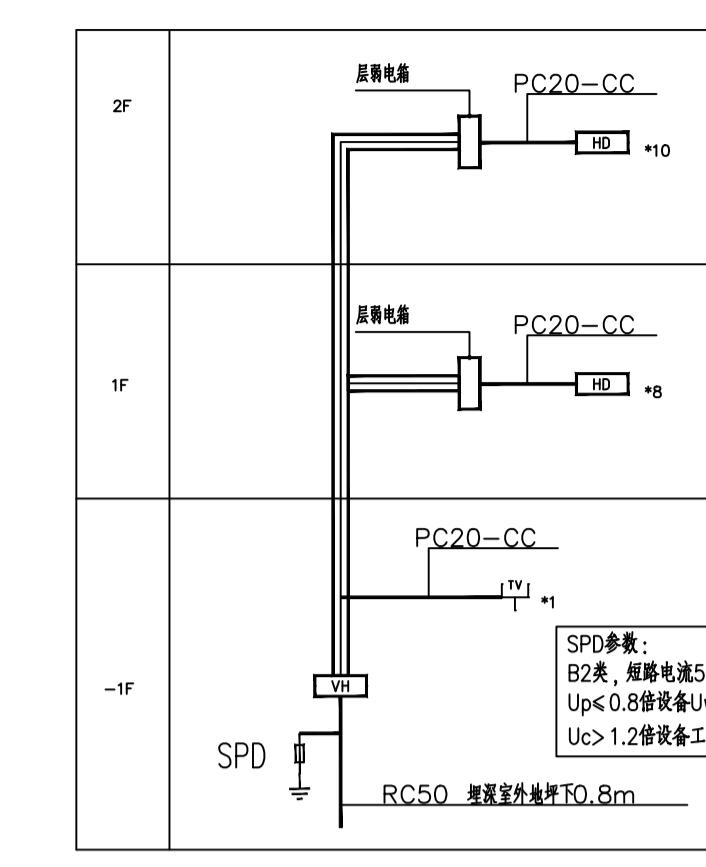


有线电视总向系统图

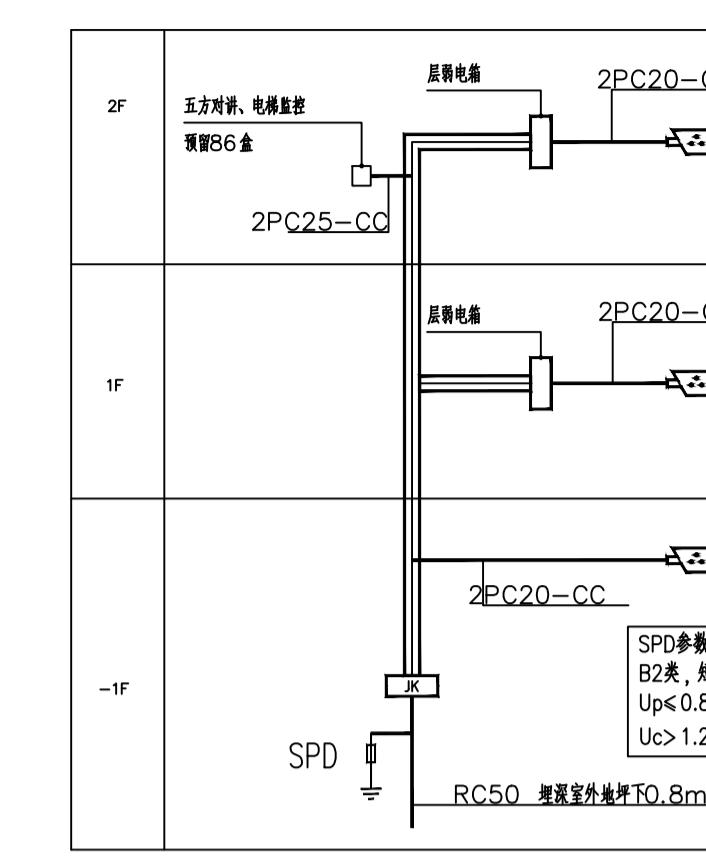


安防监控总向系统图

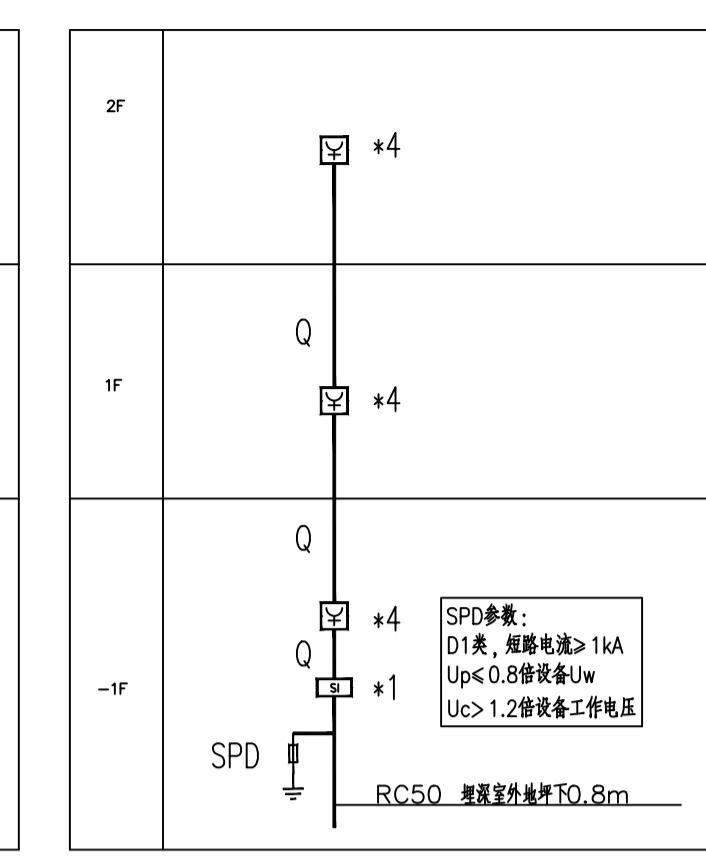

消防总向系统图


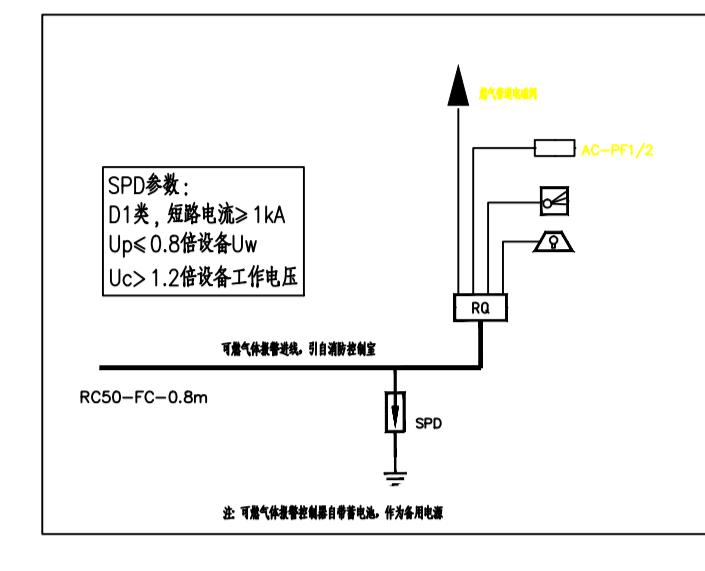


可燃气体报警控制系统图

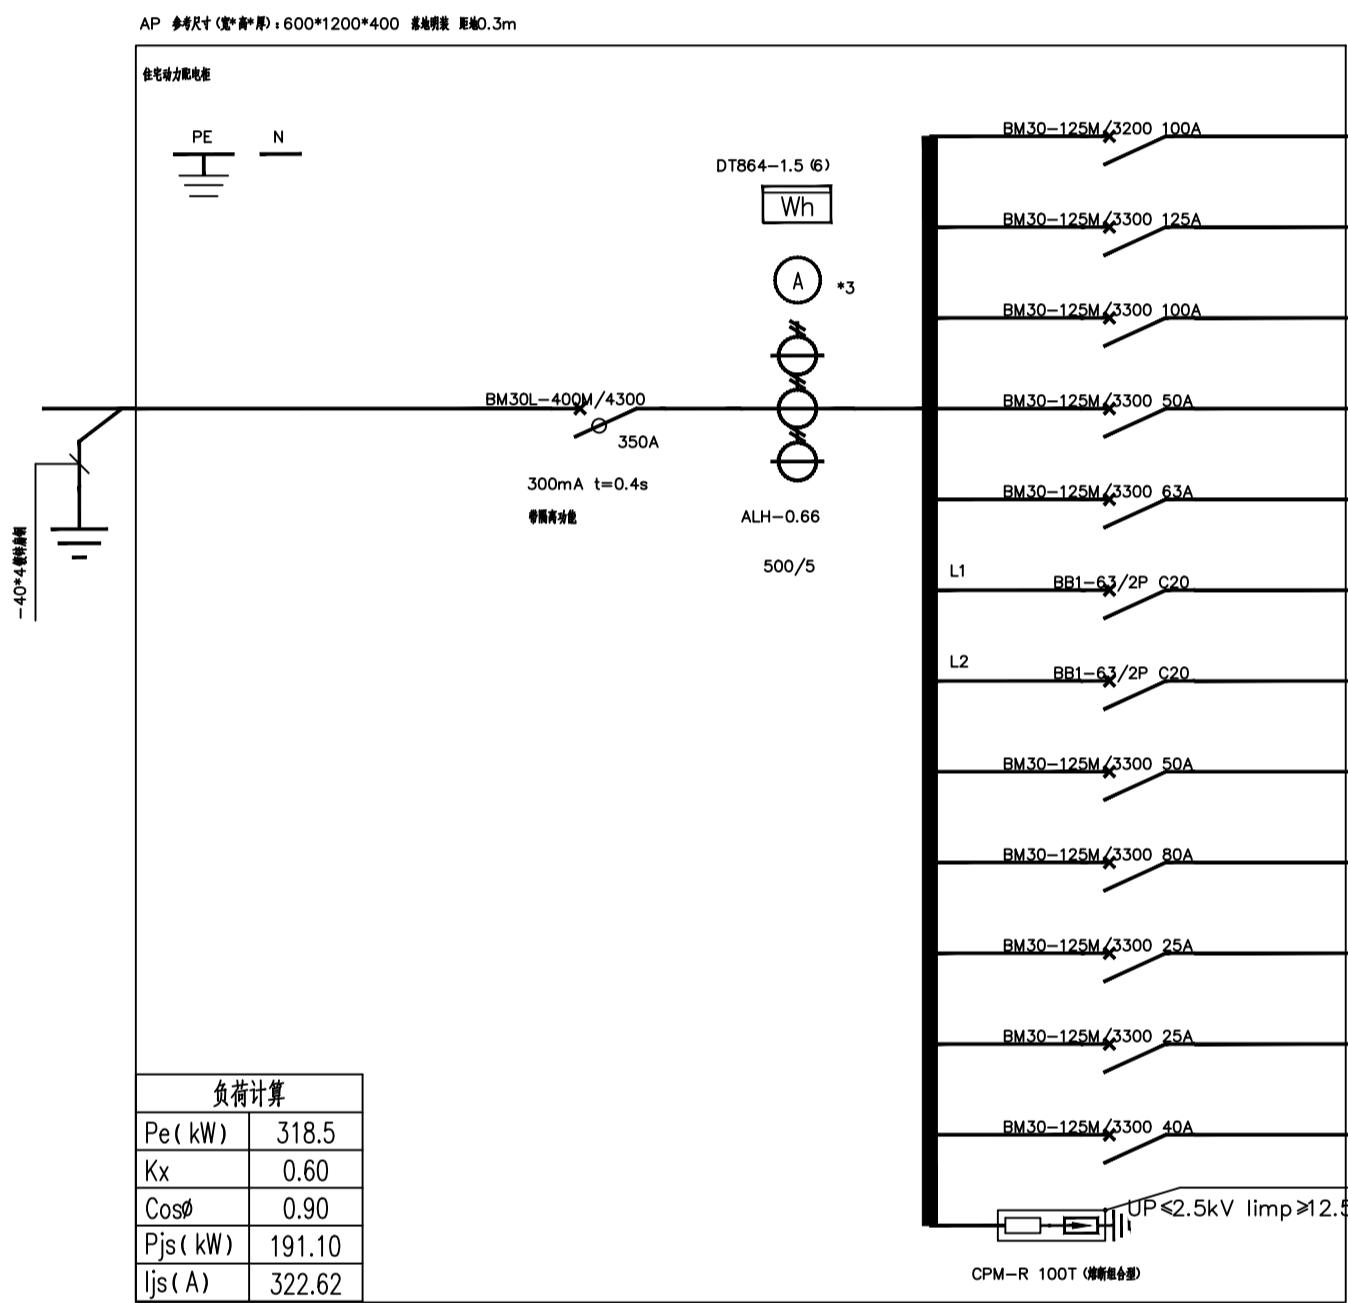



负荷计算

Pe(kW)	318.5
Kx	0.60
Cosφ	0.90
Pjs(kW)	191.10
Ijs(A)	322.62

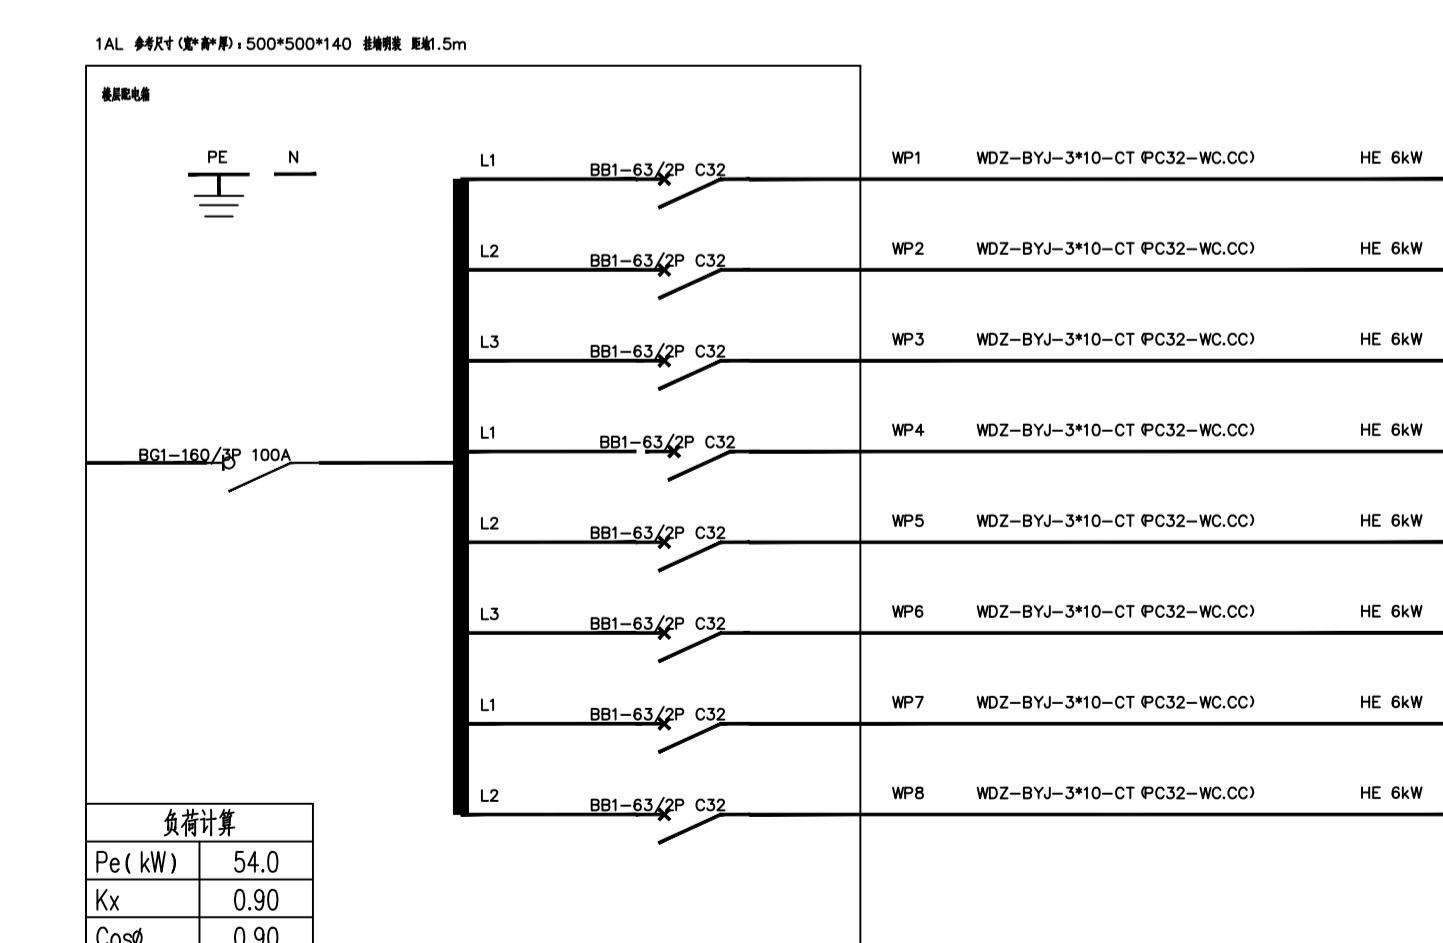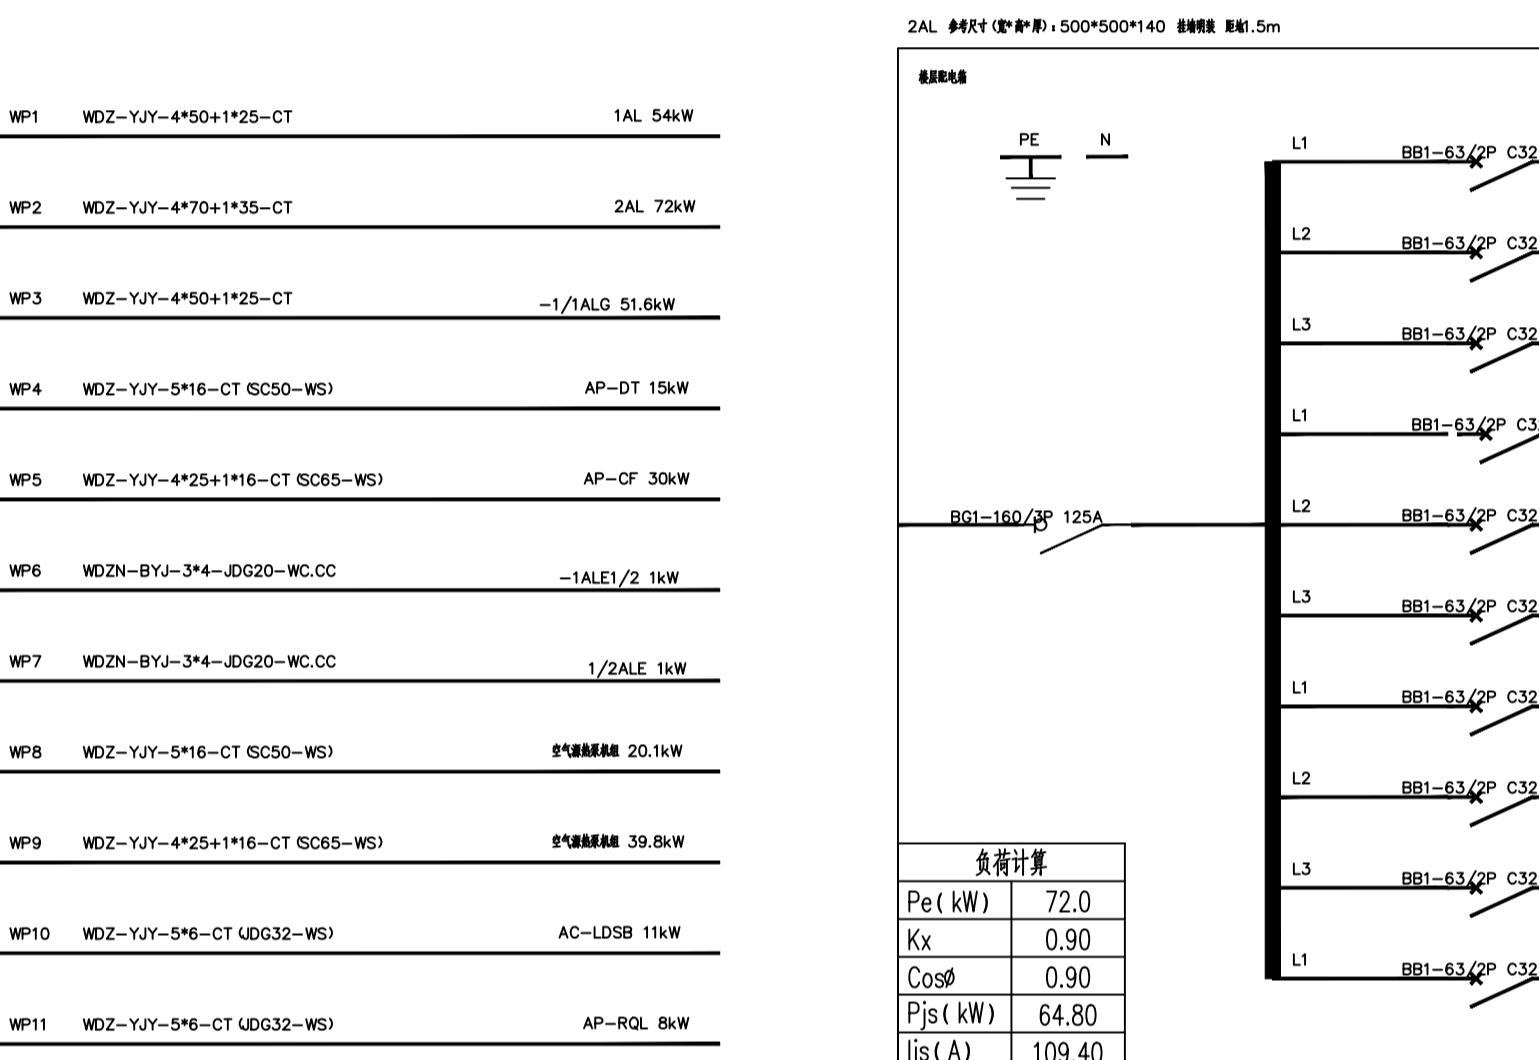


负荷计算

Pe(kW)	54.0
Kx	0.90
Cosφ	0.90
Pjs(kW)	48.60
Ijs(A)	82.05

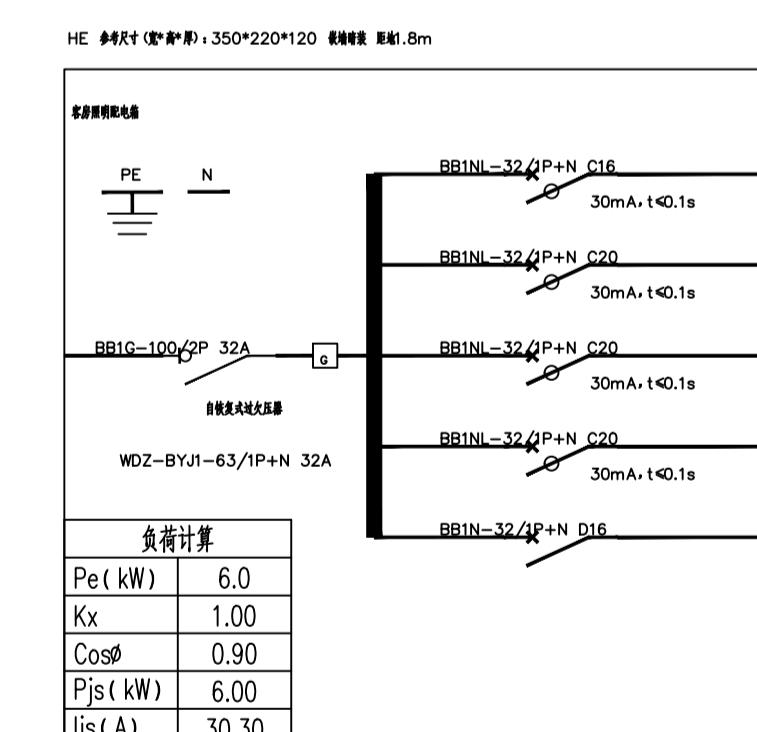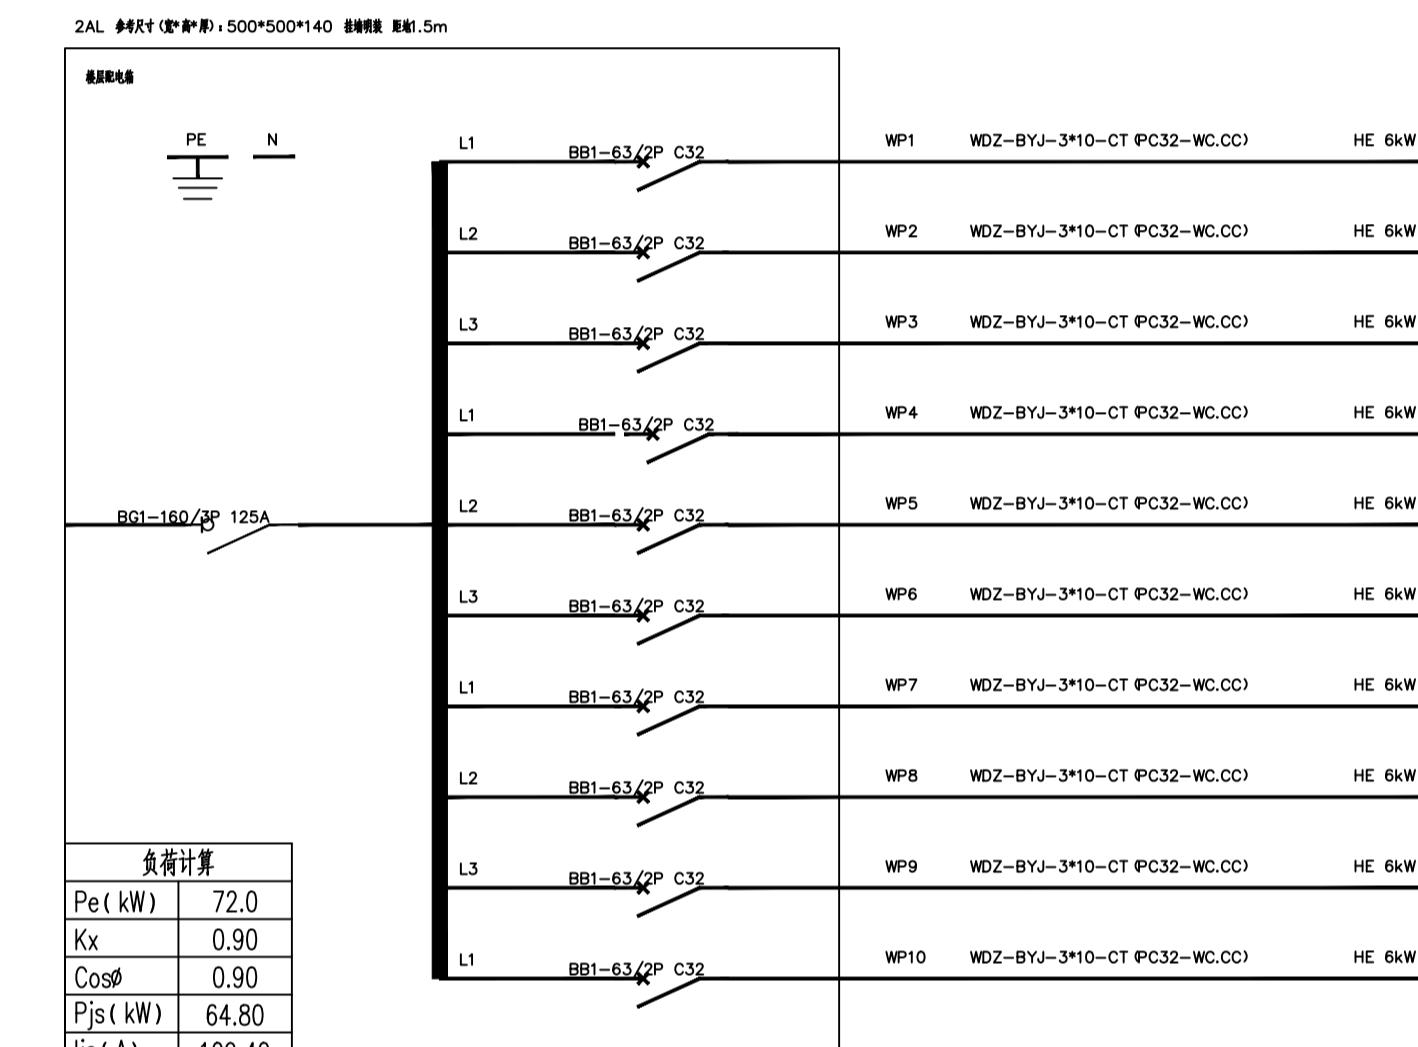

负荷计算

Pe(kW)	6.0
Kx	1.00
Cosφ	0.90
Pjs(kW)	6.00
Ijs(A)	30.30

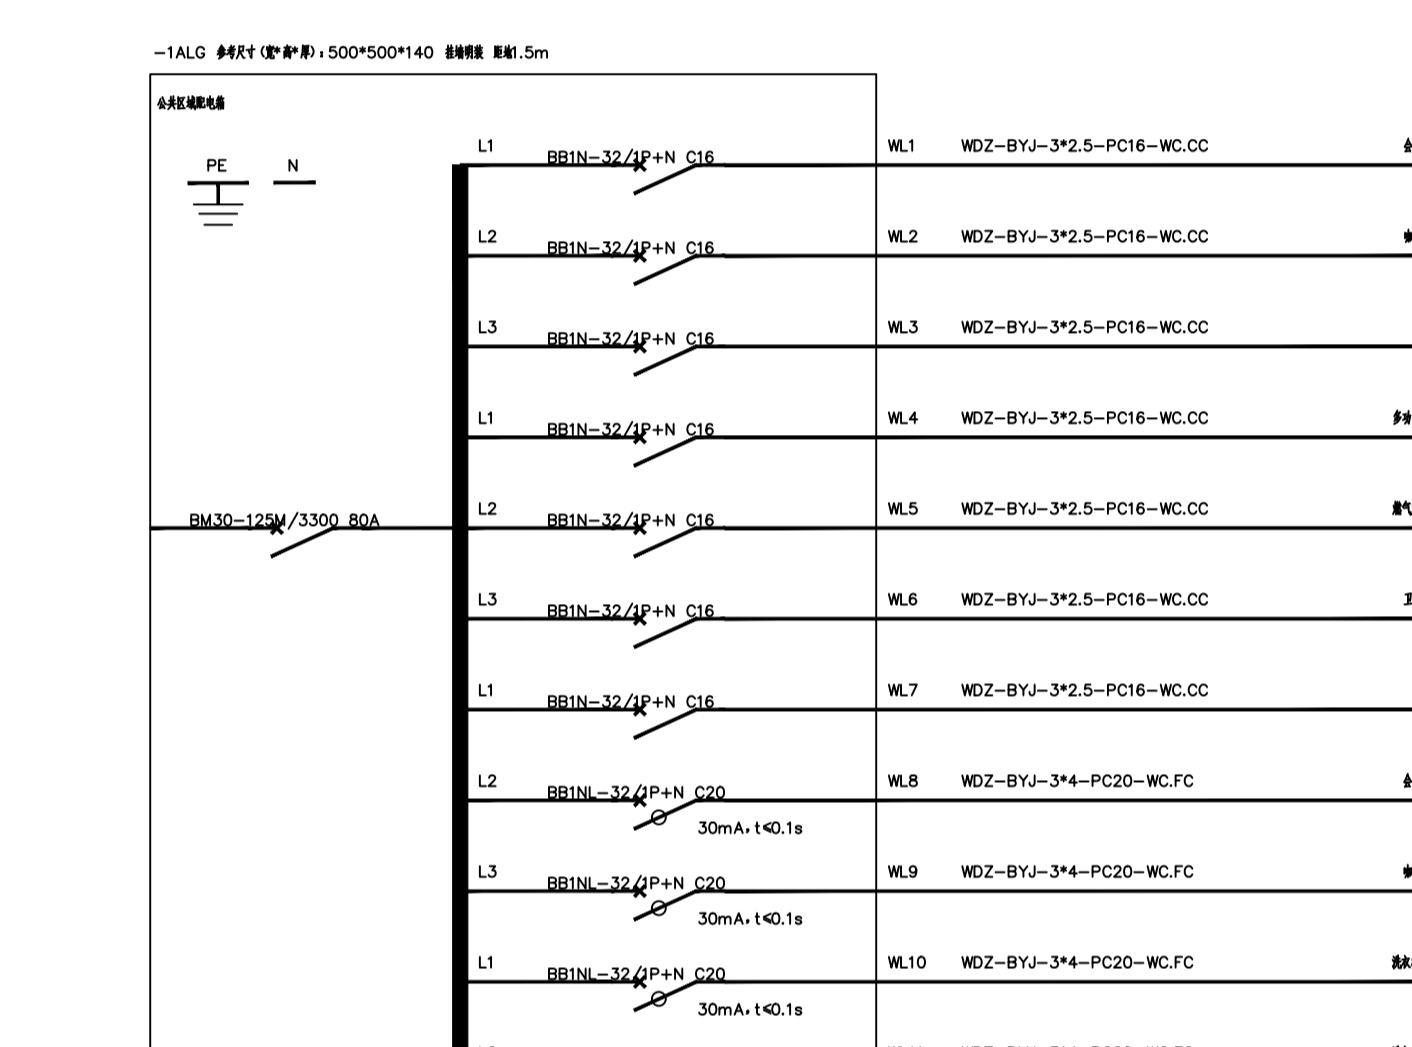

负荷计算

Pe(kW)	45.6
Kx	1.00
Cosφ	0.90
Pjs(kW)	45.60
Ijs(A)	76.98

