


三层电力平面图 1:100

19	速冻装置面	Ax=8-1450X500mm	↑	1
18	速冻装置面	Ax=8-700X500mm	↑	2
17	速冻装置面	Ax=8-1250X500mm	↑	1
16	速冻装置面	Ax=8-1000X630mm	↑	1
15	速冻装置面	Ax=8-500X240mm	↑	24
14	速冻装置面	Ax=8-1000X400mm	↑	8
13	膨大圈	Φ=320mm	↑	6
12	膨大圈	Ax=8-200X160mm	↑	1
11	膨大圈	Ax=8-530X400mm	↑	2
10	膨大圈	Ax=8-500X320mm	↑	5
9	膨大圈	Ax=8-500X400mm	↑	1
8	膨大圈	Ax=8-320X250mm	↑	2
7	膨大圈	Ax=8-500X320mm	↑	16
6	电能表箱	Ax=8-500X320mm	↑	15
5	膨胀螺栓	40.0mm 3/h-41Pa-0.04kW-1450rpm-42200	↑	1
4	天花板吸音板	N=11.0kW (额定) N=20.0kW (最大)	↑	1
3	天花板吸音板	R=26kW, Cl=26kW O=2kW	↑	4
2	膨胀螺栓	D50PMTC 热流密度70℃ 220V	↑	12
1	膨胀螺栓	800m³/h-280Pa-150W-220V	↑	1

三

图例: [ ] 预留温控器86接线盒, 距地1.3m, 至地面预留PC25配管

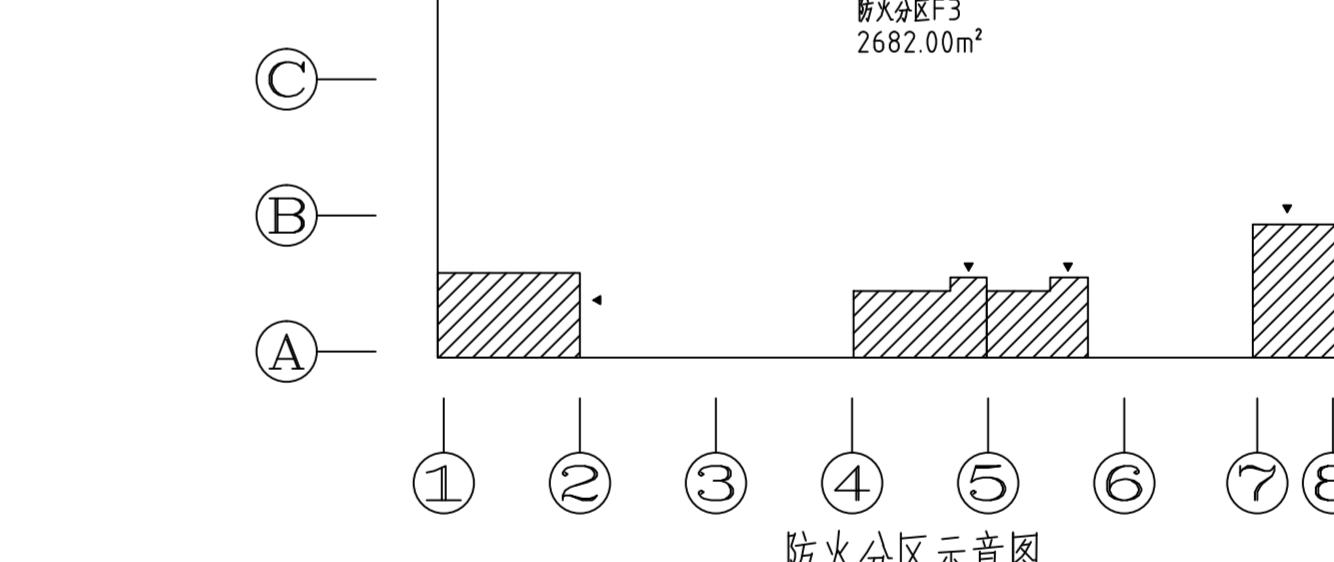

图例: [ ] 预留温控器86接线盒, 距地1.3m, 至地面预留PC25配管

图例: [ ] 预留温控器86接线盒, 距地1.3m, 至地面预留PC25配管

编 号	名 称	规 格	型 号	备 注
三楼设备表				