


XDK, 接至消防设备电源状态监控器 TW-FP3N-2V

PekW	17.0
Kx	1.00
COSφ	0.90
Pjs(kW)	17.0
Ijs(A)	28.7

详细配电线示意图

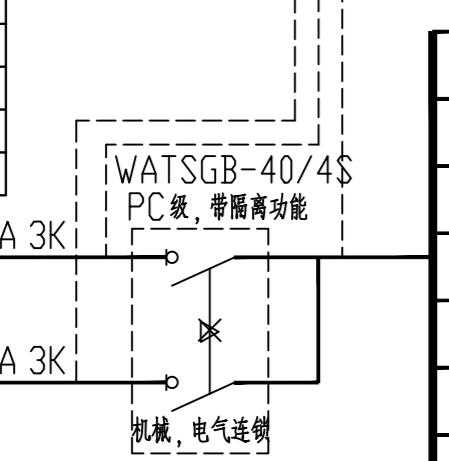


- BB1-63/3P C25 WEM1NG-A, 0.6/1KV, 5X4-CT-JDG32-WC CC 北侧3层应急照明
- BB1-63/3P C25 WEM2NG-A, 0.6/1KV, 5X4-CT-JDG32-WC CC 北侧4层应急照明
- BB1-63/3P C25 WEM3NG-A, 0.6/1KV, 5X4-CT-JDG32-WC CC 北侧3层应急照明
- BB1-63/3P C25 WEM4NG-A, 0.6/1KV, 5X4-CT-JDG32-WC CC 北侧4层应急照明
- L1 BB1N-32/1P+N C16 WEM5WDZN-BYJ-3X2.5-JDG20-WC CC 防火门监控电源
- L2 BB1N-32/1P+N C16 WEM6WDZN-BYJ-3X2.5-JDG20-WC CC 北侧强电井照明
- L3 BB1N-32/1P+N C16 WEM7WDZN-BYJ-3X2.5-JDG20-WC CC 北侧弱电井照明
- L1 BB1N-32/1P+N C16 WEM8WDZN-BYJ-3X2.5-JDG20-WC CC 南侧强电井照明
- L2 BB1N-32/1P+N C16 WEM9WDZN-BYJ-3X2.5-JDG20-WC CC 南侧弱电井照明
- L3 BB1N-32/1P+N C16 WEM10WDZN-BYJ-3X2.5-JDG20-WC CC 强电间照明
- L1 BB1N-32/1P+N C16 WEM11WDZN-BYJ-3X2.5-JDG20-WC CC 弱电间照明
- L2 BB1N-32/1P+N C16 WEM12WDZN-BYJ-3X2.5-JDG20-WC CC 北侧广播功率放大器电源
- L3 BB1N-32/1P+N C16 WEM13WDZN-BYJ-3X2.5-JDG20-WC CC 南侧广播功率放大器电源
- L1 BB1N-32/1P+N C16 WEM14: 预留
- L2 BB1N-32/1P+N C16 WEM15: 预留
- L3 BB1N-32/1P+N C16 WEM16: 预留

PE N
600X800X200
明装, 下皮距地1.5米


详细配电线示意图
共2个

1ATE1,2箱系统图

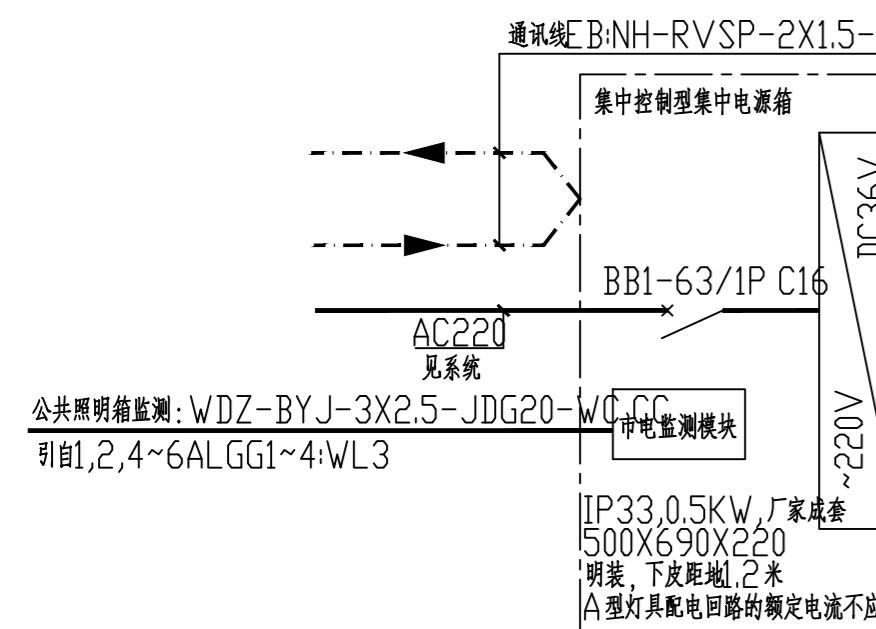


1ALE1,3,4,2,4~6ALE1~4箱系统图

共19个

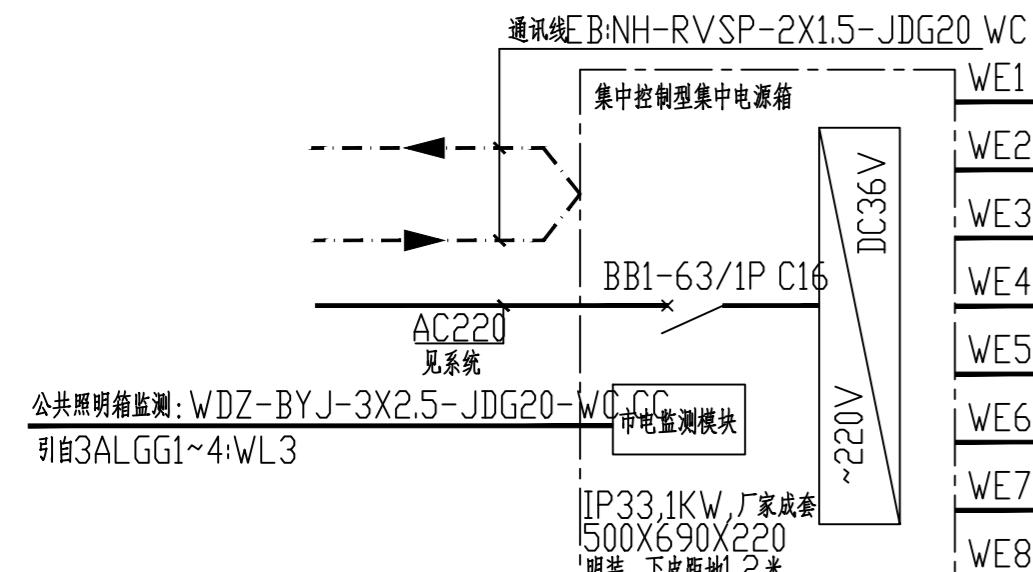

3ALE1~4箱系统图
共4个


通讯线 B:NH-RVSP-2X1.5-JDG20 WC CC

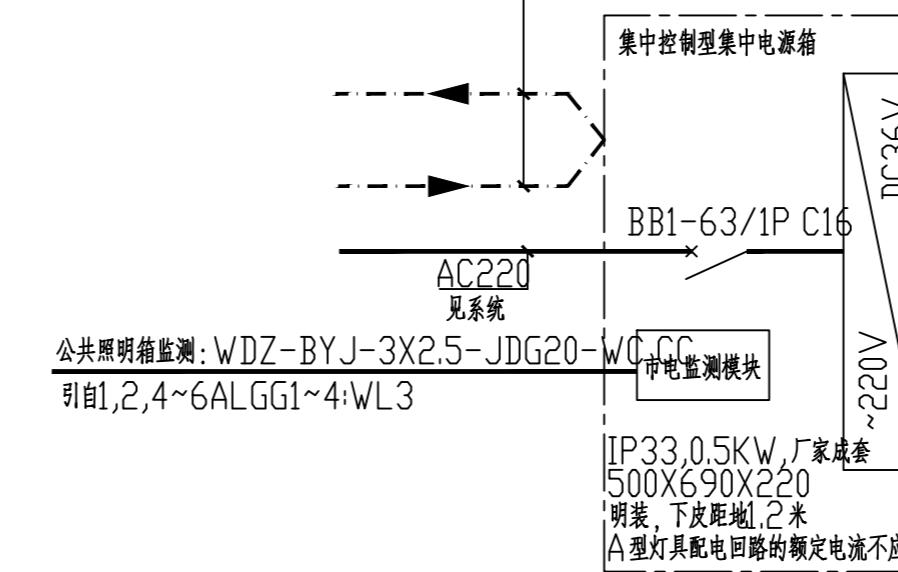

- WE1: WDZN-BYJ-2x2.5-JDG20-WC CC 应急照明
- WE2: WDZN-BYJ-2x2.5-JDG20-WC CC 应急照明
- WE3: 预留
- WE4: 预留


1ALE2箱系统图
共1个

PekW	37.0
Kx	1.00
COSφ	0.90
Pjs(kW)	37.0
Ijs(A)	62.5

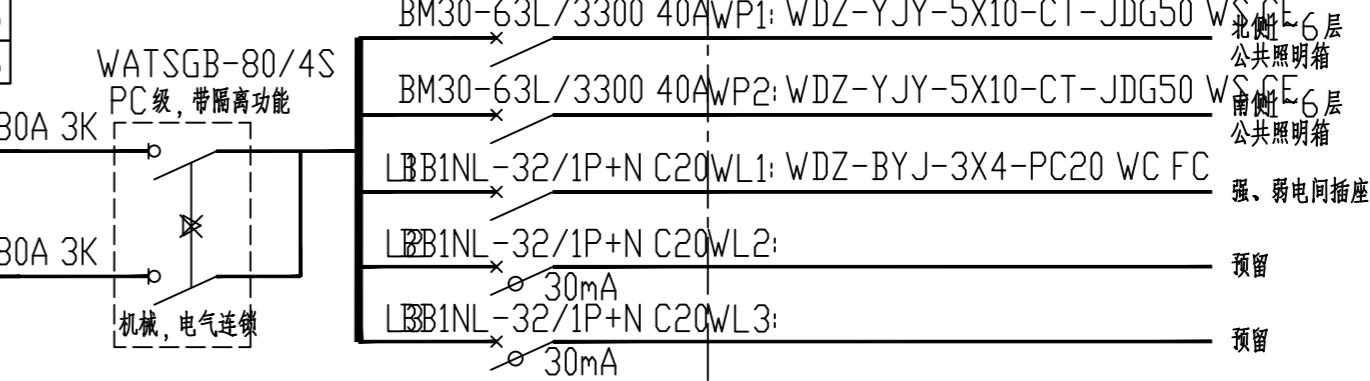


1AT-GG1,2箱系统图
共2个

PekW	3.0
Kx	1.00
COSφ	0.80
Pjs(kW)	3.0
Ijs(A)	5.7

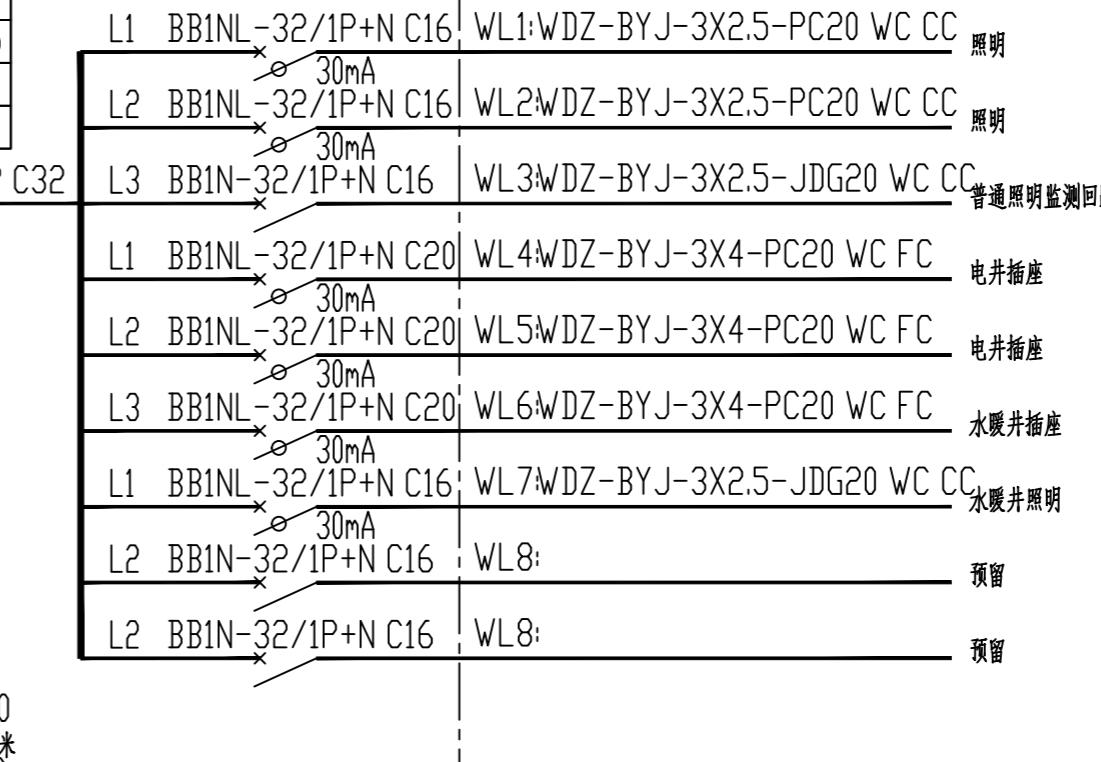

1ALGG1~4箱系统图
共4个

PekW	3.0
Kx	1.00
COSφ	0.80
Pjs(kW)	3.0
Ijs(A)	5.7

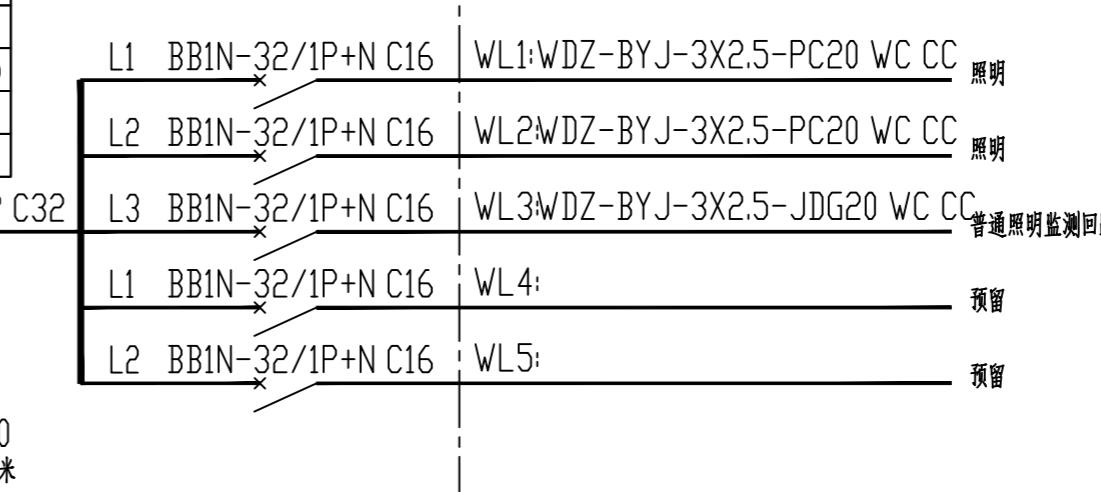

2~6ALGG1~4箱系统图
共20个