




强电竖向系统图

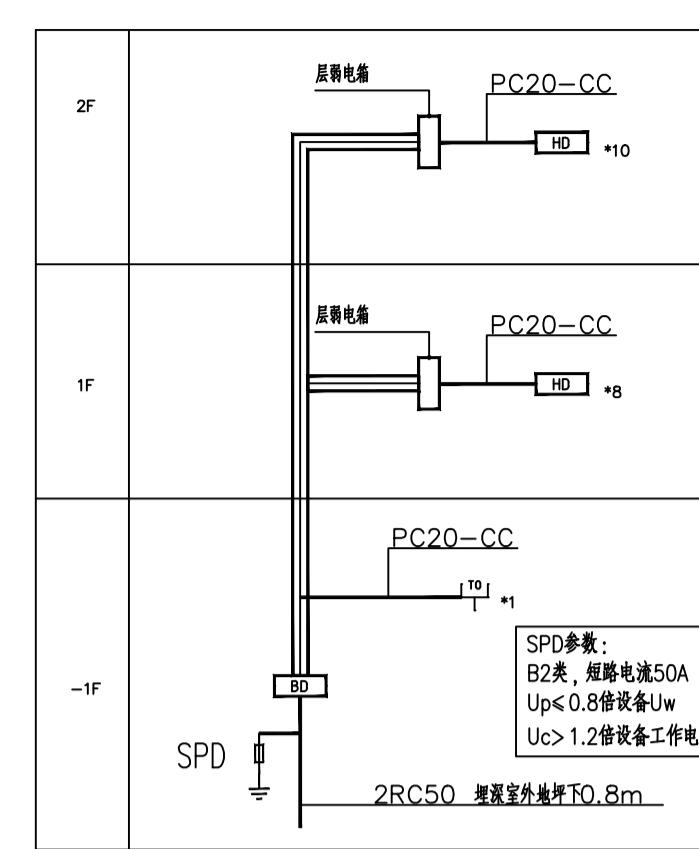


网络电话竖向系统图

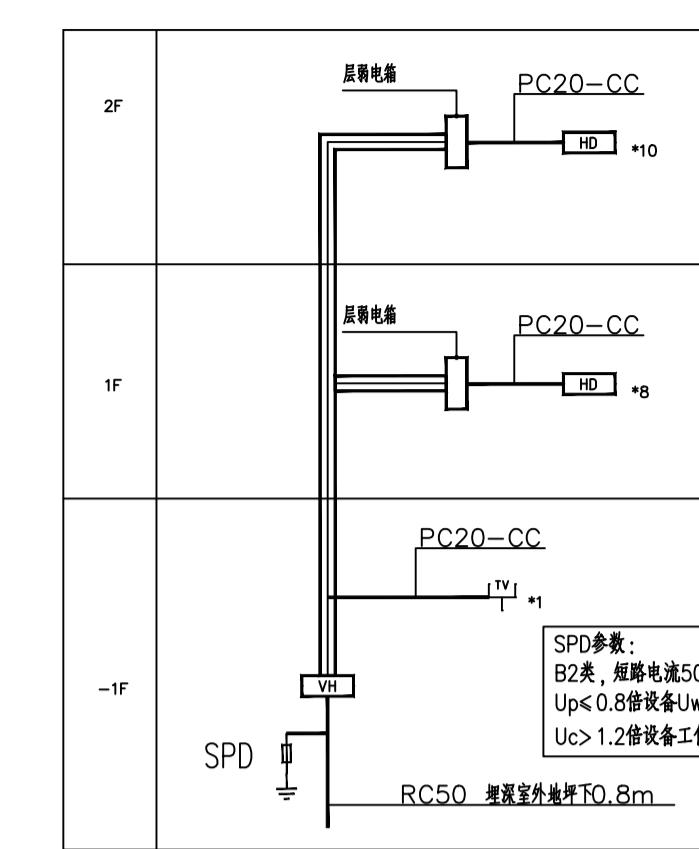


有线电视竖向系统图

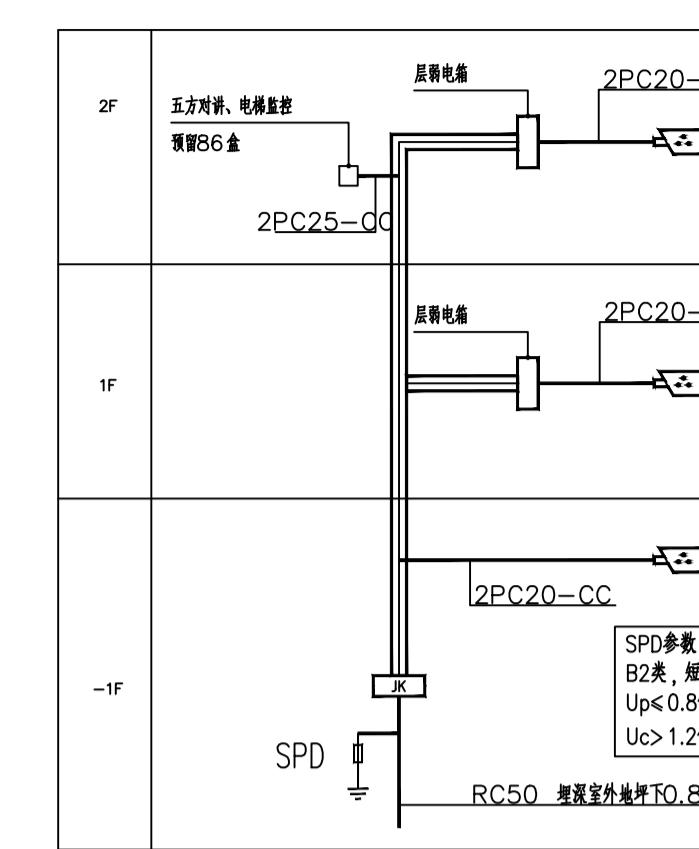


安防监控竖向系统图

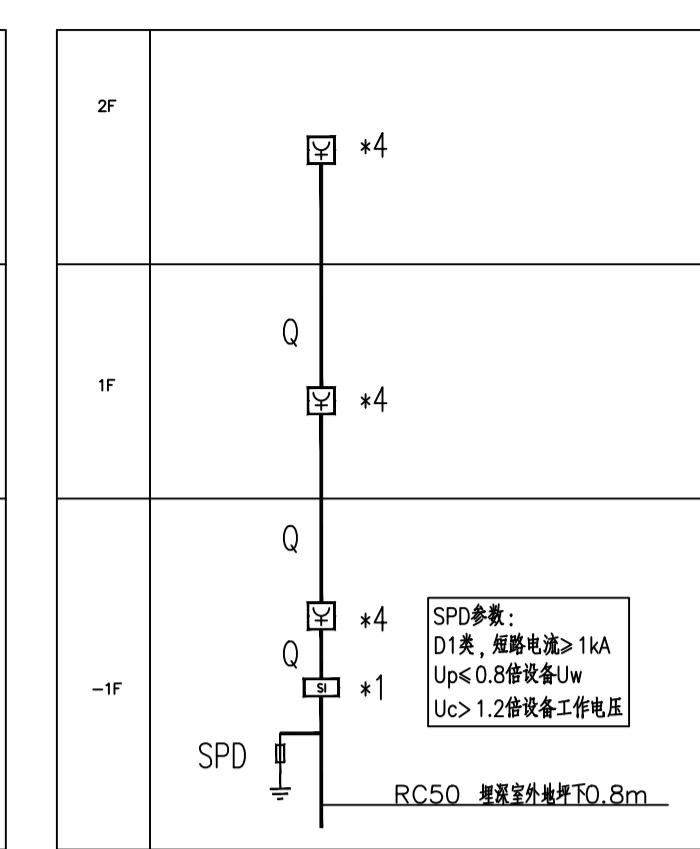

消防竖向系统图

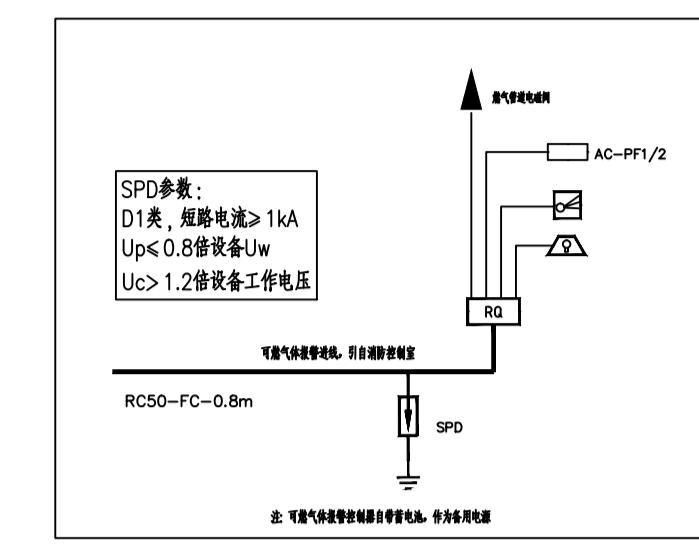


可燃气体报警控制系统图

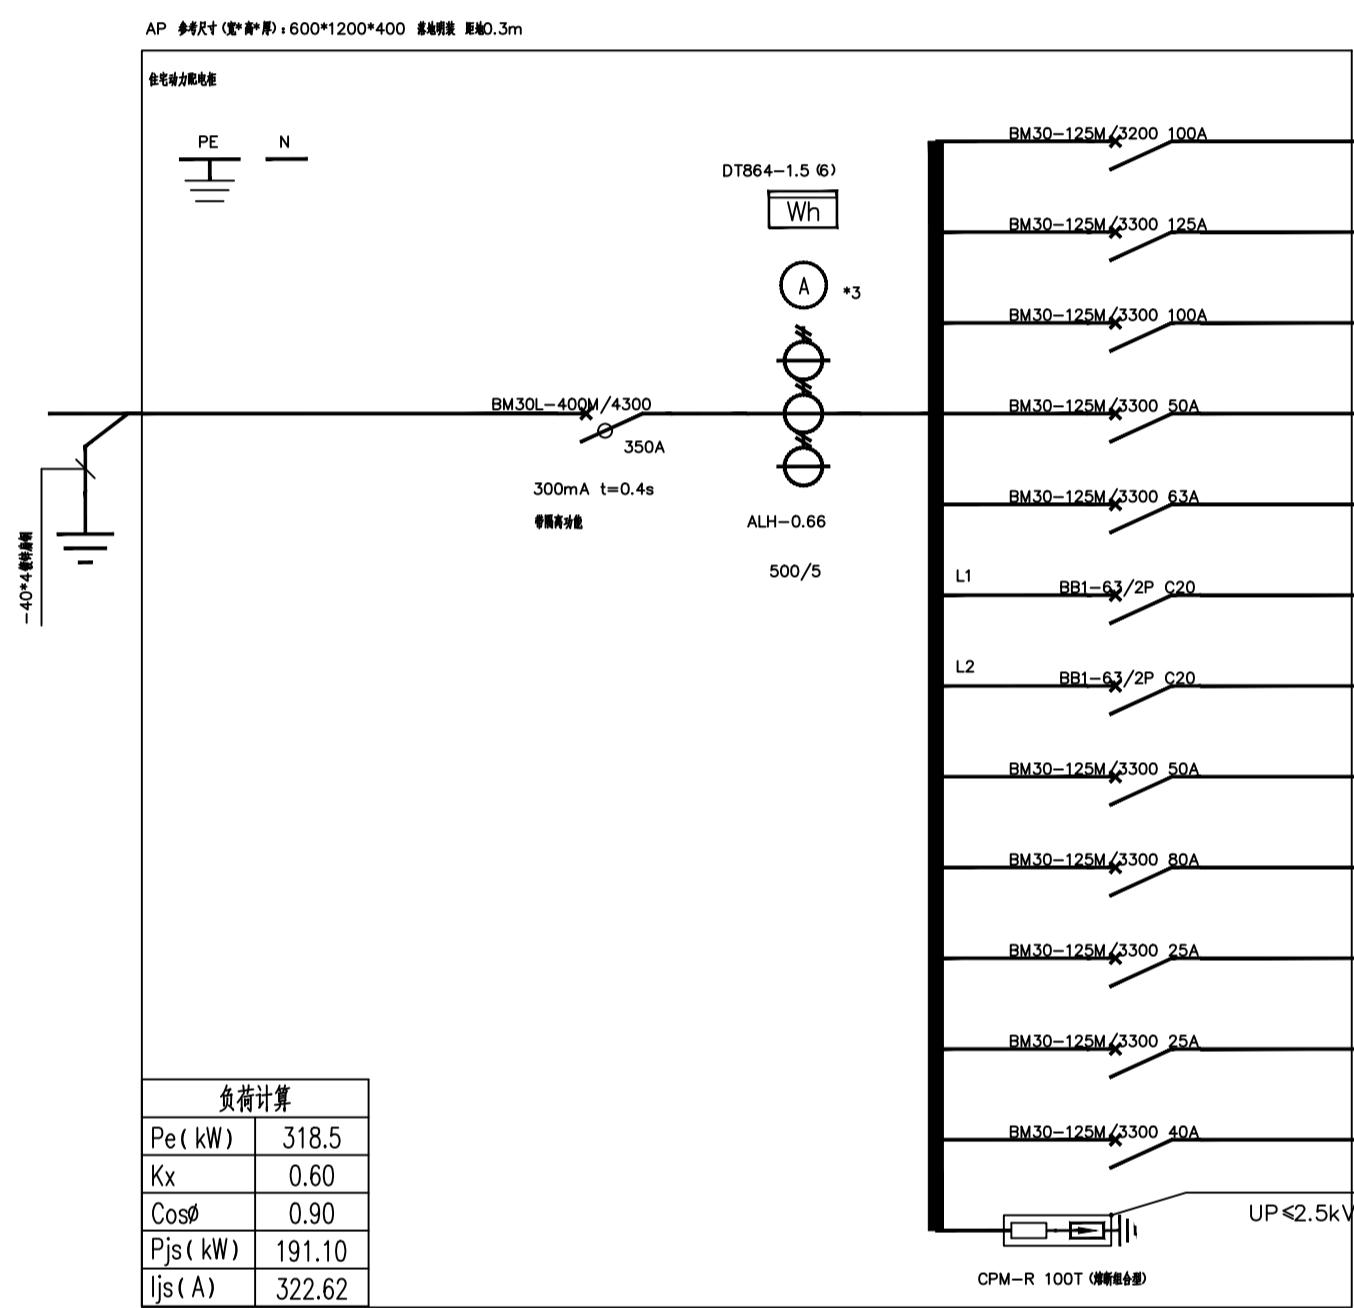


负荷计算

Pe(kW)	318.5
Kx	0.60
Cosφ	0.90
Pjs(kW)	191.10
Ijs(A)	322.62

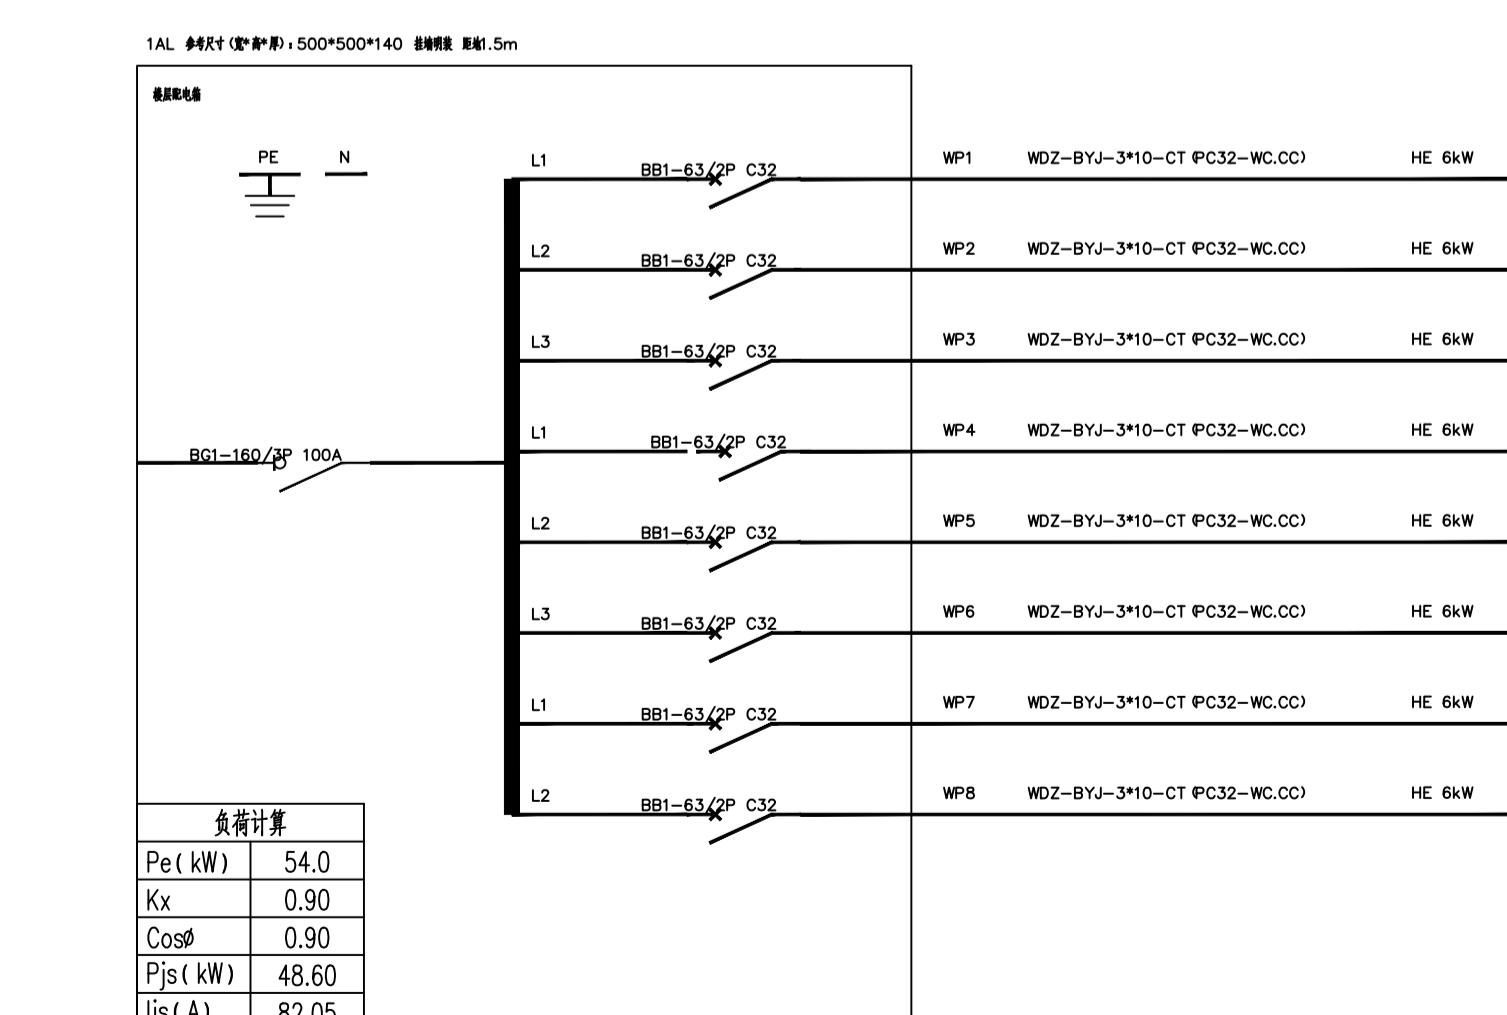


负荷计算

Pe(kW)	54.0
Kx	0.90
Cosφ	0.90
Pjs(kW)	48.60
Ijs(A)	82.05

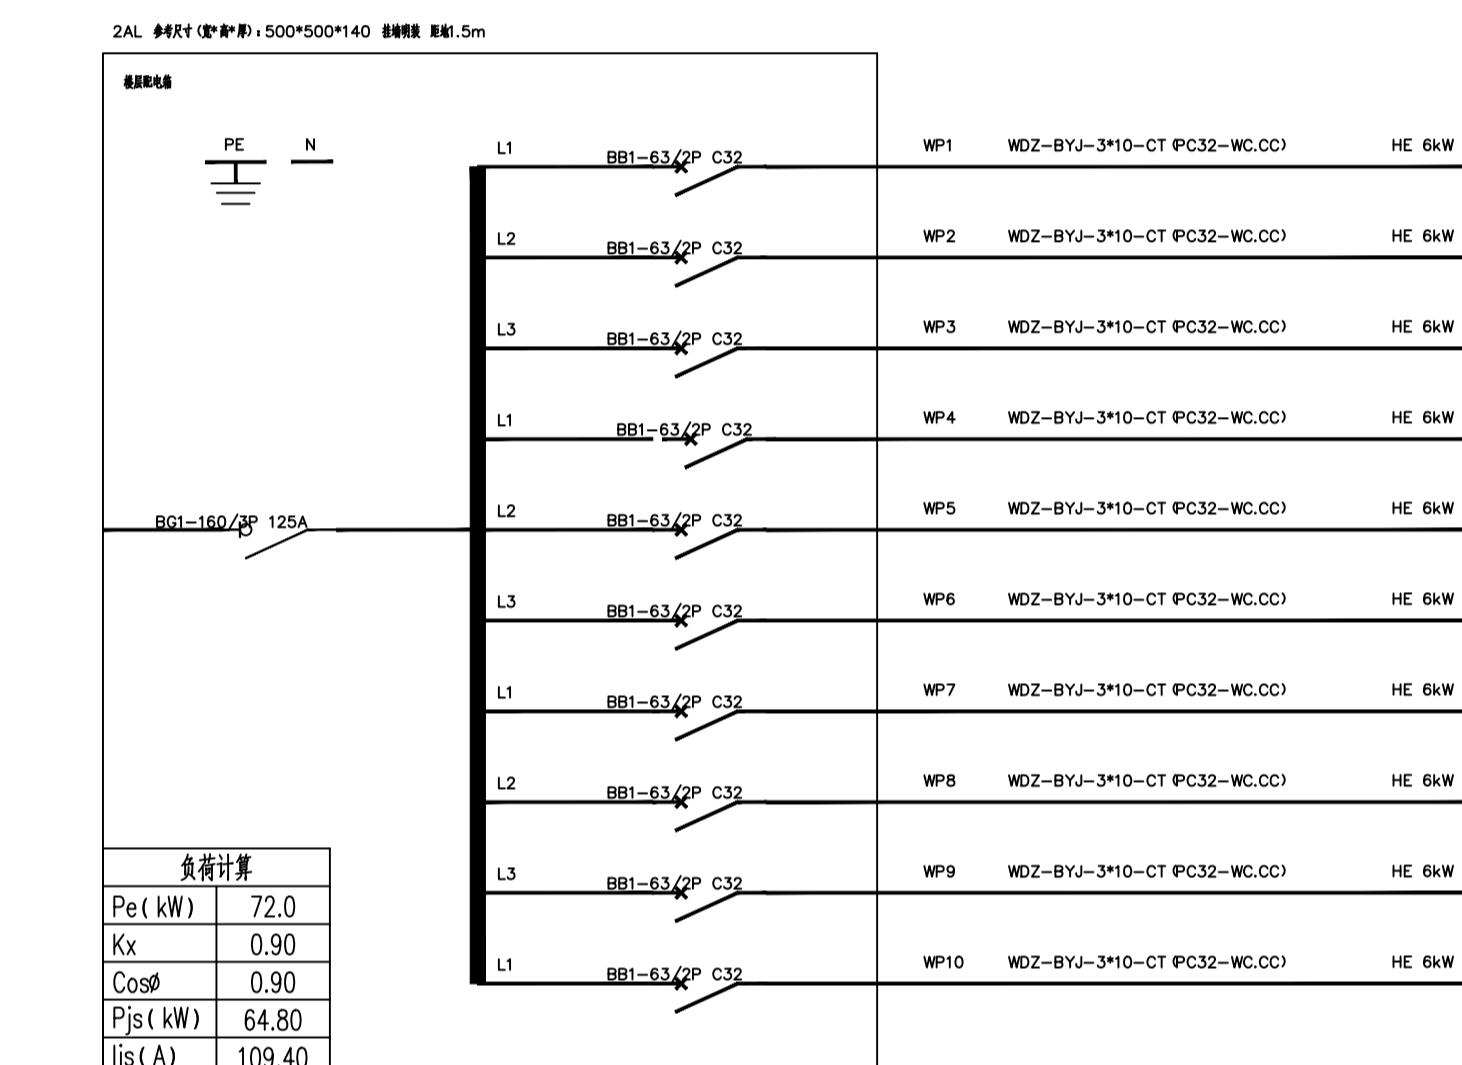


负荷计算

Pe(kW)	72.0
Kx	0.90
Cosφ	0.90
Pjs(kW)	64.80
Ijs(A)	109.40

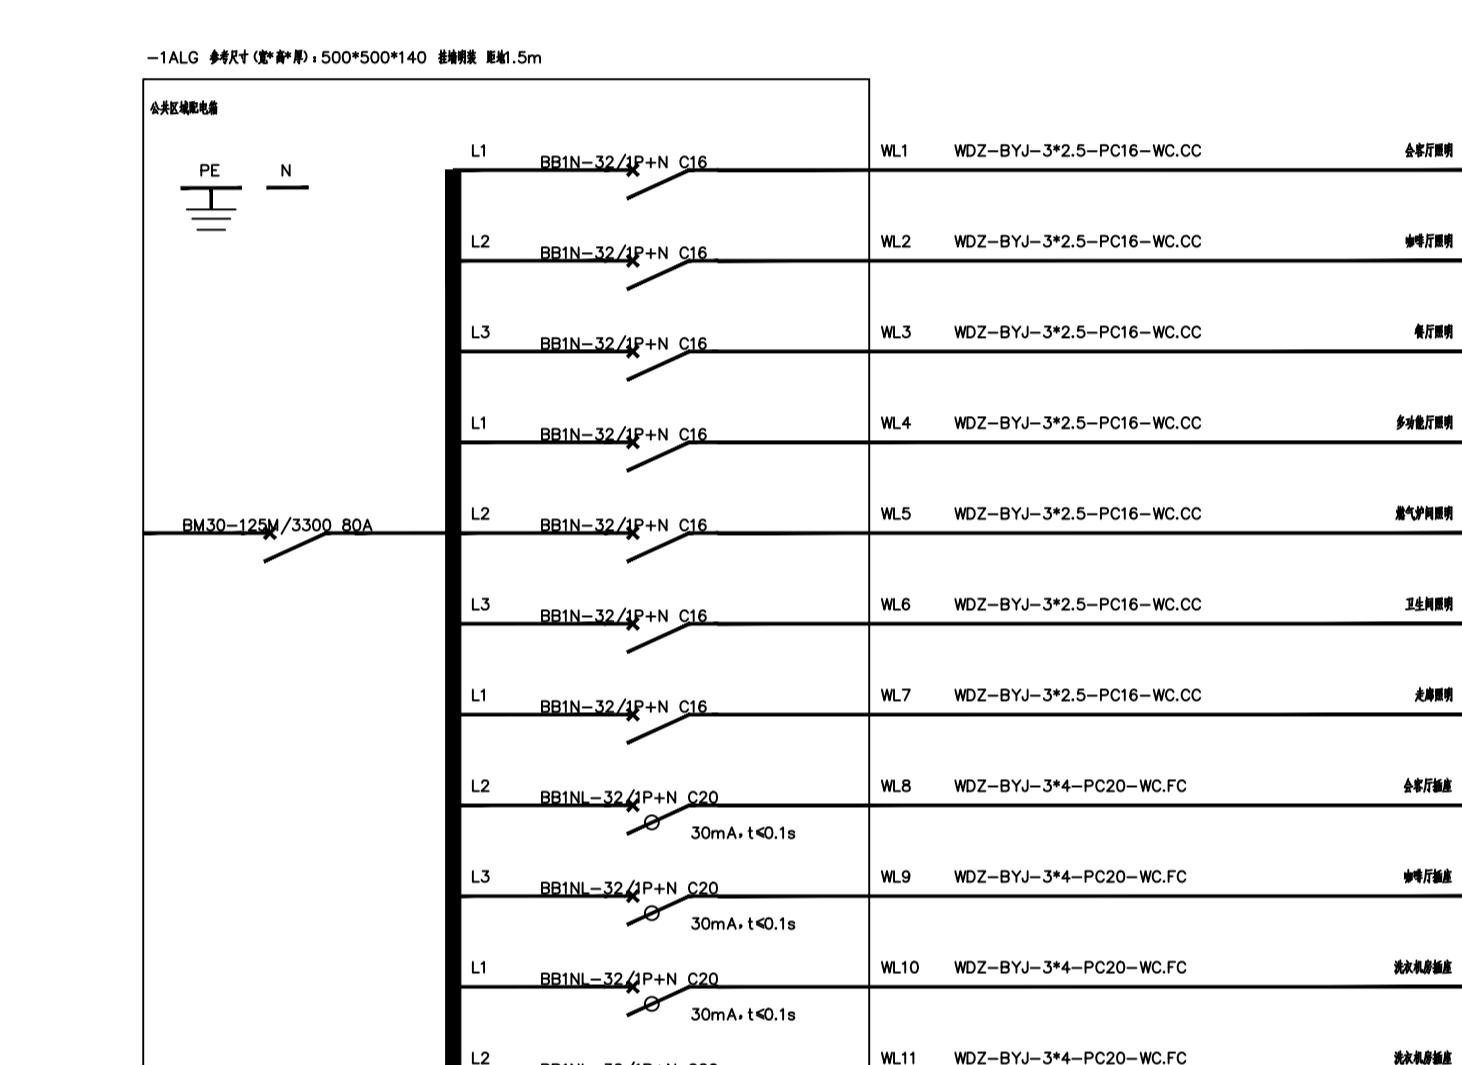


负荷计算

Pe(kW)	72.0
Kx	0.90
Cosφ	0.90
Pjs(kW)	64.80
Ijs(A)	109.40

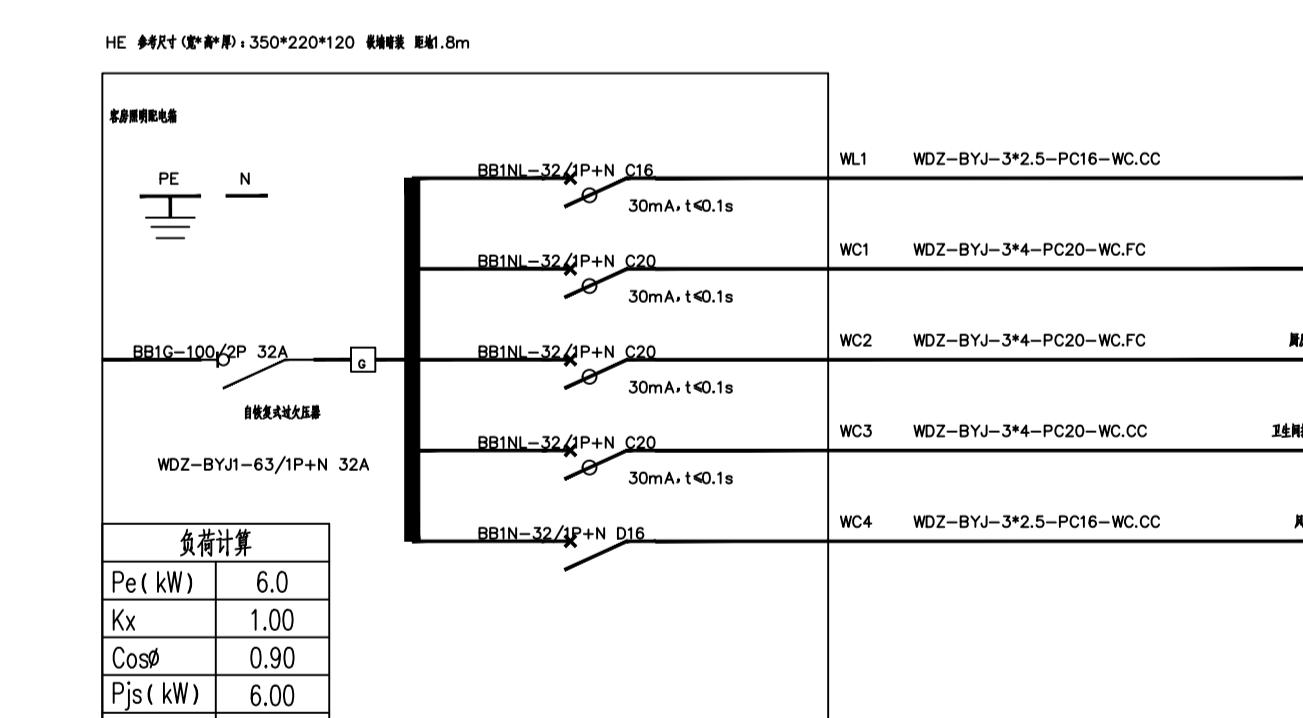


负荷计算

Pe(kW)	6.0
Kx	1.00
Cosφ	0.90
Pjs(kW)	6.00
Ijs(A)	30.30

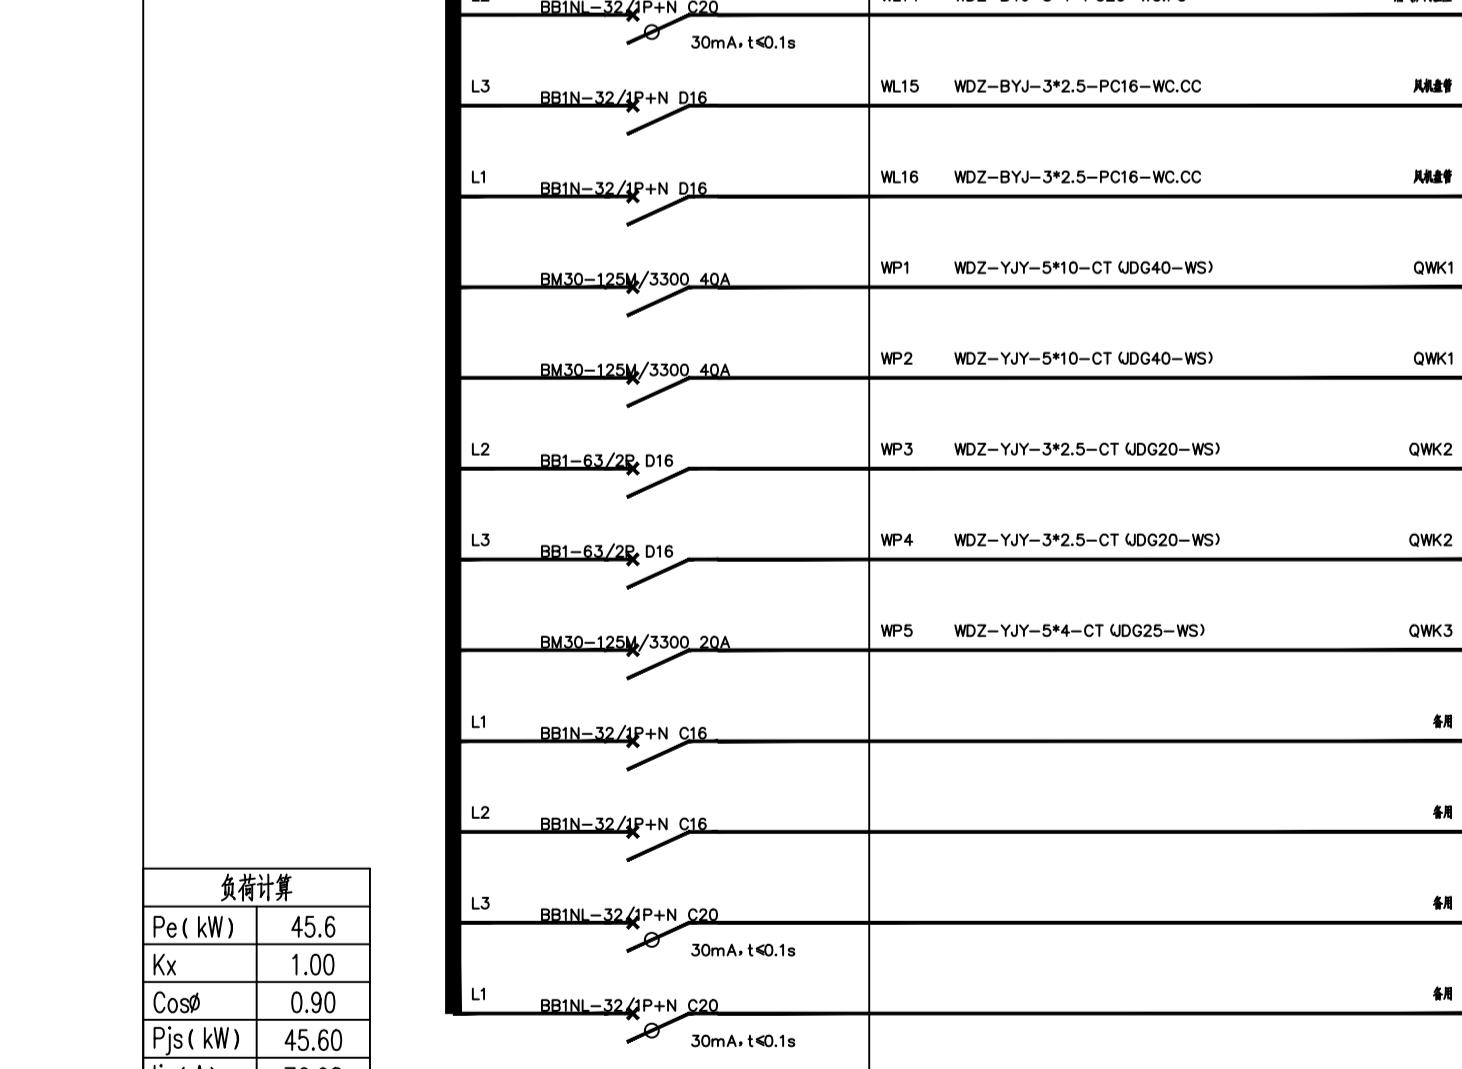

负荷计算

Pe(kW)	45.6
Kx	1.00
Cosφ	0.90
Pjs(kW)	45.60
Ijs(A)	76.98

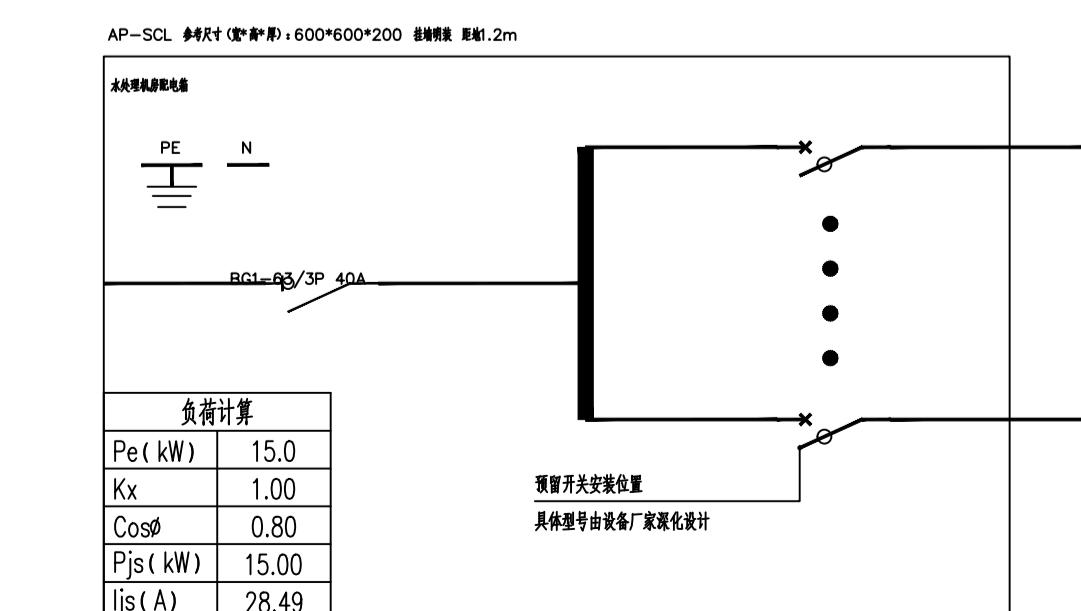

负荷计算

Pe(kW)	15.0
Kx	1.00
Cosφ	0.80
Pjs(kW)	15.00
Ijs(A)	28.49