

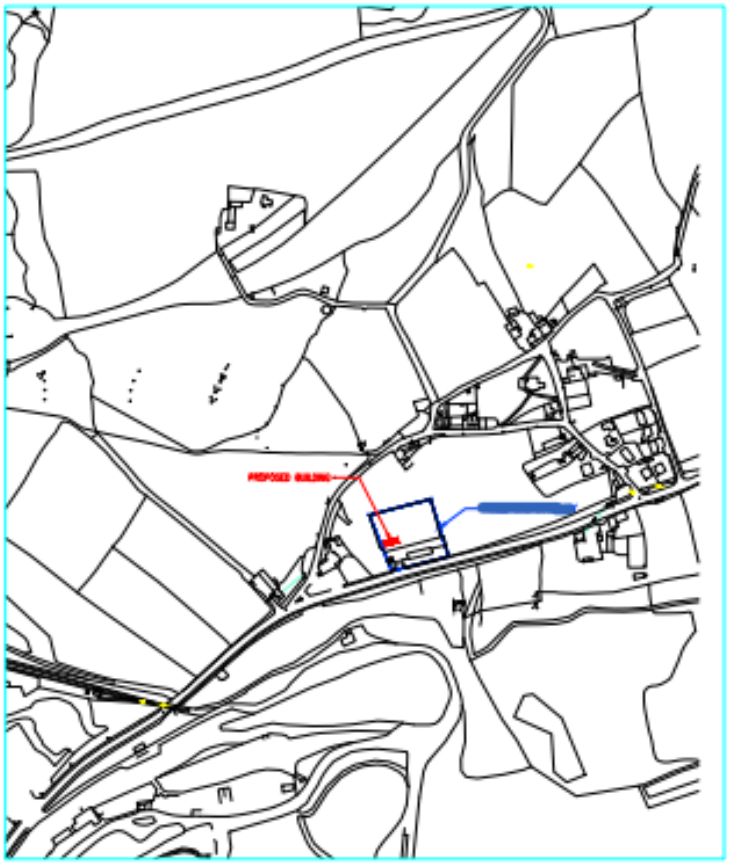


LOCATION PLAN
SCALE 1:2500


[redacted]

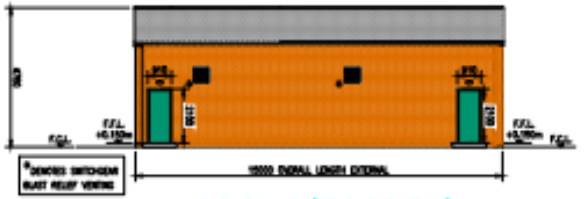

ELEVATION B (REAR ELEVATION)
SCALE 1:100




ELEVATION C (SIDE ELEVATION)
SCALE 1:100

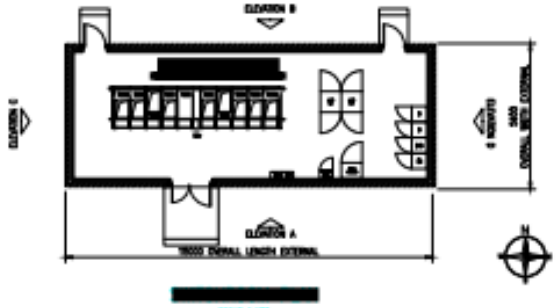

SCALE 1:100



ELEVATION D (SIDE ELEVATION)
SCALE 1:100

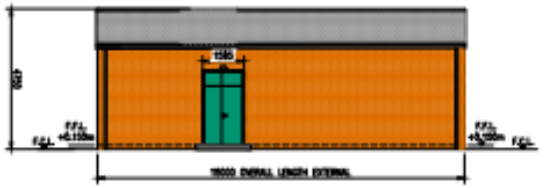

ELEVATION A (FRONT ELEVATION)
SCALE 1:100

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE STATED.
2. OVERALL WALL THICKNESS TO BE 352.5mm WITH 50mm CLEAR CAVITY.
3. EXTERNAL CAVITY WALL OUTER SKIN :- BRICKWORK ABOVE & BELOW DPC LEVEL TO BE FACING BRICK TO MATCH EXISTING SSE BUILDINGS. SAMPLES TO BE PROVIDED TO LOCAL PLANNING AUTHORITY TO WHERE APPLICABLE.
4. EXTERNAL CAVITY WALL INNER SKIN :- LIGHT COLOUR, FAIR FACE, CONCRETE BLOCKS TO BE USED TO CLOSE CAVITY AT ALL OPENINGS.
5. DOOR FRAMES TO BE FORMED FROM 1.6mm ZINC COATED STEEL SHEET WITH STANDARD DOUBLE REBATE FRAME DRIP BAR TO BE FITTED TO THE HEAD OF FRAME.
6. ALL DOORS TO BE PROVIDED WITH A SECURITY STRIP AT LEADING EDGE OF DOORS.
7. ALL DOORS TO BE POLYESTER POWDER COATED. COLOUR 14C39 GREEN TO BS4800.
8. ALL DOORS TO BE 45mm THICK, DOUBLE SKIN LEAVES FORMED FROM 1.2mm ZINC COATED STEEL WITH RESIN IMPREGNATED LAMINATED CORE MATERIAL.
9. FLOORS TO BE REINFORCED CONCRETE POWER FLOAT FINISH DESIGNED TO WITHSTAND THE WEIGHT OF SWITCHGEAR TO BE INSTALLED.
10. ROOF TO BE TILED PITCHED ROOF CONSTRUCTION.
11. EXTERNAL BUILDING LOCALISED LIGHTING FOR PERSONNEL ACCESS LOCATED OVER DOORS. LIGHTS TO BE BULKHEAD LUMINAIRES, IP65 WITH POLYCARBONATE DIFFUSERS TO BE CONTROLLED BY A SEPARATE PHOTO ELECTRIC CELL AND PASSIVE INFRARED DETECTORS INCORPORATING AN ADJUSTABLE OVER RUN TIMER.