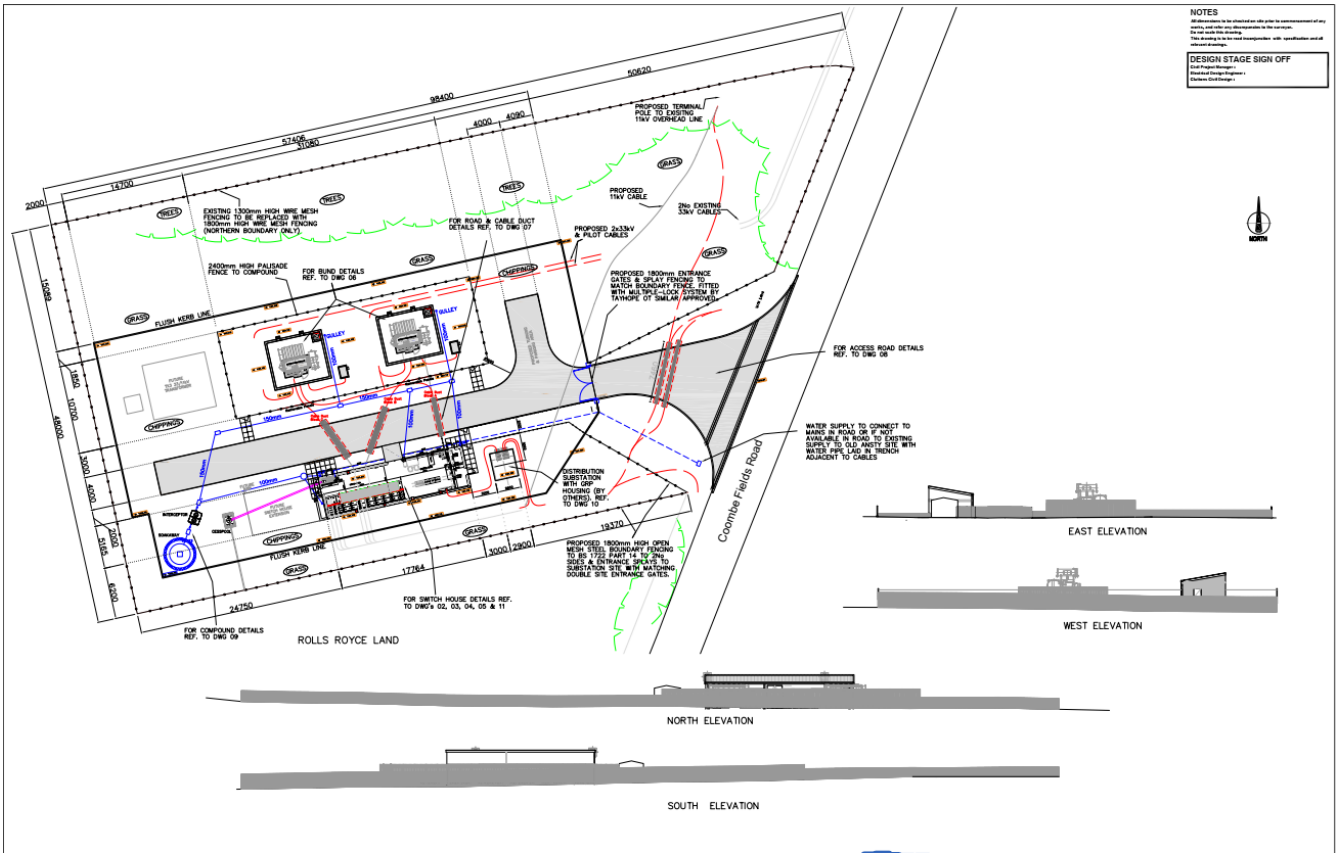

NOTES
DESIGN STAGE SIGN OFF
PROPOSED TERMINAL POLE TO EXISTING 11kV OVERHEAD LINE
PROPOSED 11kV CABLE
2No EXISTING 33kV CABLES
EXISTING 1300mm HIGH WIRE MESH FENCING TO BE REPLACED WITH 1800mm HIGH WIRE MESH FENCING (NORTHERN BOUNDARY ONLY)
FOR ROAD & CABLE DUCT DETAILS REF. TO DWG 07
PROPOSED 2x33kV & PILOT CABLES
2400mm HIGH PALISADE FENCE TO COMPOUND
FOR BUND DETAILS REF. TO DWG 06
PROPOSED 1800mm ENTRANCE GATES & SPLAY FENCING TO MATCH BOUNDARY FENCE, FITTED WITH MG TRIPLE-LOCK SYSTEM BY TATHOPE OT SIMILAR APPROVED
FOR ACCESS ROAD DETAILS REF. TO DWG 08
WATER SUPPLY TO CONNECT TO MAINS IN ROAD OR IF NOT AVAILABLE, TO CONNECT TO EXISTING SUPPLY ON COLD ARCH SITE WITH WATER PIPE LAID IN TRENCH ADJACENT TO CABLES
DISTRIBUTION SUBSTATION WITH GRP HOUSING (BY OTHERS). REF. TO DWG 10
PROPOSED 1800mm HIGH OPEN MESH STEEL BOUNDARY FENCING TO BS 1722 PART 14. TO 2No SIDES & ENTRANCE GATES TO SUBSTATION SITE WITH MATCHING DOUBLE SITE ENTRANCE GATES.
FOR SWITCH HOUSE DETAILS REF. TO DWG's 02, 03, 04, 05 & 11
FOR COMPOUND DETAILS REF. TO DWG 09
ROLLS ROYCE LAND
Coombe Fields Road
EAST ELEVATION
WEST ELEVATION
NORTH ELEVATION
SOUTH ELEVATION