


Home Control Lighting and Switching Assignments and Wattages
Beginning at Front moving through Foyer, Master suite, Bedrooms,
playroom, great room, to dining and kitchen mud room and garage

L-101 Dim 240 watts
L-102 Dim 50 watts
L-103 Dim 80 watts
L-104 Dim 100 watts
L-105 Dim 160 watts
L-106 Dim 255 watts
L-107 Dim 120 watts
L-108 Dim 140 Watts
L-109 Dim 40 watts
S-110 switch Evac fan
L-111 Dim 62 watts
L-112 Dim 200 watts LED 24V
L-113 Dim 600 Watts switched outlet.
L-114 Dim 300 watts
FS-115 Fan speed
L-116 Dim 320 watts
L-117 Dim 100 Watts
L-118 Dim 160 watts
L-119 Dim 264 watts
L-120 Dim 100 watts
L-121 Dim 12 watts
S-122 Evac fan
L-123 Dim 100 watts
L-124 Dim 180 watts
L-125 Dim 160 watts
L-126 Dim 180 watts
S-127 Switch 450 watts CFL lamps
L-129 Dim 24 watts
L-130 Dim 600 watts
L-131 Dim 600 Watts outlet
L-132 Dim 600 Watts outlet
L-133 Dim 240 watts
L-134 Dim 600 Watts outlet
L-135 Dim 150 watts
FS-136 Fan speed
L-137 Dim 240 watts
L-138 Dim 36 watts
L-139 Dim 240 watts
L-140 Dim 12 watts
S-141 Evac fan
L-142 Dim 36 Watts
L-143 Dim 240 watts
S-144 Evac fan
L-145 Dim 12 watts
L-146 Dim 160 watts
FS-147 Fan speed
L-148 Dim 100 Watts

L-149 Dim 600 watts outlet
S-150 switch 110 watts CFL bulbs
L-151 Dim 750 watts
L-152 dim 500 watts
L-153 dim 80 watts
FS-153a Fan speed
L-154 dim 320 watts
L-155 Dim 300 Watts
L-156 Dim 600 watts
L-157 Dim 600 watts
L-158 Dim 600 watts outlets
FS-159 Fan speed
L-160 Dim 320 Watts
L-161 Dim 600 watts
L-162 Dim 100 Watts
L-163 Dim 96 watts
L-164 Dim 250 watts
L-165 Dim 100 watts
L-166 open
L-167 Dim 50 Watts
L-168 Dim 150 watts
L-169 Dim open
L-170 Dim 300 watts
L-171 Dim 150 watts LED 24V.
L-172 Dim 750 watts
L-173 Dim 24 watts LED
L-174 Dim 150 watts
L-175 Dim 36 Watts LED
L-176 Dim 66 watts LED
L-177 Dim 360 watts
L-178 Dim 150 watts
L-179 Dim 150 Watts
L-180 Dim 375 watts 9"
L-181 Dim 240 Watts
S-182 Evac Fan
L-183 Dim 220 watts
L-184 Dim 50 watts
S-185 switch 640 watts
S-186 switch 435 Watts CFL bulbs
S-187 eave floods
S-188 Eave floods
L-189 Dim 300 Watts

S-1001 through S-1011 reserved for Landscape lighting
Circuits marked w/ E are designated as generator backed up

For 2nd floor, Basement Drawing, lofts and out
building loads and schedules please see LD-3

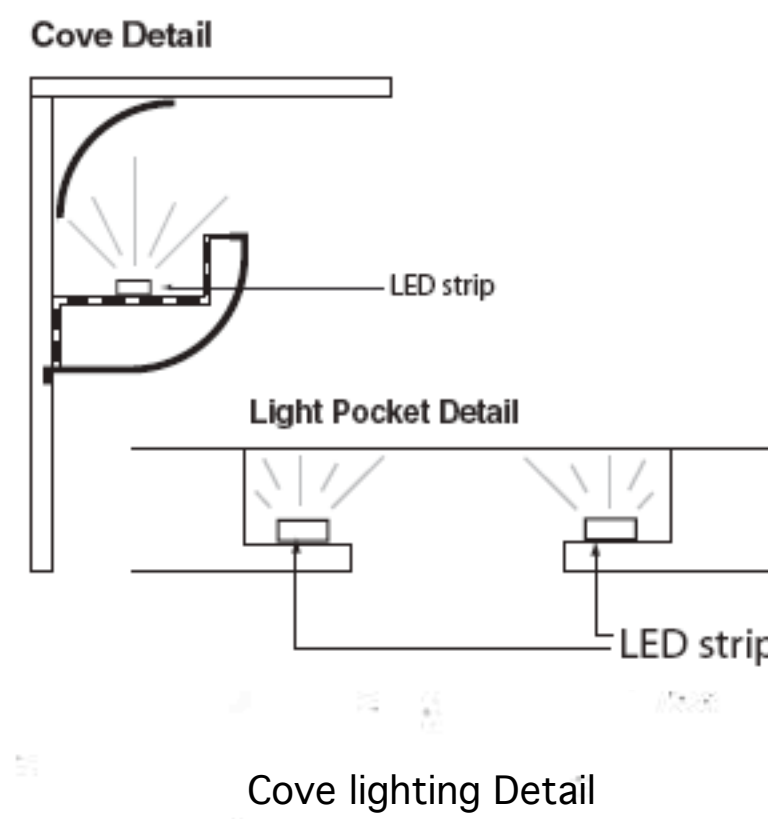

- Lighting Legend
- Nora 4" NLUC 401QSAT w/ NL450 trim and MR16 Bulb
 - Nora 3" NLUC3010 housing w/NL3345W and MR-16 bulb
 - Dreamscape DL7005-IC- w/ DL7400 Trim and MR-16 bulb
 - Nora 3" NLUC3010 housing w/ NL3312 trim and MR-16 bulb
 - Nora 4" NSIC 401QAT w/ Cree CR4 trim kit
 - Nora 4" NSIC 401QAT w/ NS27W and 12 watt a-19 LED bulb
 - Dreamscape DL130NT well light for Interior 20 watt MR11 bulb
DL-130 for exterior 20 Watt MR-11 bulb
(12V remote transformer Required)
 - Halo H7ICA w/ Cree LED solutions LR6 trim Kit
 - DayBright Arioso Surface direct/ indirect 2x2 CF Fluorescent
#2SAVC2CF5SPMW120V
 - Lightroller 1x4 recessed direct indirect Fluorescent Light
QV51GPFOS240 w/ drywall kit FK91x4 2 32 watt T-8 bulbs
 - Metalux WS232120VEB81U 2/4 Fluorescent surface light
 - Dreamscape LED strip DL-S100 series 2700 K
 - Hanging or Flush ceiling Fixture TBD
 - Decorative Fan
 - Wall sconce or Vanity fixture
 - Surface mounted bullet exterior Dreamscape Lunar 3 # DL133 w/ DL-210-3
 - Tech Lighting 1 or 2 circuit mono rail or similar system see Lighting designer
 - Tech Lighting Cable lighting system see Lighting designer
 - Tech Lighting Monopoint w/ Telescope fixture see Lighting designer
 - Jesco
 - Dreamscape Lighting DLED 5400 angle under cabinet strip
 - Key Pad location
 - Evacuation Fan

Electrical Notes
All numbered switch Legs are Home Runs to Lighting Panels
It is recommended that all switch legs be run be separately run, should combinations of switching circuits be
made, they be made at the Lighting Panel Junction Gutter so future
up grades can be made more easily all wiring shall be marked with it's corresponding Number

Refer all questions to Lighting Designer

Refer all lighting location and specification questions to Lighting Designer


Lighting Panels located in Basement, Garages, 2nd floor closet and in Loft attic. see: panel assignment sheets
for load panel locations

Outlets shall be installed as per local code Outlets makes w/ "E" shall be designated as emergency power
GFC outlets shall be used in baths, Kitchens and any area within 4 ft of water

All standards of local and The National Electrical Code shall be followed
Additional circuits shall start at #2001 (Christmas lighting outlets etc.)

Sconces and Lanterns shall be hung at 75 inches off finished floor
Vanity fixtures shall be hung at 65 inches off finished floor Unless over mirror, verify
mirror height
Except in Conservatory hang above windows and in mud room Hang at Landing
height

Lighting Designer shall verify all fixture specifications and locations
Griff Williams (910)949-2458

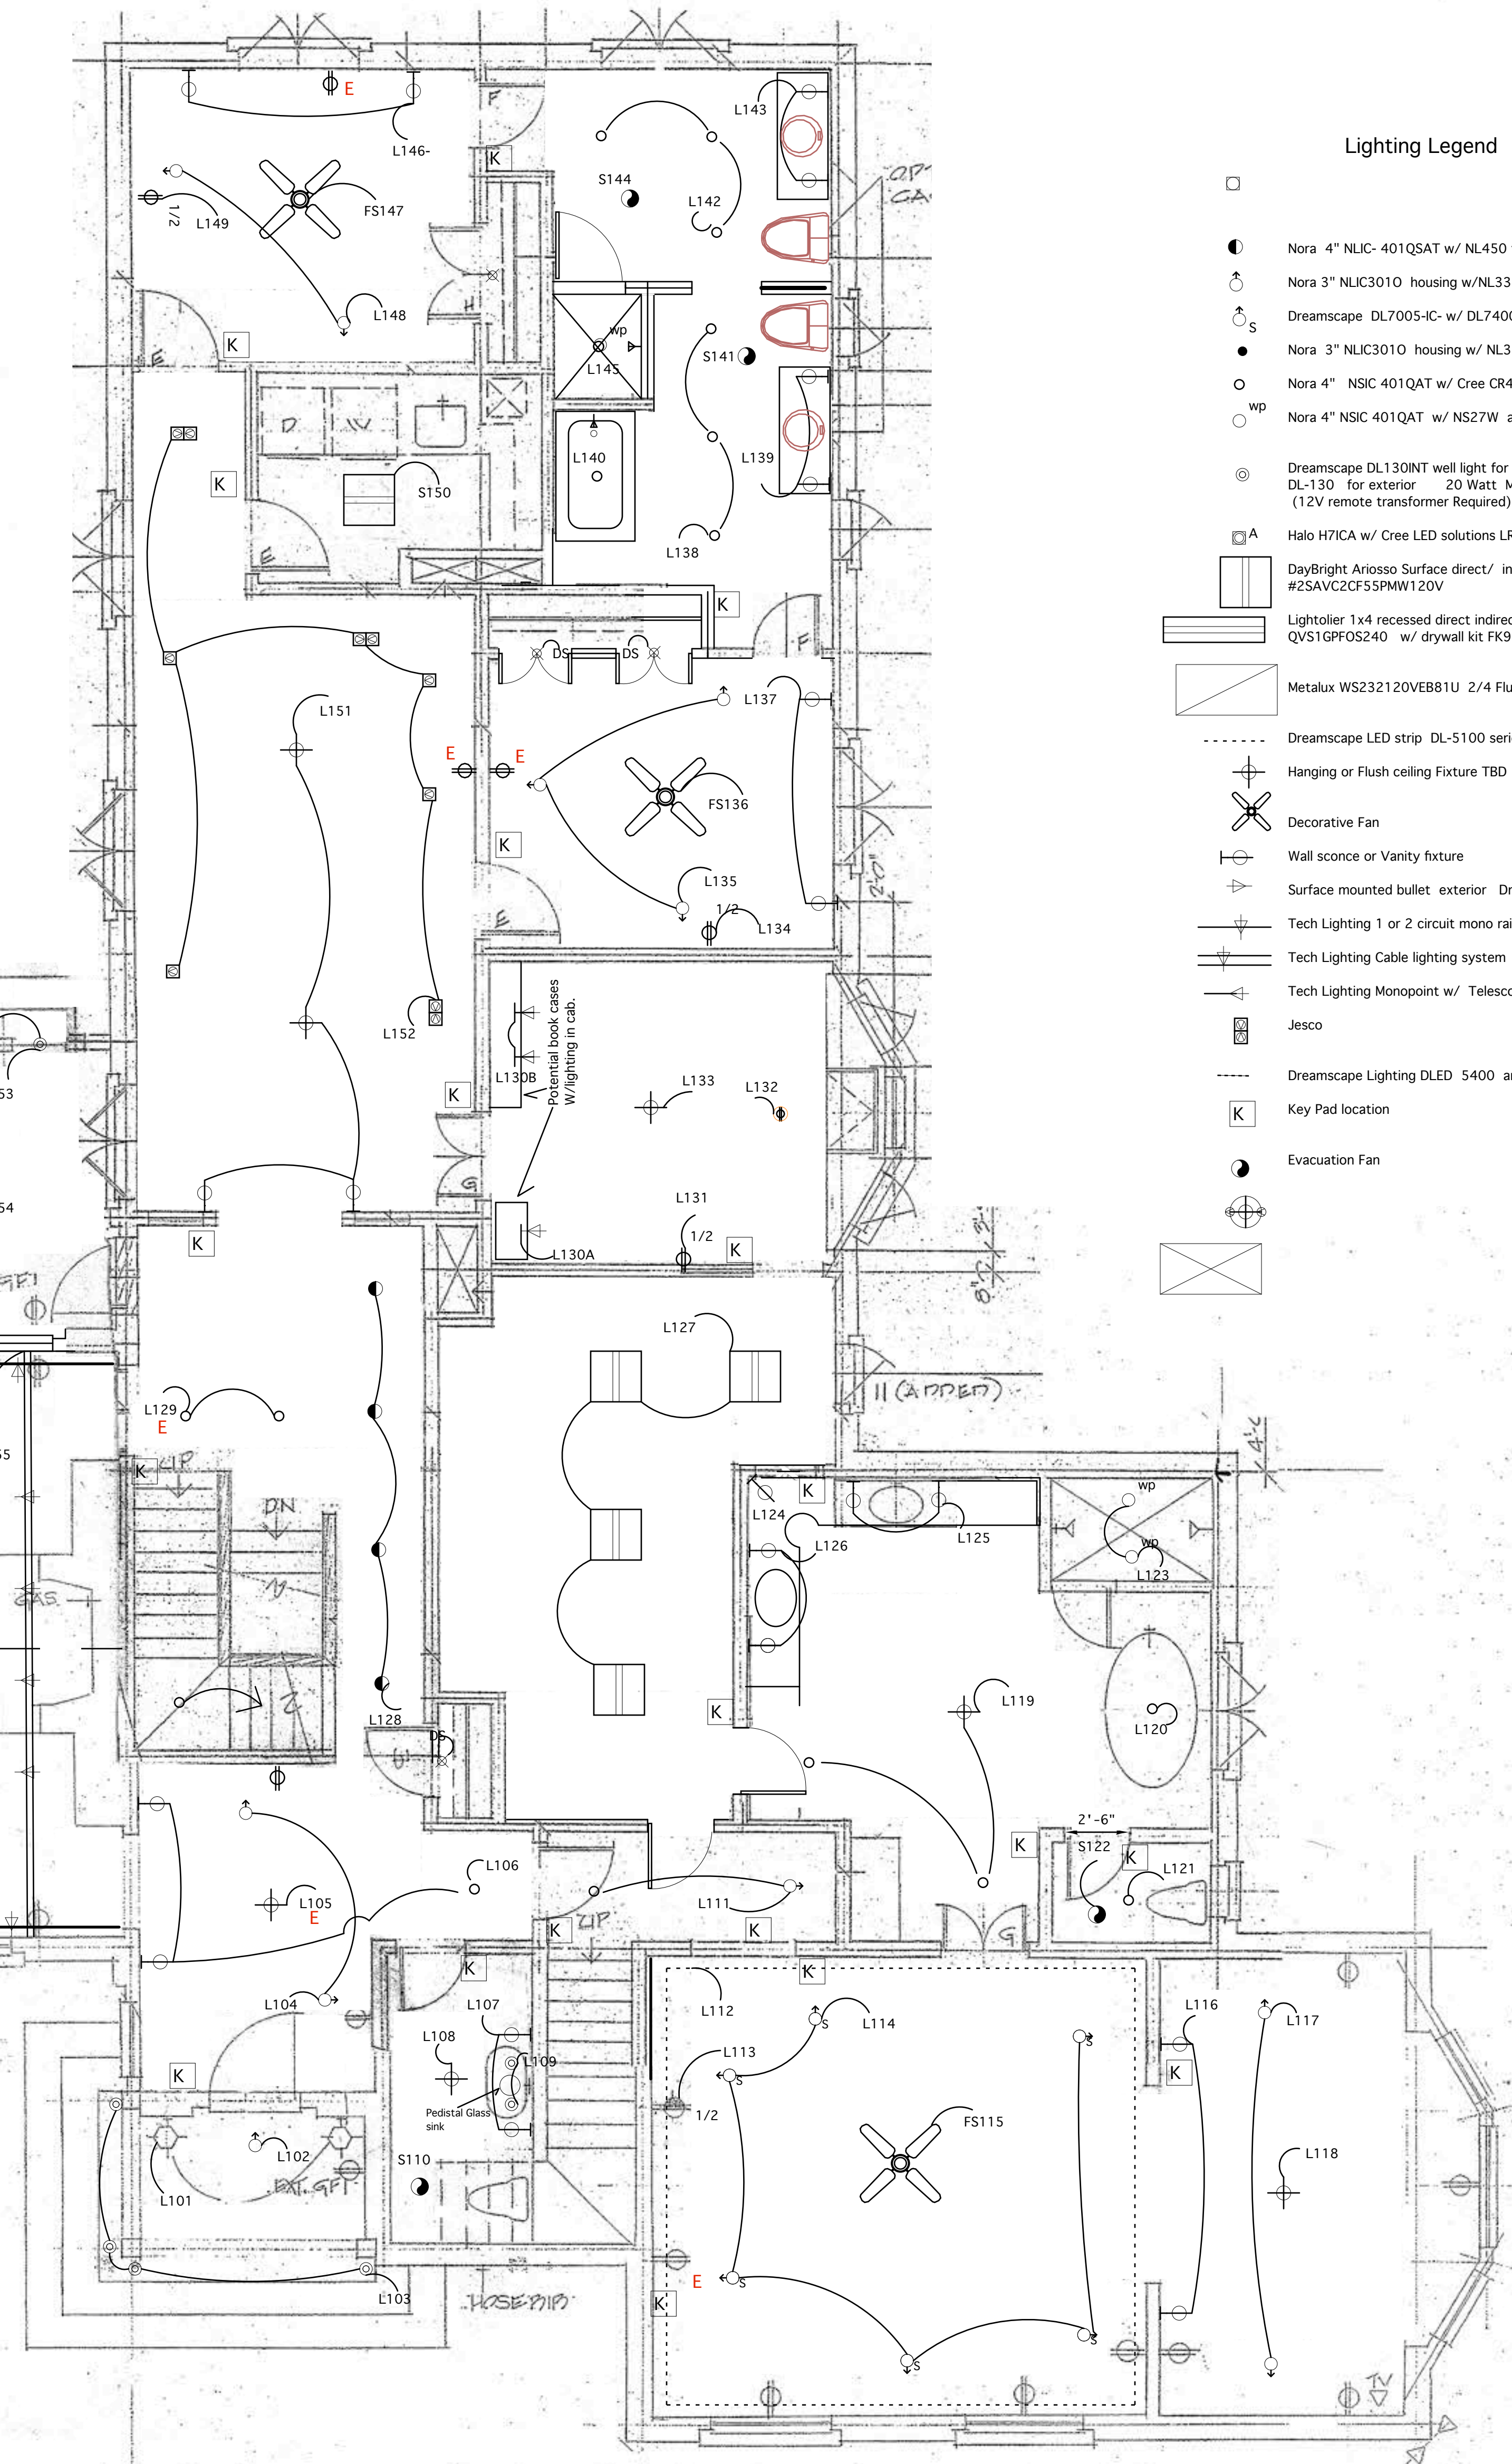

Living in Lighting
Lighting Consultation and Lighting System Design
By Griff Williams
P.O. Box 2379
Southern Pines N.C. 28388
(910)949-2458
www.livinginlighting.com

Design Dated 06/29/09
Revised 07/21/09
Revised 10/21/09
Revised 11/04/12
G.W.

GROUND FLOOR POWER PLAN 1/4"=1'-0"



ROBERT E. CLARK ARCHITECT
THE ARCHITECT RETAINS THE RIGHT OF AUTHORSHIP FOR
THIS WORK, AND AS SUCH ALL
EPSTEIN/LATHAM RESIDENCE 3227 1/2 LINDEN TRAIL, RENEHURST, NC

Home Control Lighting and Switching Assignments and Wattages
2nd Floor:
Beginning in office moving through hall to Guest bedroom Then to
Garage Loft

L-201 Dim 200 watts **Emergency**
L-202 open
S-203 switch 440 watts
S-204 110 watts **Emergency**
L-205 Dim 530 watts
L-206 Dim 150 watts
L-207 Dim 180 watts
L-208 Dim 480 Watts
S-209 switch 110 watts
L-210 Dim 320 watts
L-211 Dim 400 watts
S-212 switch Evac fan
L-213 open
L-214 Dim 360 watts
L-215 Dim 600 Watts outlet
FS-216 Fan speed
Garage loft
L-217 Dim 36 Watts LED **Emergency**
L-218 Dim 150 watts
L-219 Dim 60 watts LED **Emergency**
S-220 Evac fan
L-221 Dim 50 watts
L-222 Dim 50 watts
L-223 Dim 170 watts **Emergency**
L-224 Dim 600 watts outlet
FS-225 Fan speed
L-226 Dim 240 watts

Basement Wattages
L-001 Dim 100 watts
L-002 Dim 150 watts
L-003 Dim 84 watts LED
FS-004 Fan speed
L-006 Dim 24 Watts LED
S-007 switch 70 Watts Fluorescent
L-008 Dim 200 watts
L-009 Dim 50 Watts
S-010 Evac fan
S-011 switch 70 watts Fluorescent
L-012 Dim 600 watts
L-013 Dim 300 watts
L-014 Dim 150 watts

Electrical Notes

All numbered switch Legs are Home Runs to Lighting Panels
It is recommended that all switch legs be run by separately run , should combinations of switching circuits be made ,
they be made at the Lighting Panel Junction Gutter so future
up grades can be made more easily all wiring shall be marked with it's corresponding Number

Refer all questions to Lighting Designer

Refer all lighting location and specification questions to Lighting Designer

Lighting Panels located in Basement , Garages, 2nd floor closet and in Loft attic. see panel assignment sheets for load
panel locations

Outlets shall be installed as per local code
GFCI outlets shall be used in baths , Kitchens and any area within 4 ft of water

All standards of local and The National Electrical Code shall be followed

Additional circuits shall start at #2001 (Christmas lighting outlets etc.)

Emergency Power is being supplied by Solar collectors and a battery storage system
a distribution panel is incorporated with the solar and battery system Called Sunny Island

As a secondary and concurrent backup system, a propane power generator is incorporated with a transfer switch
well pump , geothermal Heat , stove and refrigeration are priorities
Energy monitoring devices and computer systems are a priority
outlets are marked throughout the house for emergency use (12 total) and shall require 2 15 amp circuits 14 outlets
Emergency Lighting circuits are also designated and shall require 1 15 amp circuits 1450 watts
suggested emergency circuits are marked with **E**

Notes for automation

1. Sun shades shall be incorporated in this design . shade controls shall interface with Central Control computer solar and thermal sensors shall be used to control both temperature and Lighting levels
2. Heating and Air shall be interfaced with control system
3. Security shall be interfaced with master control system. Pool and spa controls shall be interfaced with control system
5. access points shall be placed through out the house as needed for wireless control and Internet connection
6. sprinkler and watering systems shall be controlled by system
7. a page of the Master Control screen shall monitor energy usage
8. Emergency back up power shall power the central control computer and at least 1 Master control screen
10. Incorporate remote location control and alert via internet

Areas included in emergency back up TBD

Living in Lighting

Lighting Consultation and Lighting System Design
By Griff Williams
P.O. Box 2379
Southern Pines N.C. 28388
(910)949-2458
www.livinginlighting.com

Sconces and Lanterns shall be hung at 75 inches off finished floor
Vanity fixtures shall be hung at 65 inches off finished floor Unless over mirror , verify
mirror height
Except in Conservatory hang above windows and in mud room Hang at Landing
height

Lighting Designer shall verify all fixture specifications and locations
Griff Williams (910)949-2458

Design Dated 06/29/09
Revised 07/21/09
Revised 10/21/09
Revised 11/14/09
G.W.


Home Control Lighting and Switching Assignments and Wattages
Cabana / Racket ball court , Apartment and Root Cellar

LC-101 Dim 36 watts
SC-102 switch 2400 watts
LC-103 Dim 340 watts
LC-104 Dim 50 watts
SC-105 Evac fan
LC-106 Dim 240 watts
LC-107 Dim 150 watts
FSC-108 Fan speed
LC-109 Dim LED 60 watts
LC-110 Dim LED 48Watts
LC-111 Dim LED 12 watts
LC-112 Dim 140 watts
LC-113 Dim LED 24 Watts
LC-114 Dim 120 watts
LC-115 Dim 120 watts
LC-116 Dim 225 watts
LC-117 Dim 675 watts

Apartment
LC-201 Dim LED 72 watts
LC-202 Dim 250 Watts
LC-203 Dim 24 watts LED
LC-204 Dim 150 watts
LC-205 Dim LED 24 watts
LC-206 Dim 50 watts
SC-207 Evac fan
SC-208 switch 70 watts
LC-209 Dim 600 watts outlet
FSC-210 Fan speed
LC-211 Dim 240 Watts
LC-212 Dim 200 Watts


Garden house
SG-101 switch 70 watts
SG-102 Switch 210 watts
LG-103 Dim 48 watts LED
SG-104 switch 120 watt

Lighting Legend

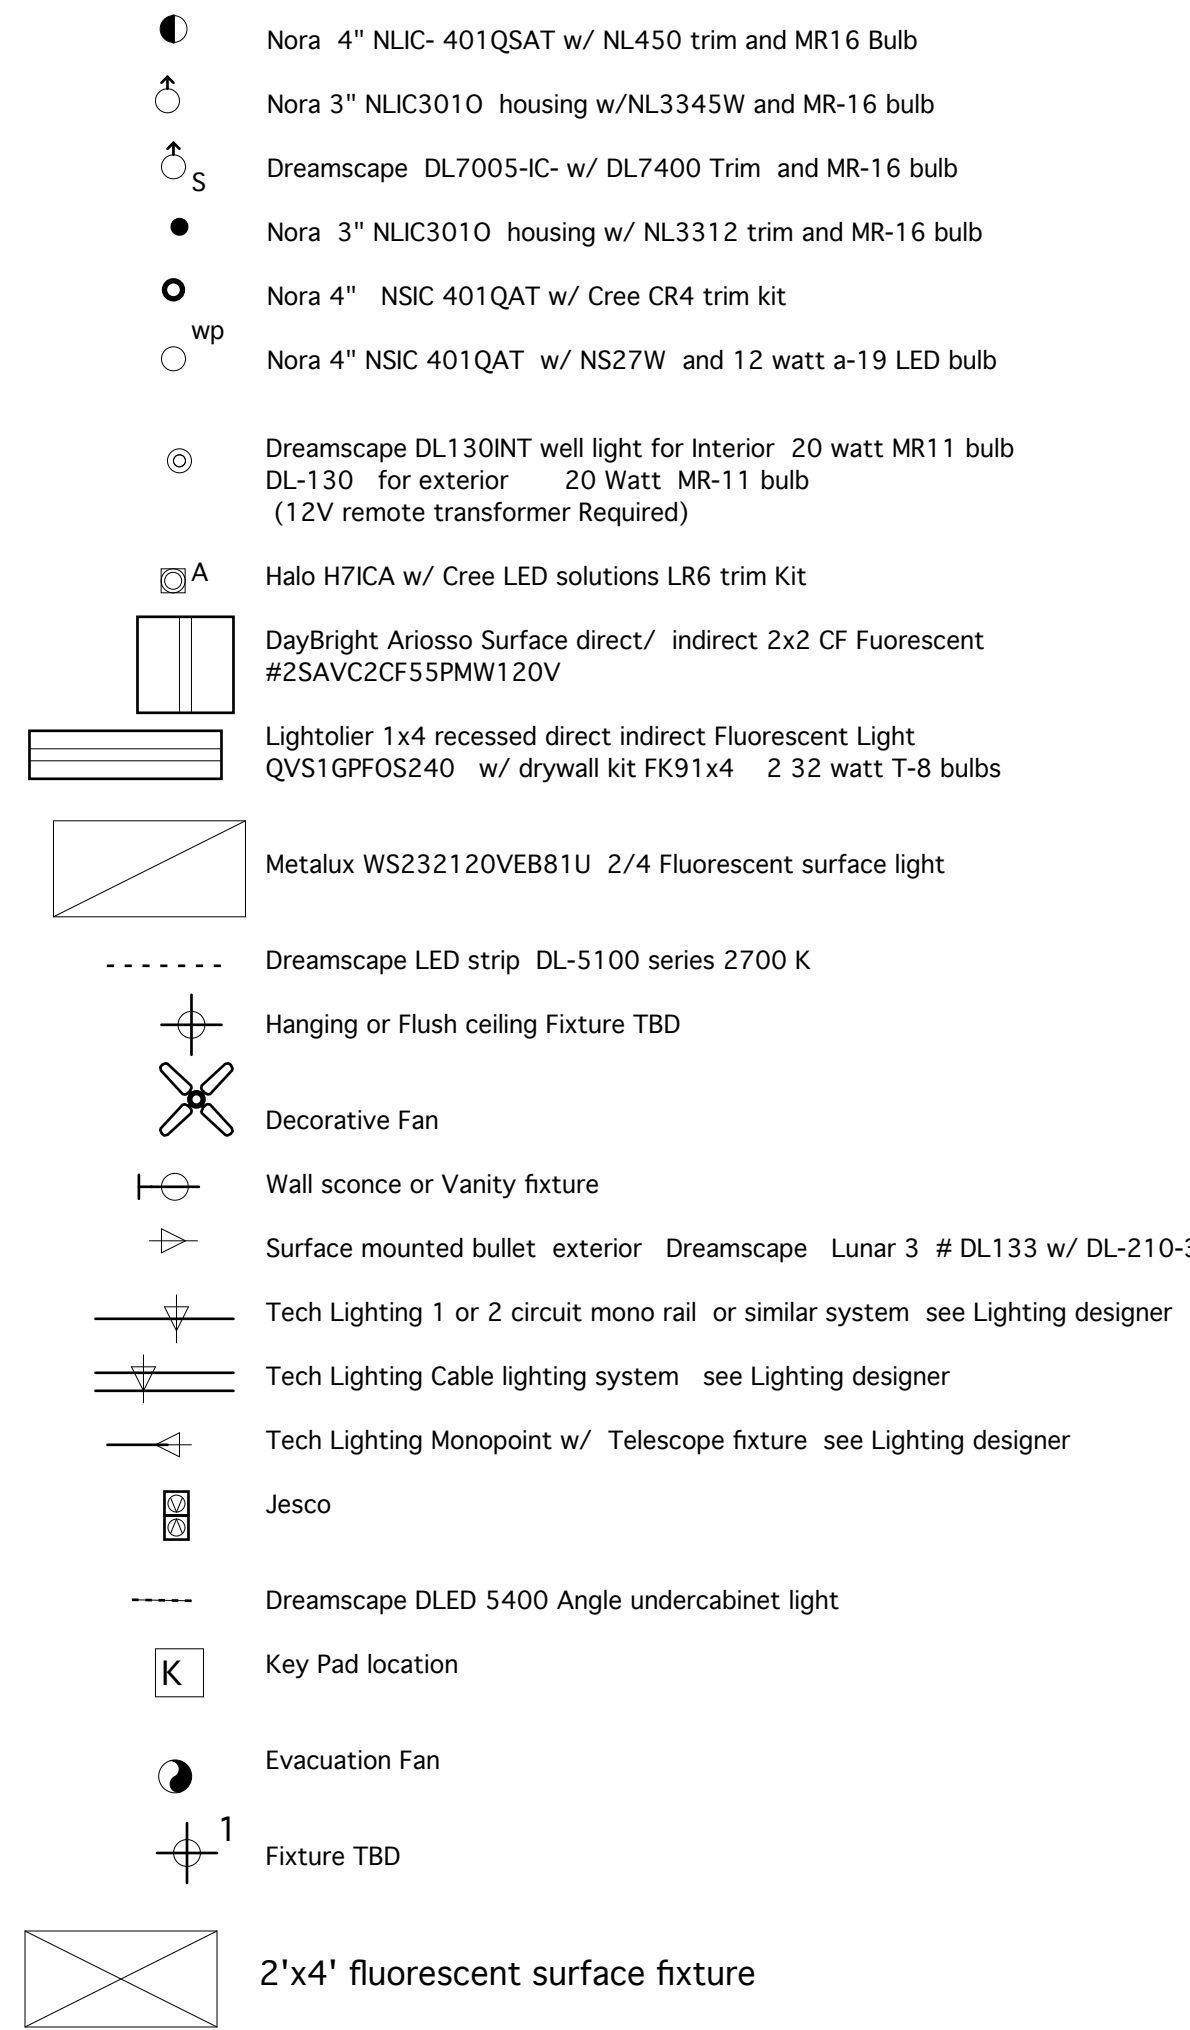

Epstein/Latham Residence Electrical Load sheet


General lighting and receptacle load	
11724 Sq ft x 3 watts	35172
20 small appliances	30000
laundry (2)	3000
general light and small appliances	68172
-3000	65172
x 0.35	22810
+ 3000	25810
Special appliance	8100
Ovens ,grill	9800
2 Dryer	10000
AC Heat pump	
3 Geo Thermal units	25000
sub total	78710
Fixed appliance	17000
1 Spa tub	2000
1 steam unit	8400
0.75 x 27400	20550
Fountains	4000
Pool/Spa	15000
Landscape lighting	4500
Total	122760/240
Total load Minimum	512 Amps
600 amp recommended	

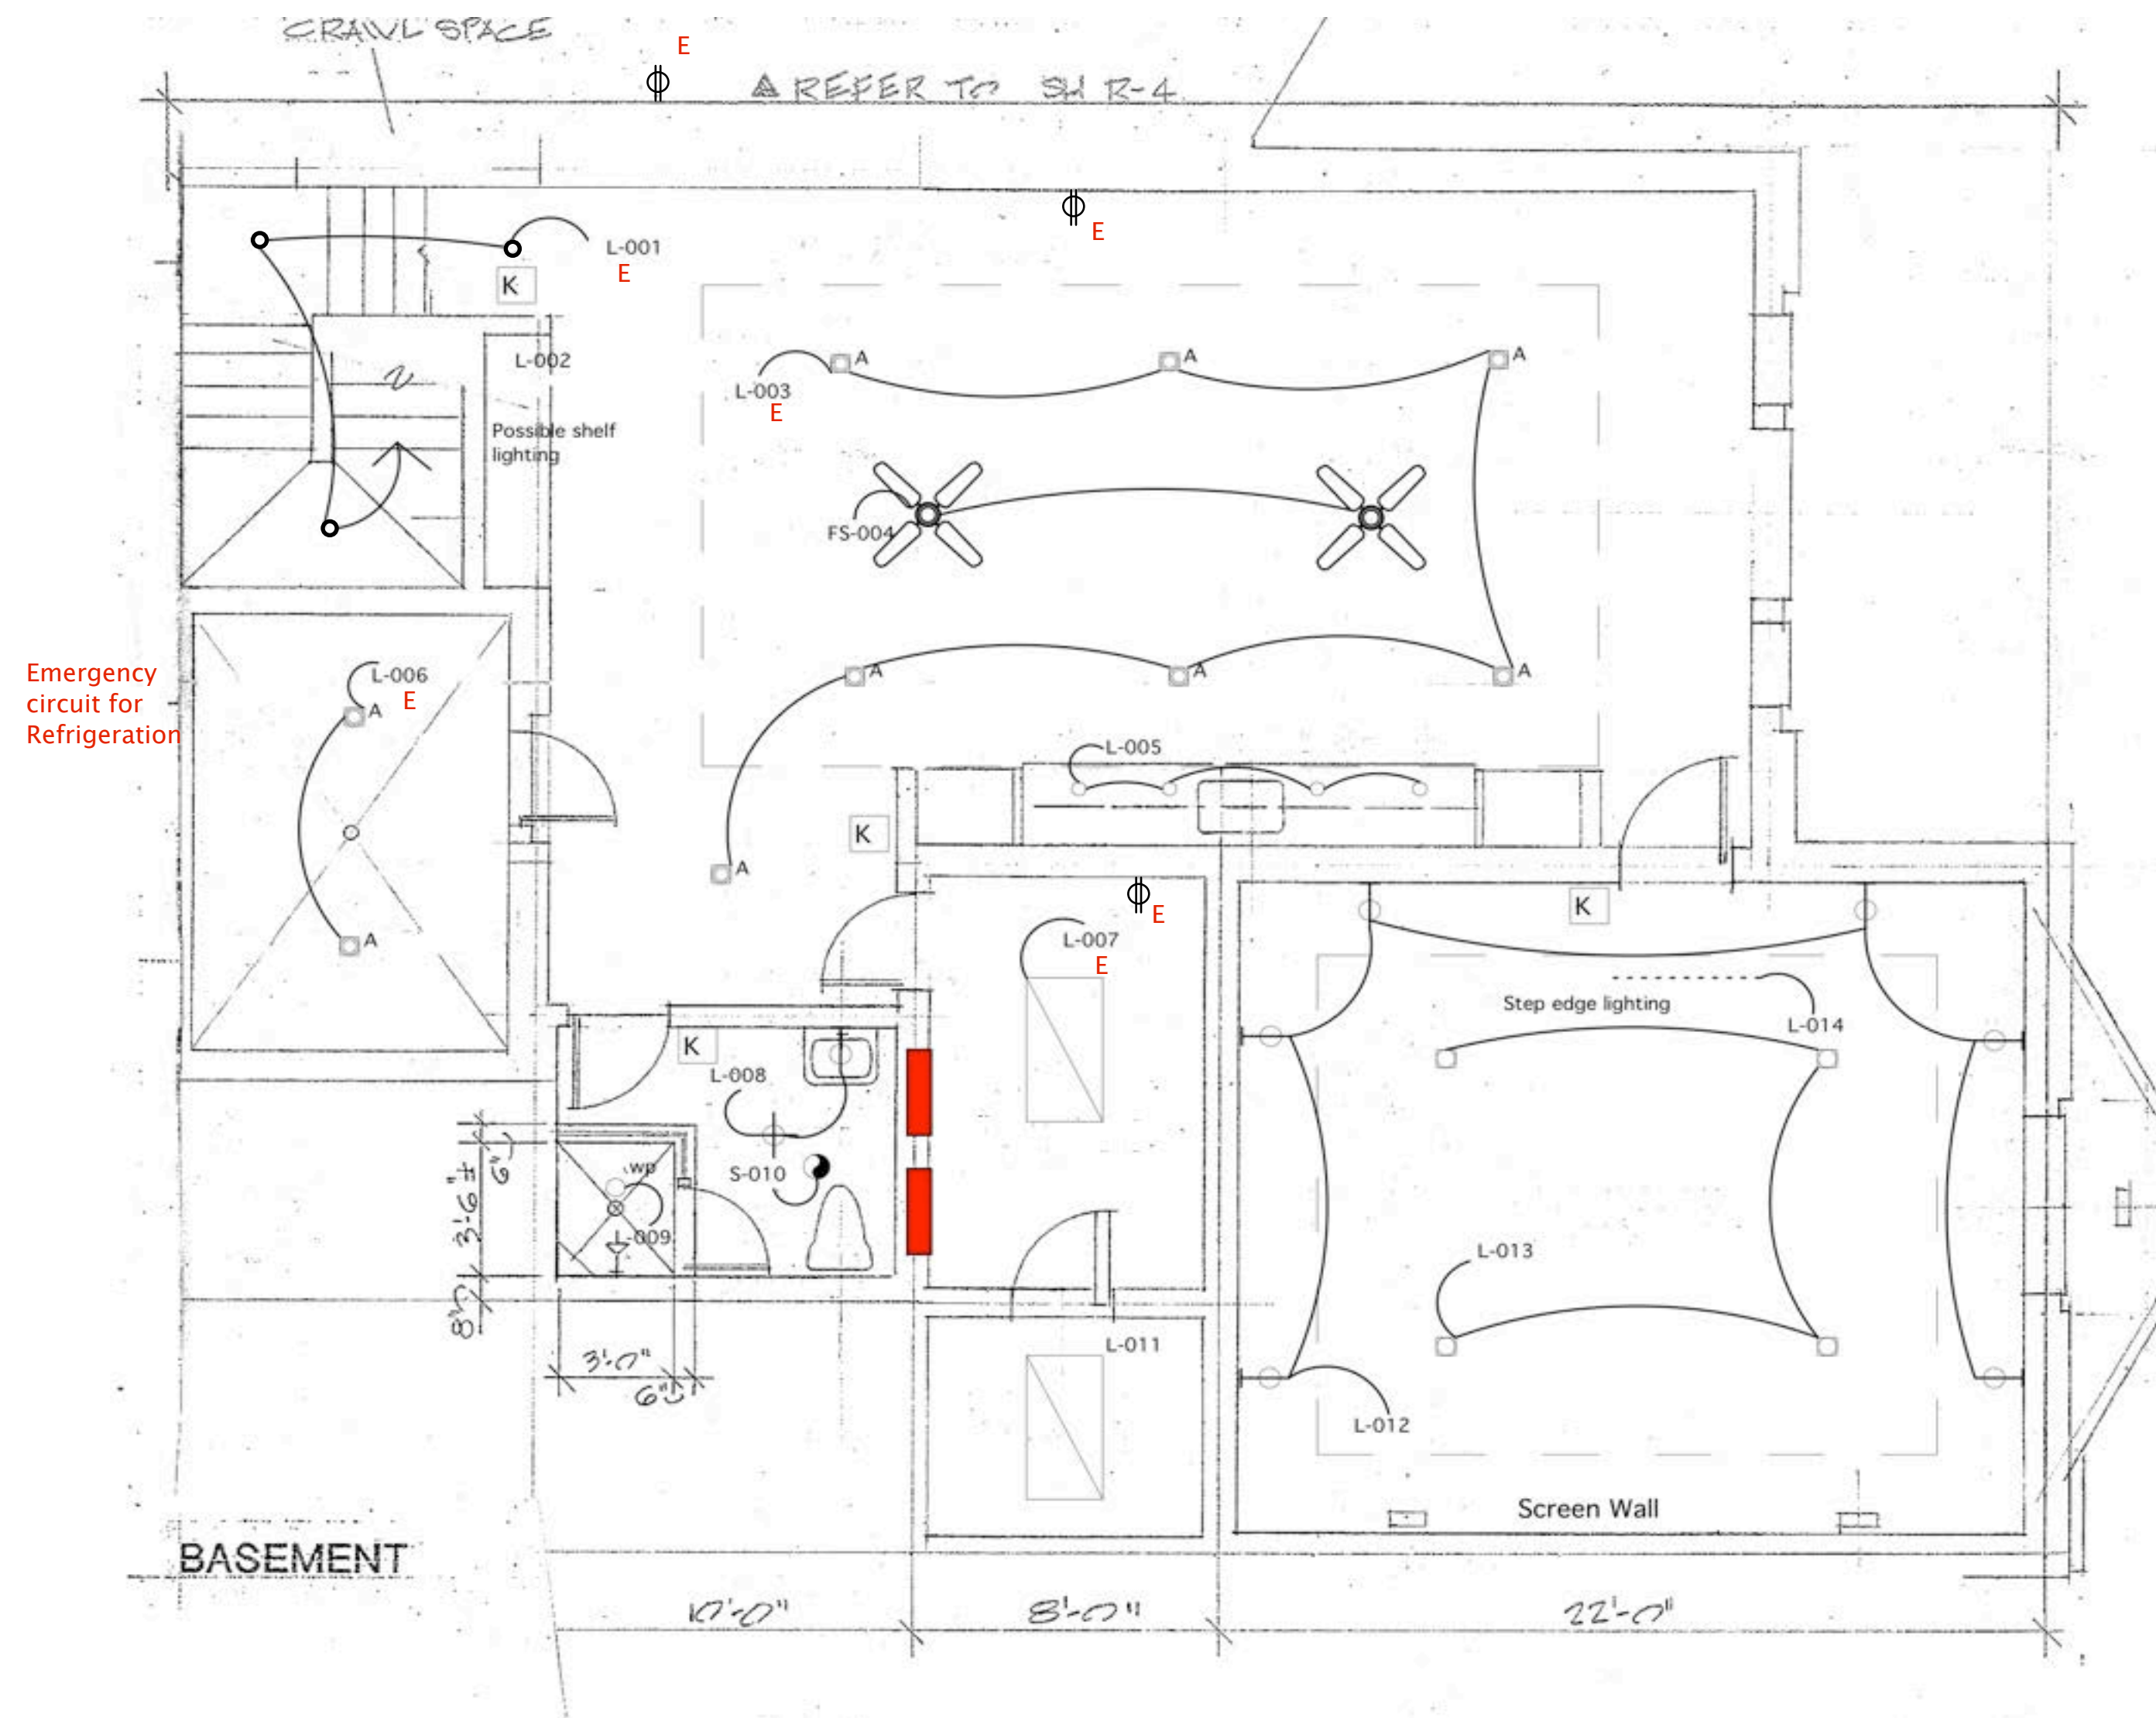


THE ARCHITECT MAKES NO REPRESENTATION OR WARRANTY FOR THE ACCURACY OR COMPLETENESS OF THE INFORMATION, DATA, OR OTHER MATERIALS FURNISHED BY HIS WORK, AND AS SUCH ALL DRAWINGS AND SPECIFICATIONS ARE PRELIMINARY AND NOT TO BE USED FOR CONSTRUCTION OR FOR ANY OTHER PURPOSE WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT. THE ARCHITECT SHALL NOT BE RESPONSIBLE FOR ANY ERRORS OR OMISSIONS IN THE DRAWINGS OR SPECIFICATIONS WHICH MAY BE MADE BY ANY OTHER PERSON OR ENTITY. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROJECT EXCEPT BY AGREEMENT WITH THE ARCHITECT.

EPSTEIN/LATHAM RESIDENCE - 12114 LINDEN TRAIL - PINEHURST, NC
APPROVED & ACCEPTED DATE 7-11-08
REVISED


LD-3
Lighting
notes

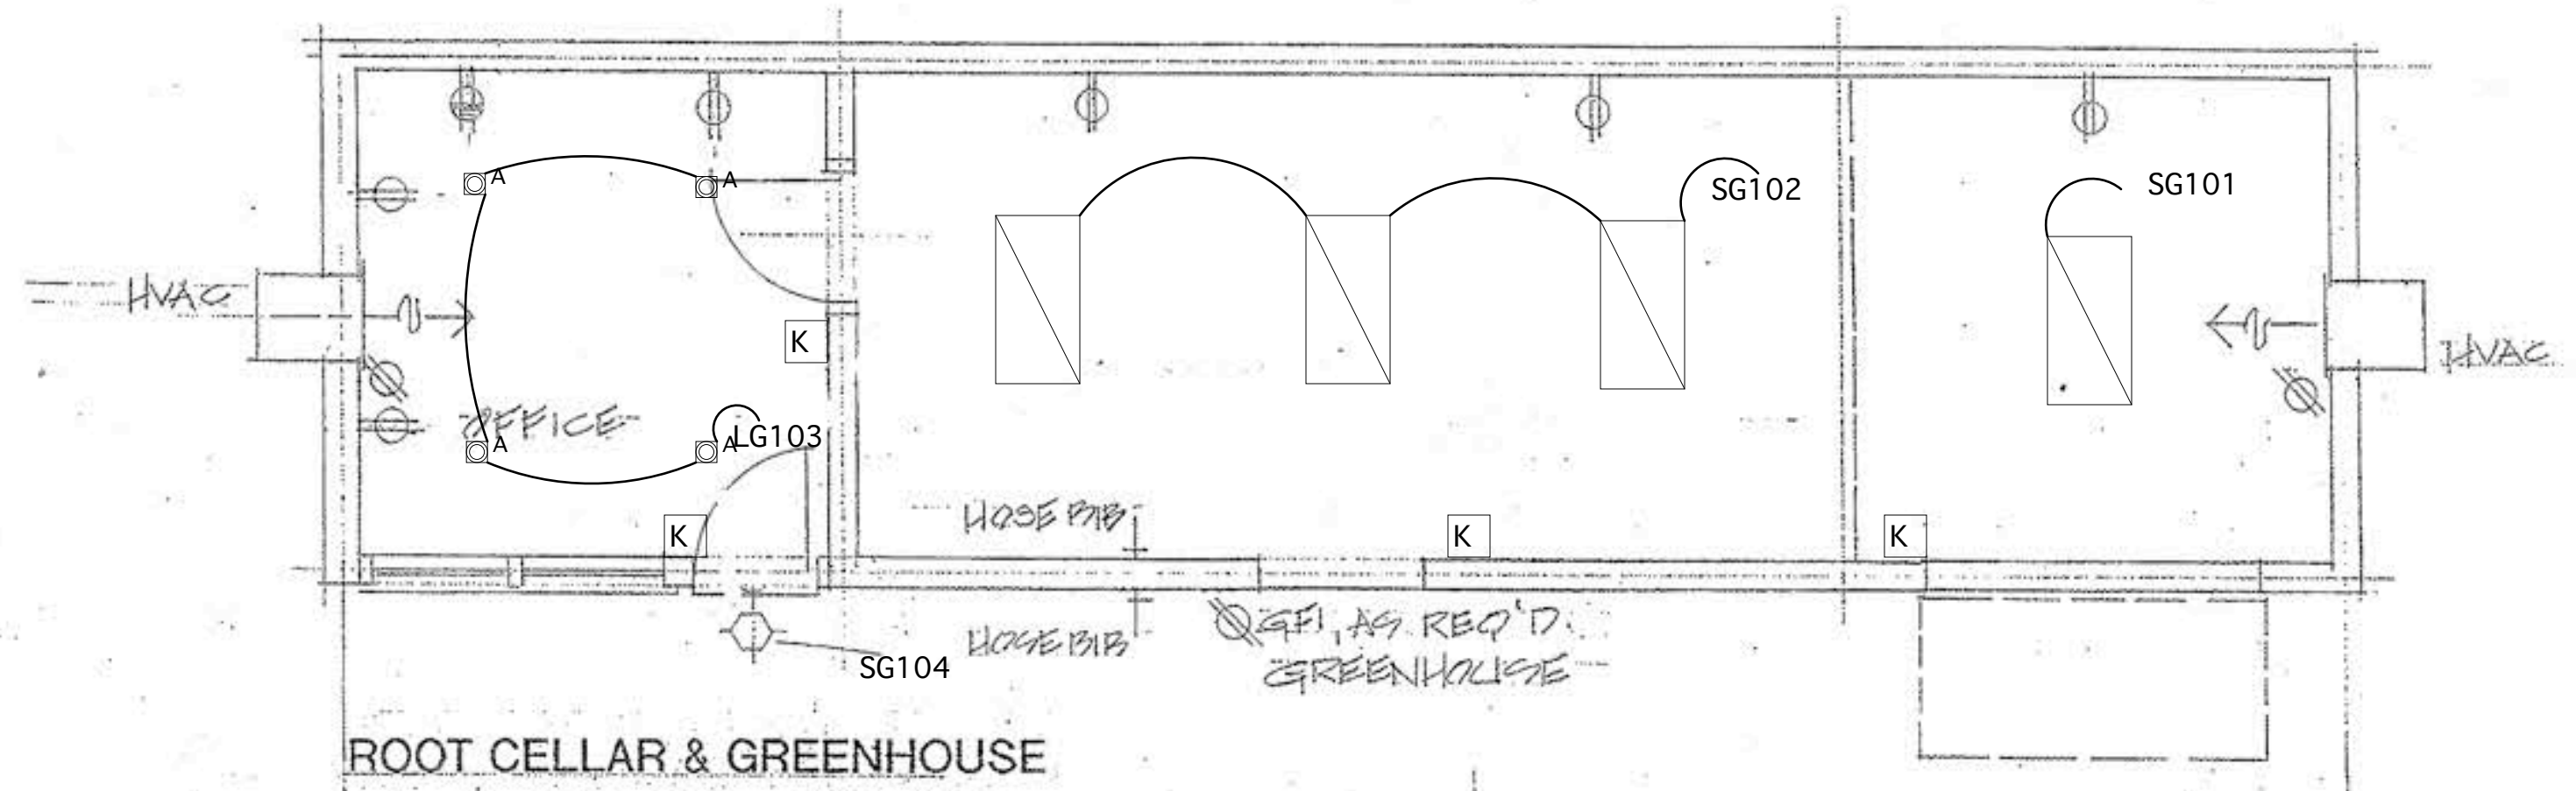


ROOT CELLAR & GREENHOUSE

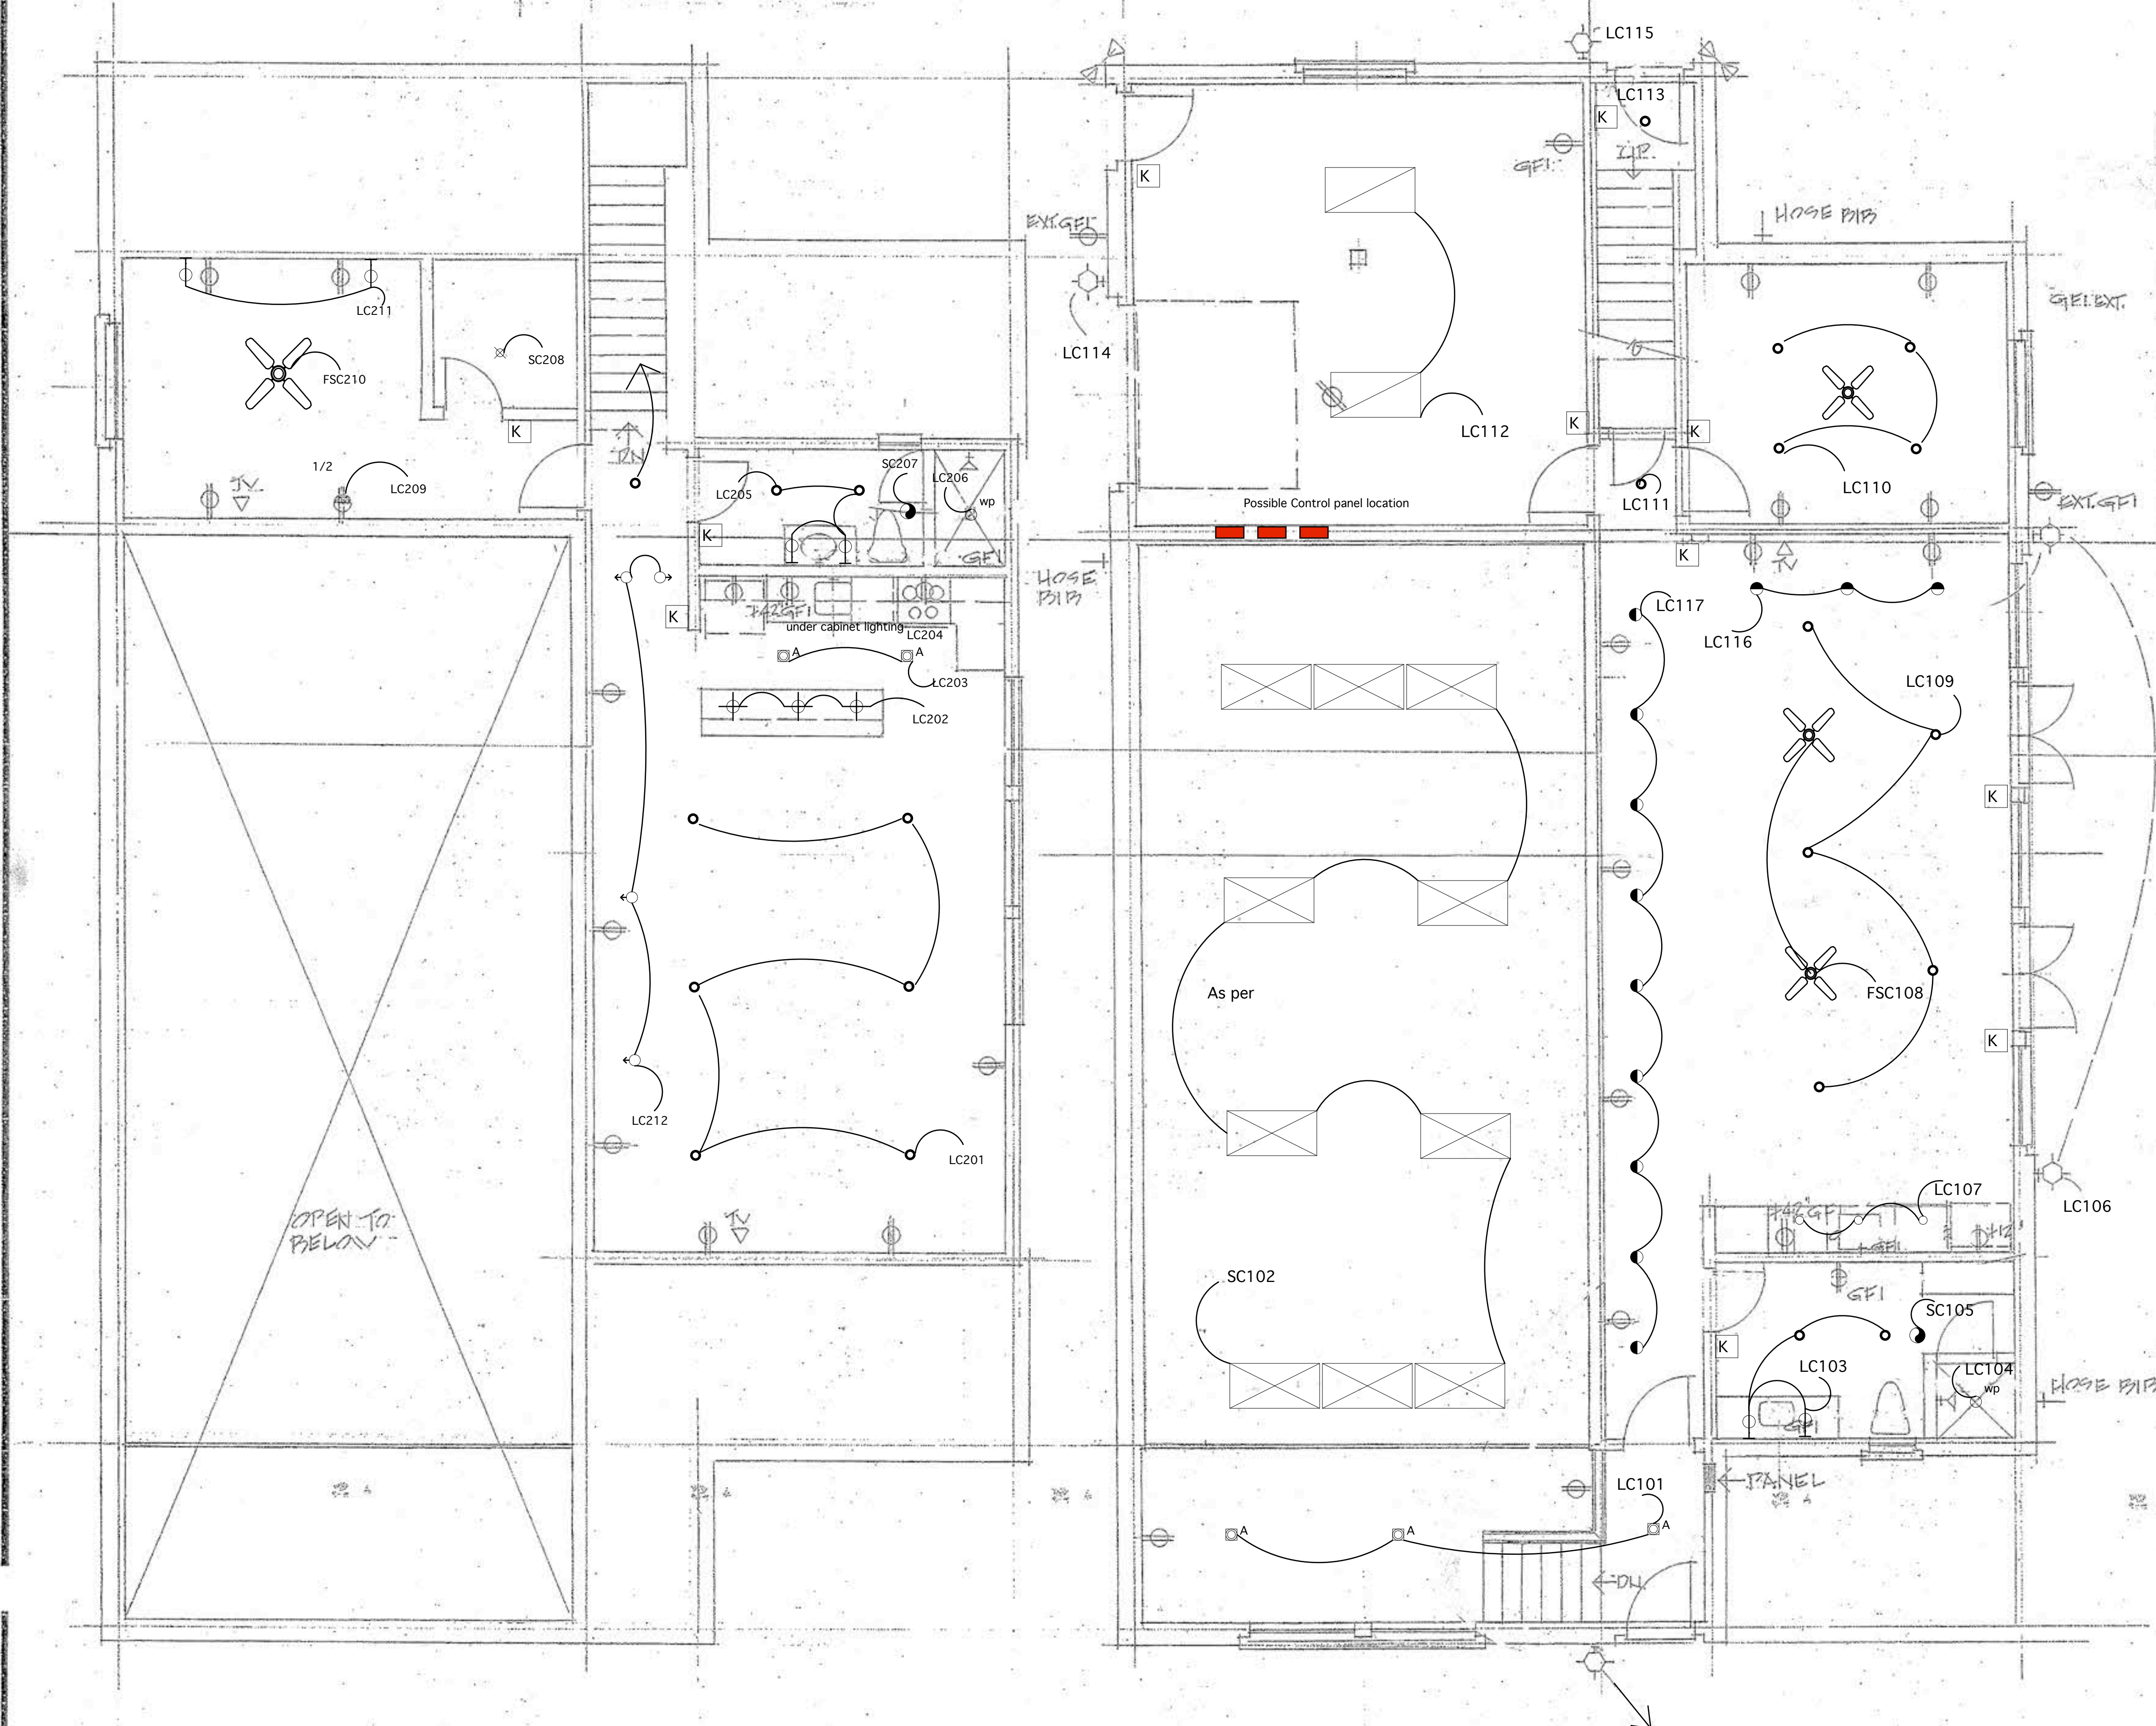

CABANA/RACQUETBALL

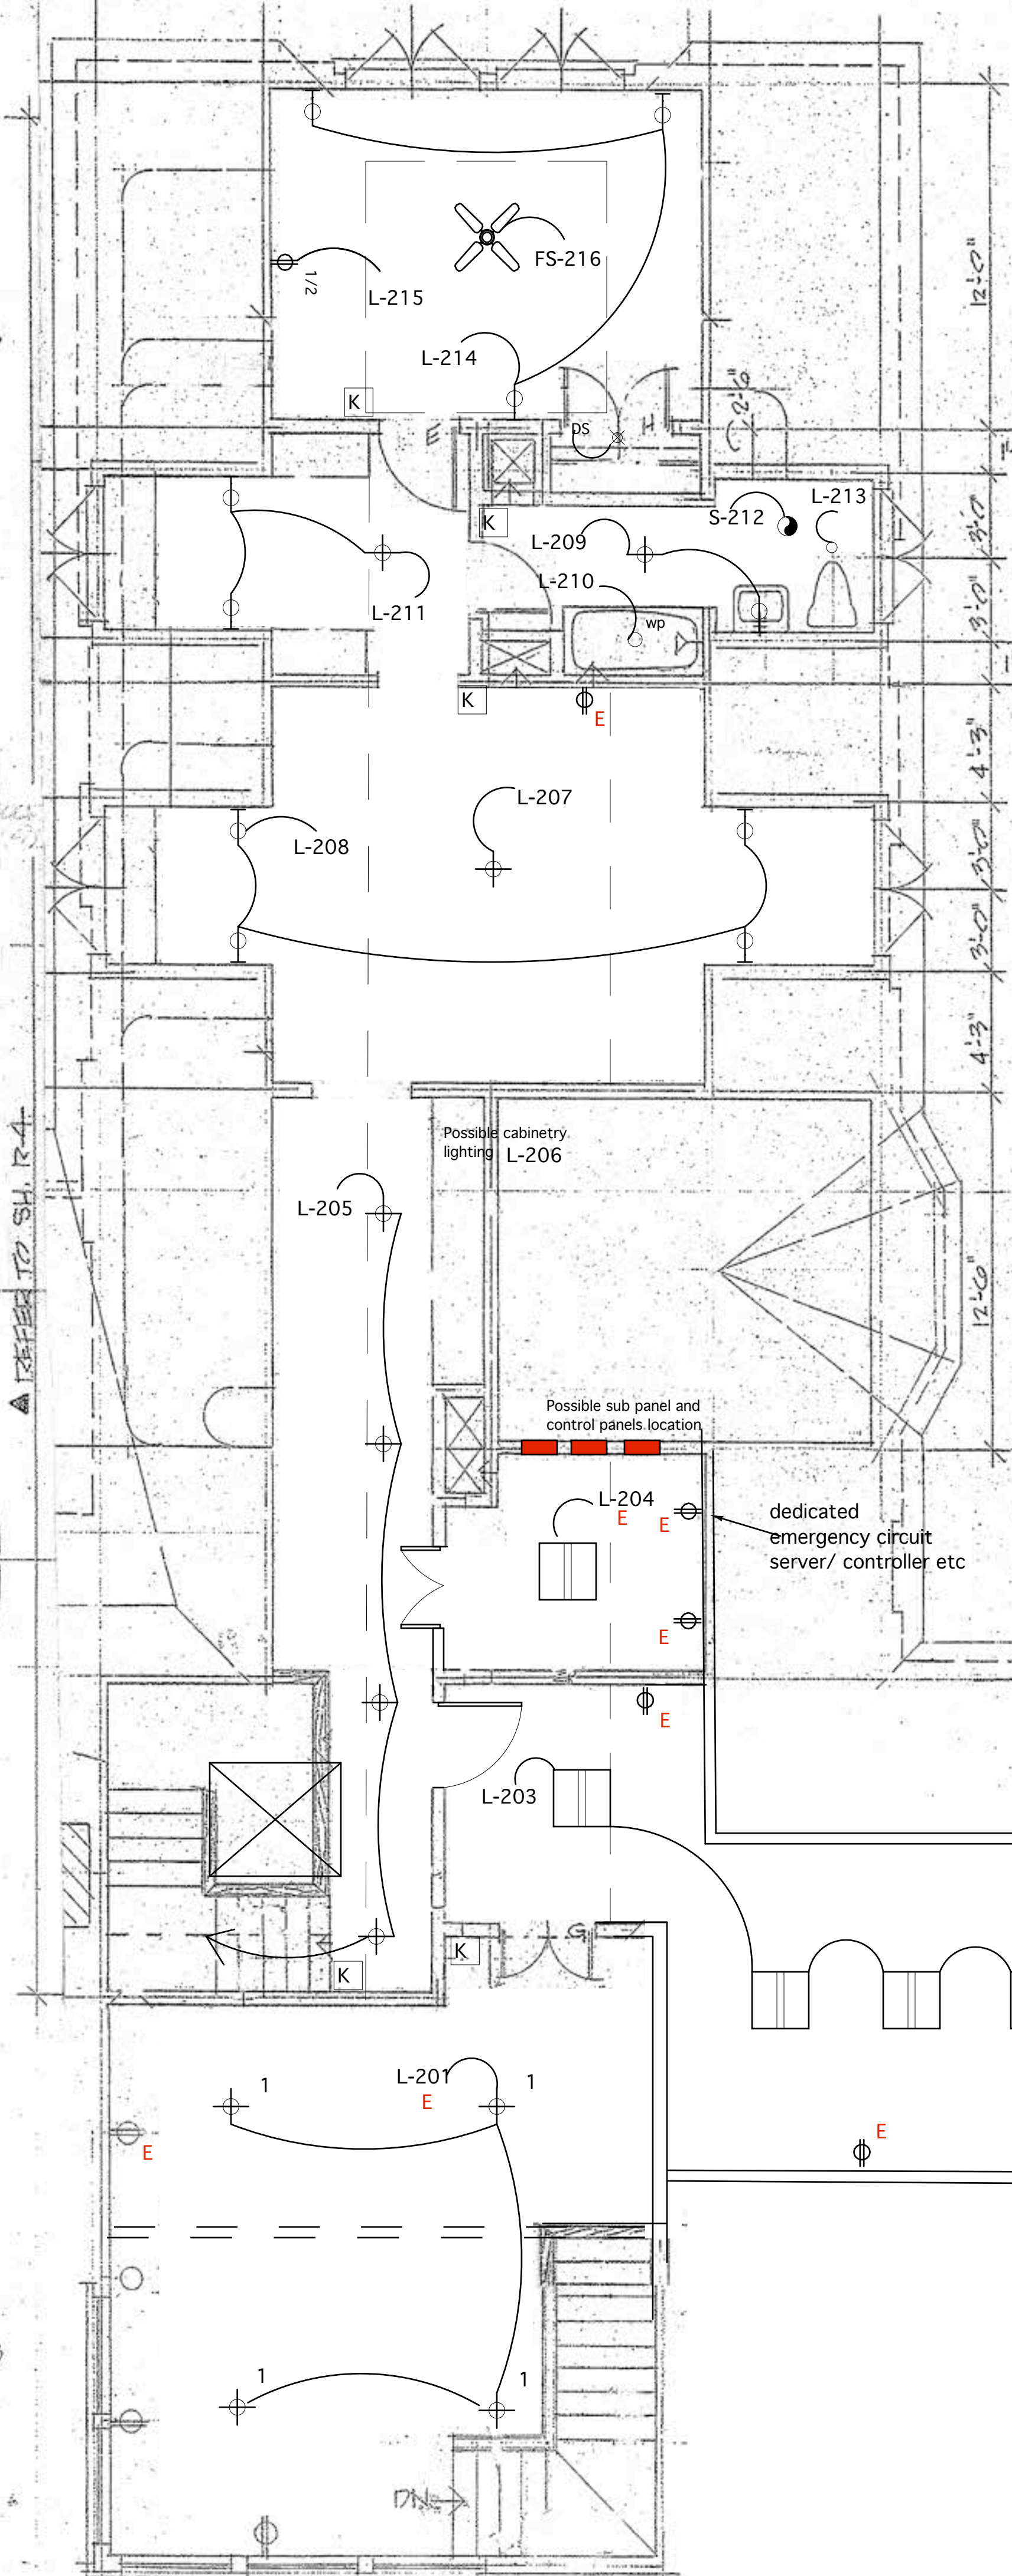

EAST WING LOFT

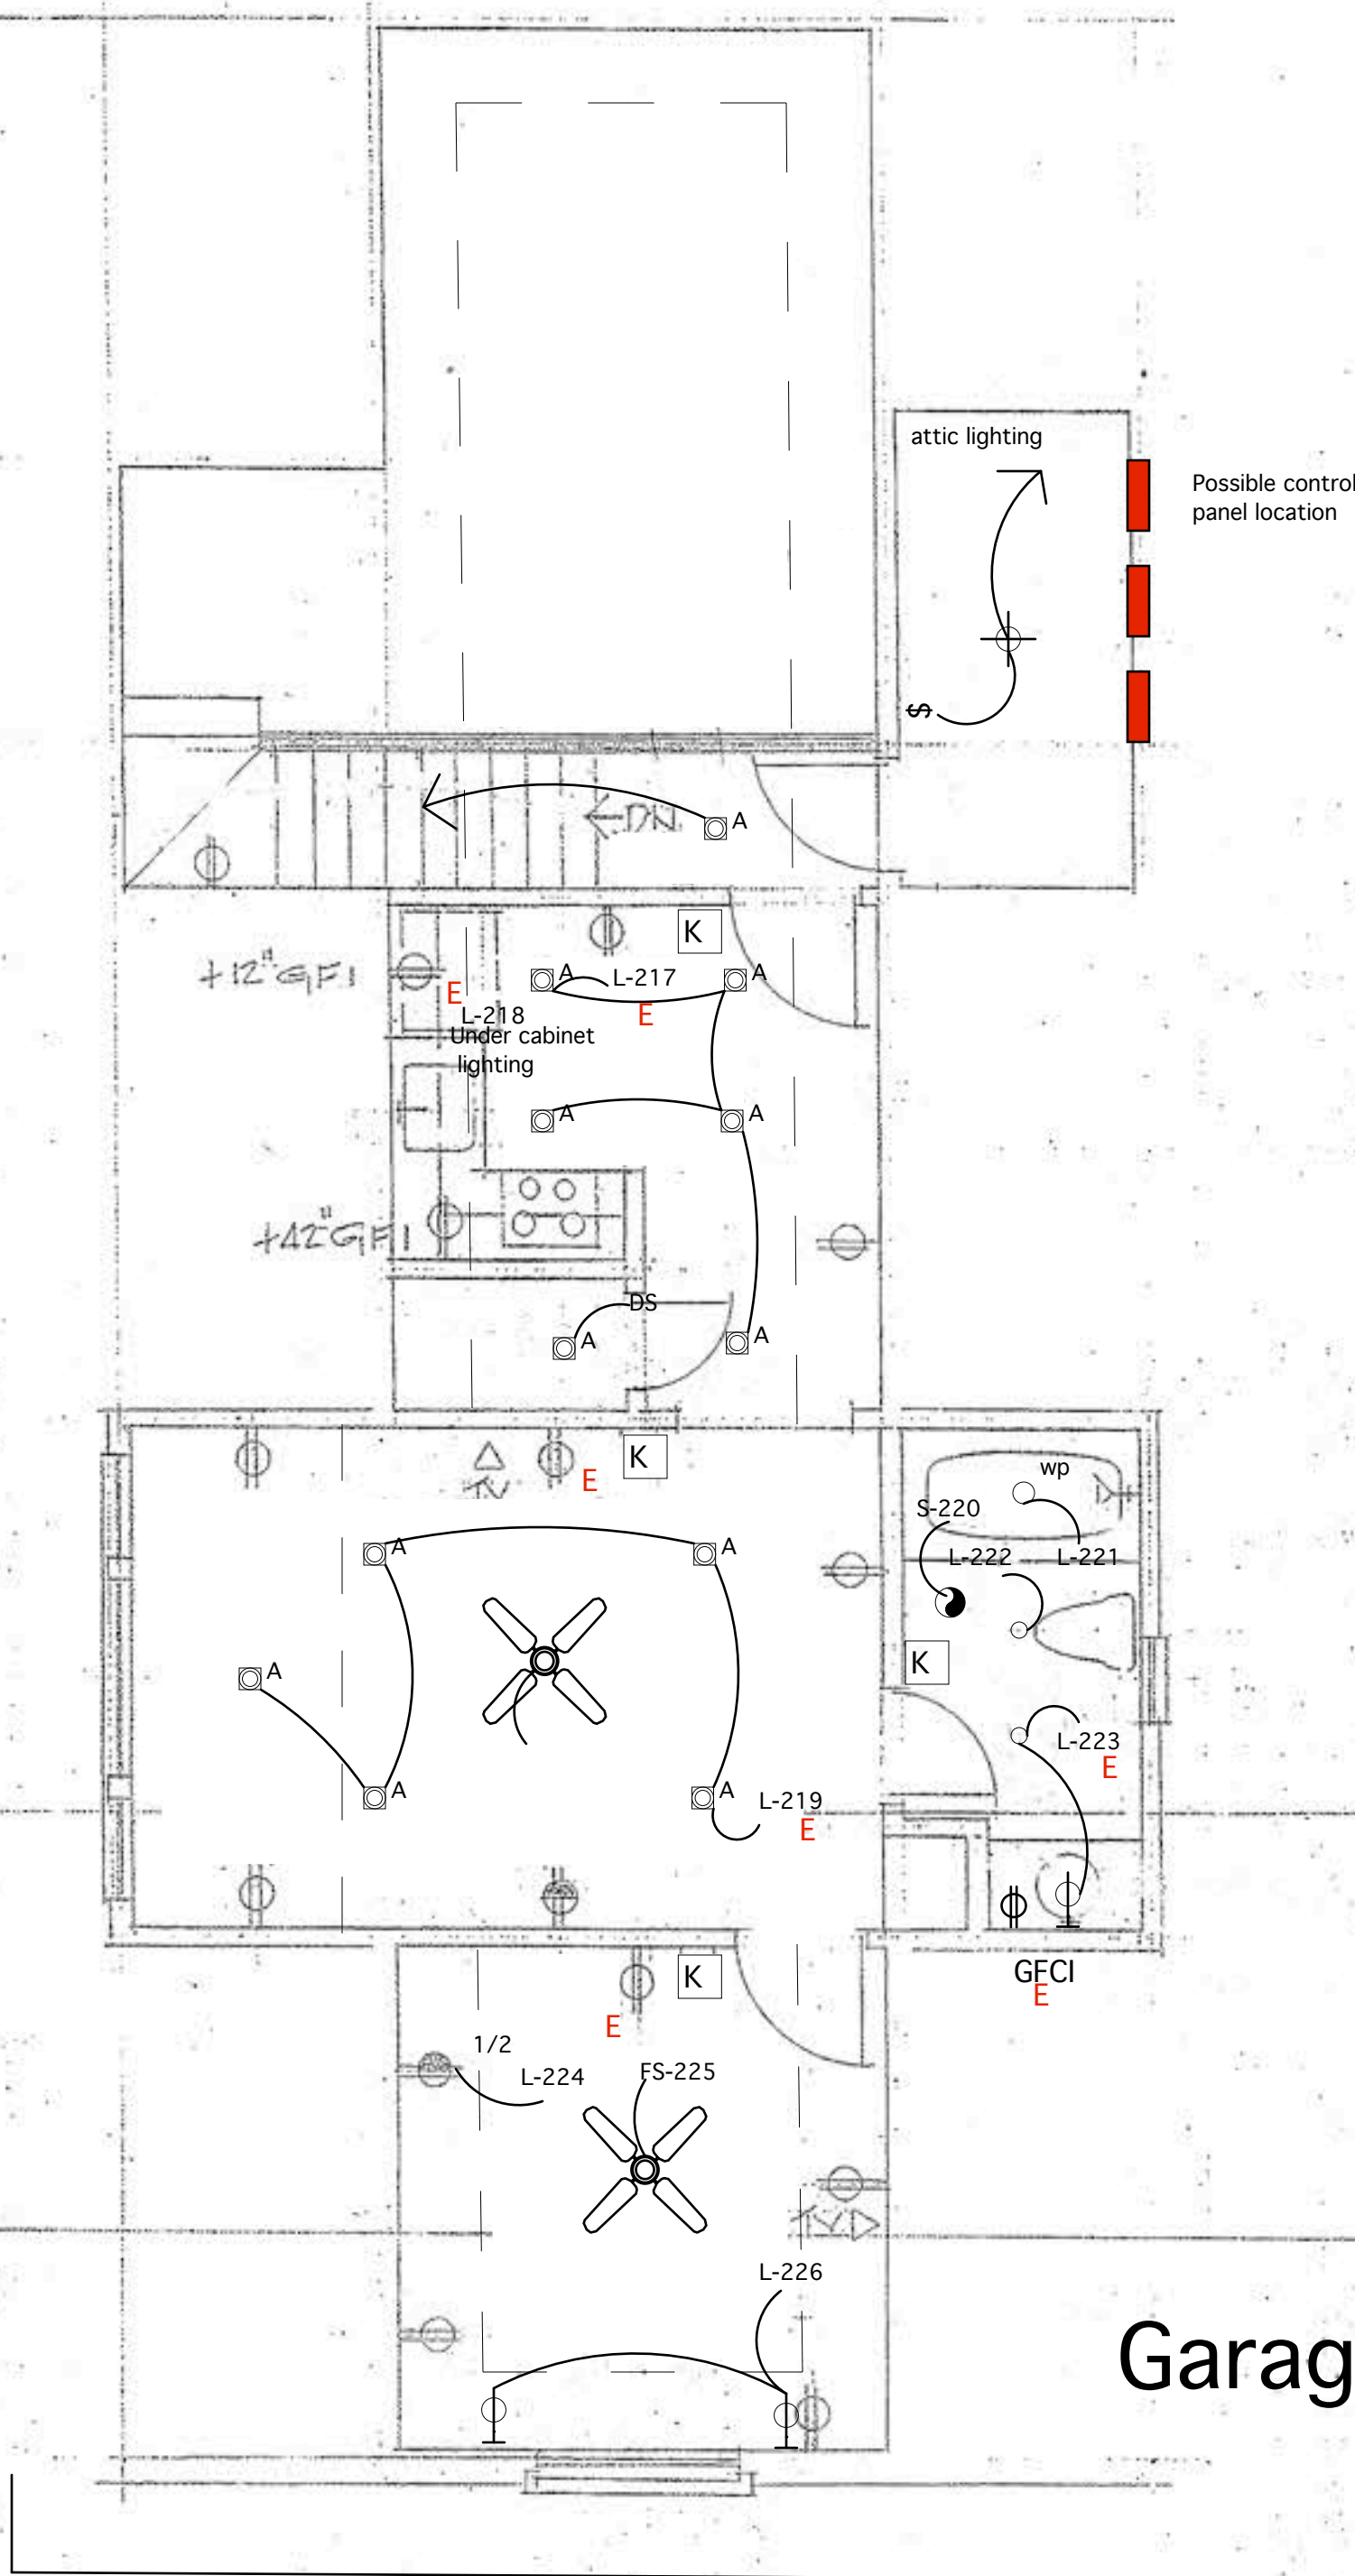

Garage Loft

For Control Panel assignments and wattages see LD-3

Lighting Designer shall verify all fixture specifications and locations
Griff Williams (910)949-2458

Living in Lighting
Lighting Consultation and Lighting System Design
By Griff Williams
P.O. Box 2379
Southern Pines N.C. 28388
(910)949-2458
www.livinginlighting.com

Design Dated 06/29/09
Revised 07/21/09
Revised 10/21/09
G.W.

Basement Drawing on LD-3

EPSTEIN/LATHAM RESIDENCE LOT 4, LINDEN TRAIL, PINEHURST, NC

ROBERT E. CLARK/ALIA ARCHITECT
910 295 4683 FAX 910 295 5684
65 COMMUNITY ROAD
PINEHURST NORTH CAROLINA 28370

THE ARCHITECT RETAINS THE RIGHT OF AUTHORSHIP FOR THIS DRAWING. ANY REUSE OF THIS DRAWING FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT IS STRICTLY PROHIBITED. THIS DRAWING IS THE PROPERTY OF THE ARCHITECT AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. ANY REUSE OF THIS DRAWING FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT IS STRICTLY PROHIBITED.

REVISIONS

APPROVED & ACCEPTED .DATE

K.G. BOGARDUS
6 OCT 08 TEL
28 JULY 08 TEL
K.W. LINE 08 TEL

LD-2