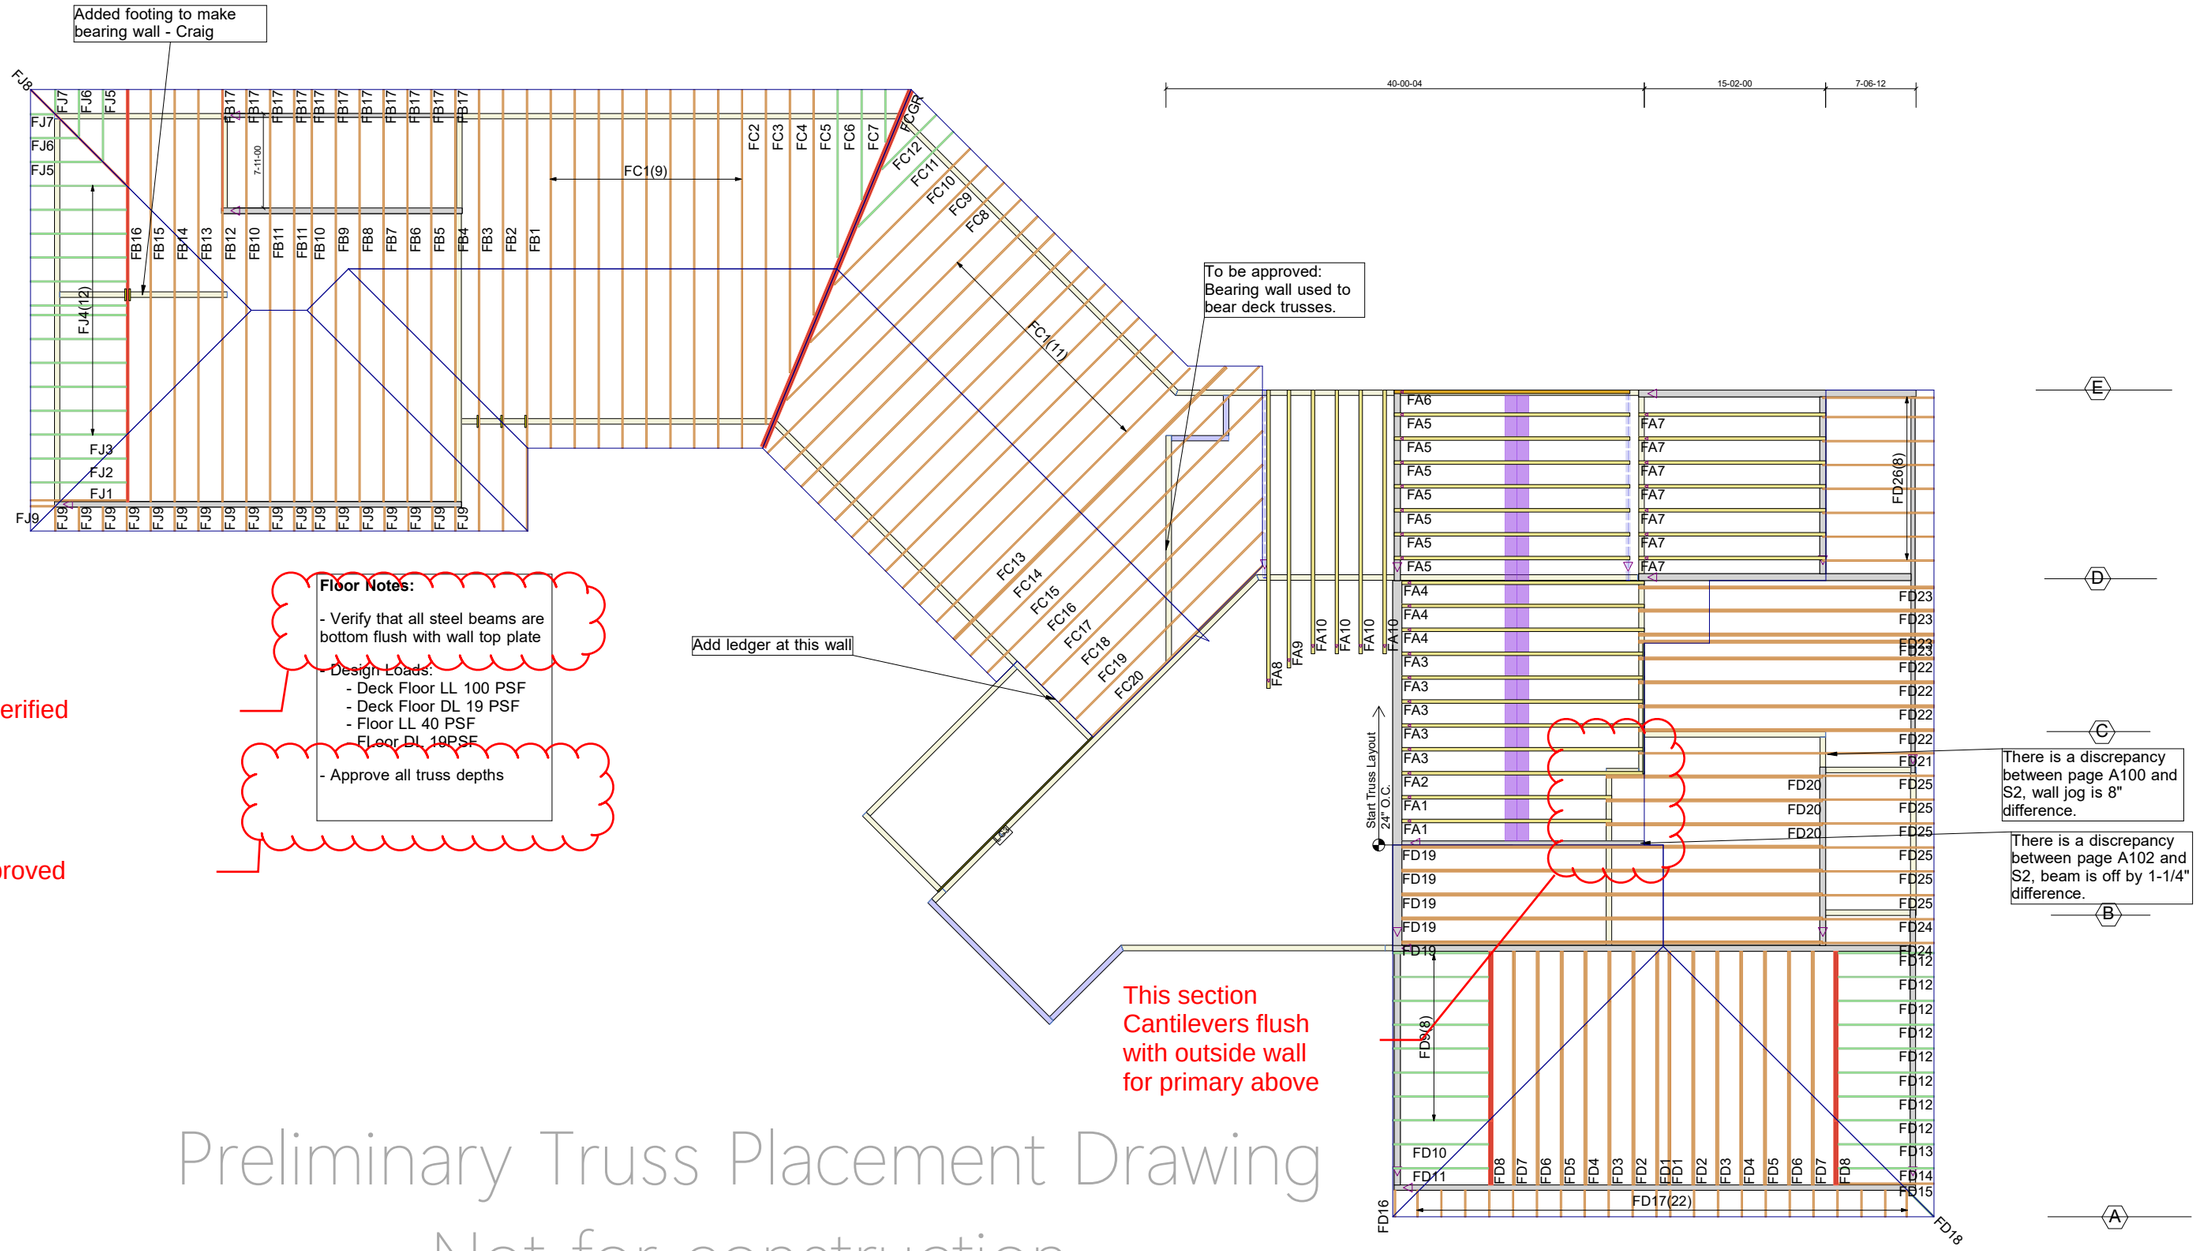


Floor Notes:

- Verify that all steel beams are bottom flush with wall top plate
- Design Loads:
  - Deck Floor LL 100 PSF
  - Deck Floor DL 19 PSF
  - Floor LL 40 PSF
  - Floor DL 19PSF
- Approve all truss depths

Verified

Approved

Preliminary Truss Placement Drawing
Not for construction

DO NOT CUT OR MODIFY TRUSSES

without authorization from SUNPRO. Please contact your sales representative prior to any modification and/or repairs that may need to be made. Any back charges as a result of damage or modifications made without the consent of Sunroc Building Materials will not be honored. Refer to BCSI-B1 sheet for HANDLING, INSTALLING, RESTRAINING AND BRACING OF TRUSSES. Truss layout is for placement only, refer to truss drawings for spacing, bracing, multi-ply nailing and bearing requirements.

Floor Truss Design Criteria
Building Code = ASCE716, IRC 2021
Top Chord Live Load = 40.0 lb/ft²
Top Chord Dead Load = 11.0 lb/ft²
Bottom Chord Dead Load = 7.0 lb/ft²
Deflection LL = L/360 TL = L/240

Issued Date: 3/9/2026

Rodriguez Residence

RAC Inc.

LOT 5 Oak Valley Estates, Kannerville, UT

Sales Rep: Chris Zimmerschied (208) 965-0004
Designer: Sam Garcia

SUNPRO
1177 E Venture Dr, St George UT 84790
Office (801) 222-3300

Order # 254084-UF