
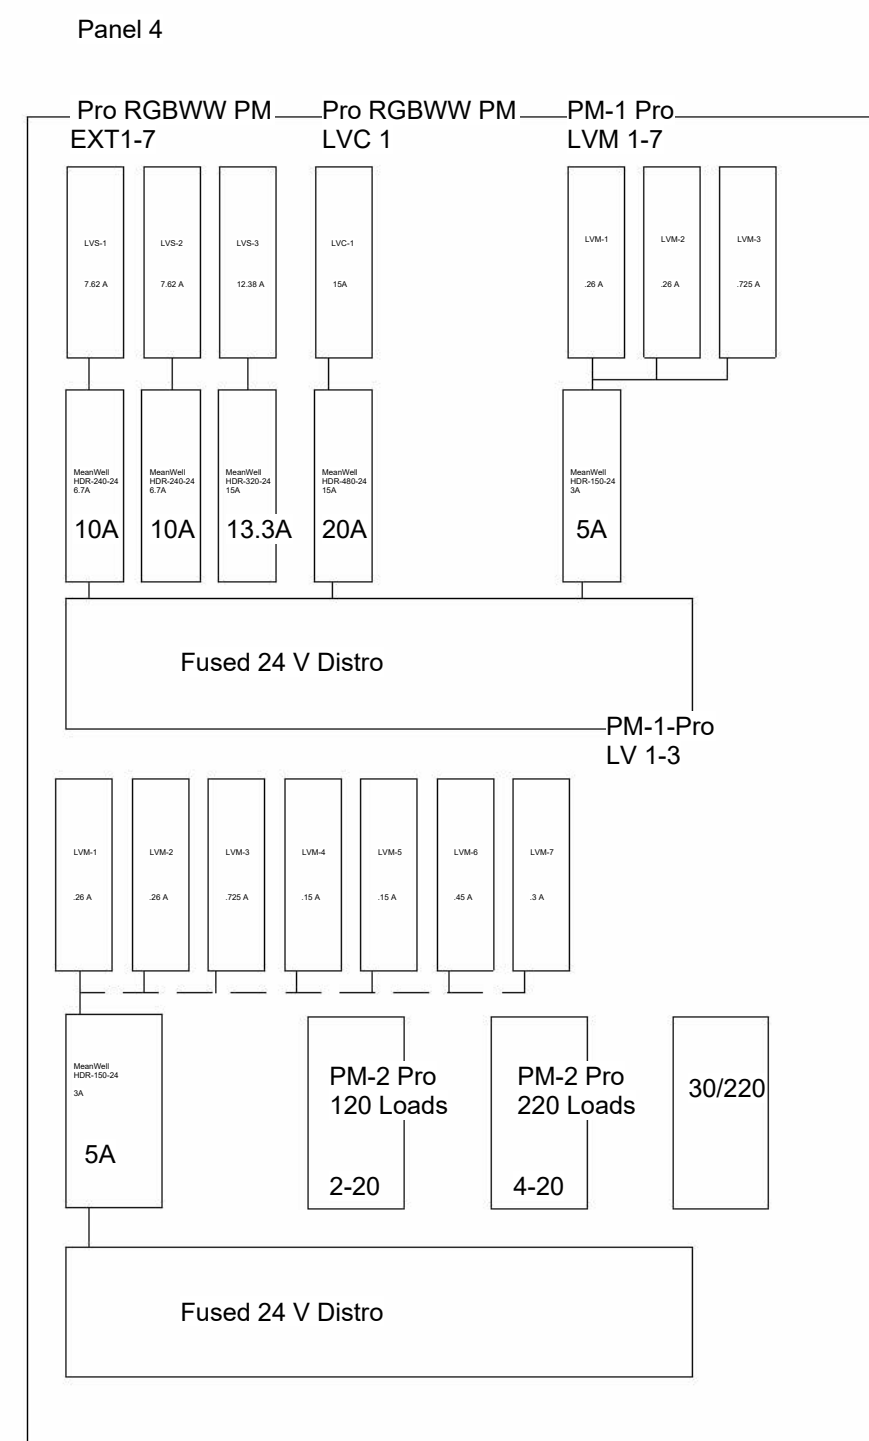
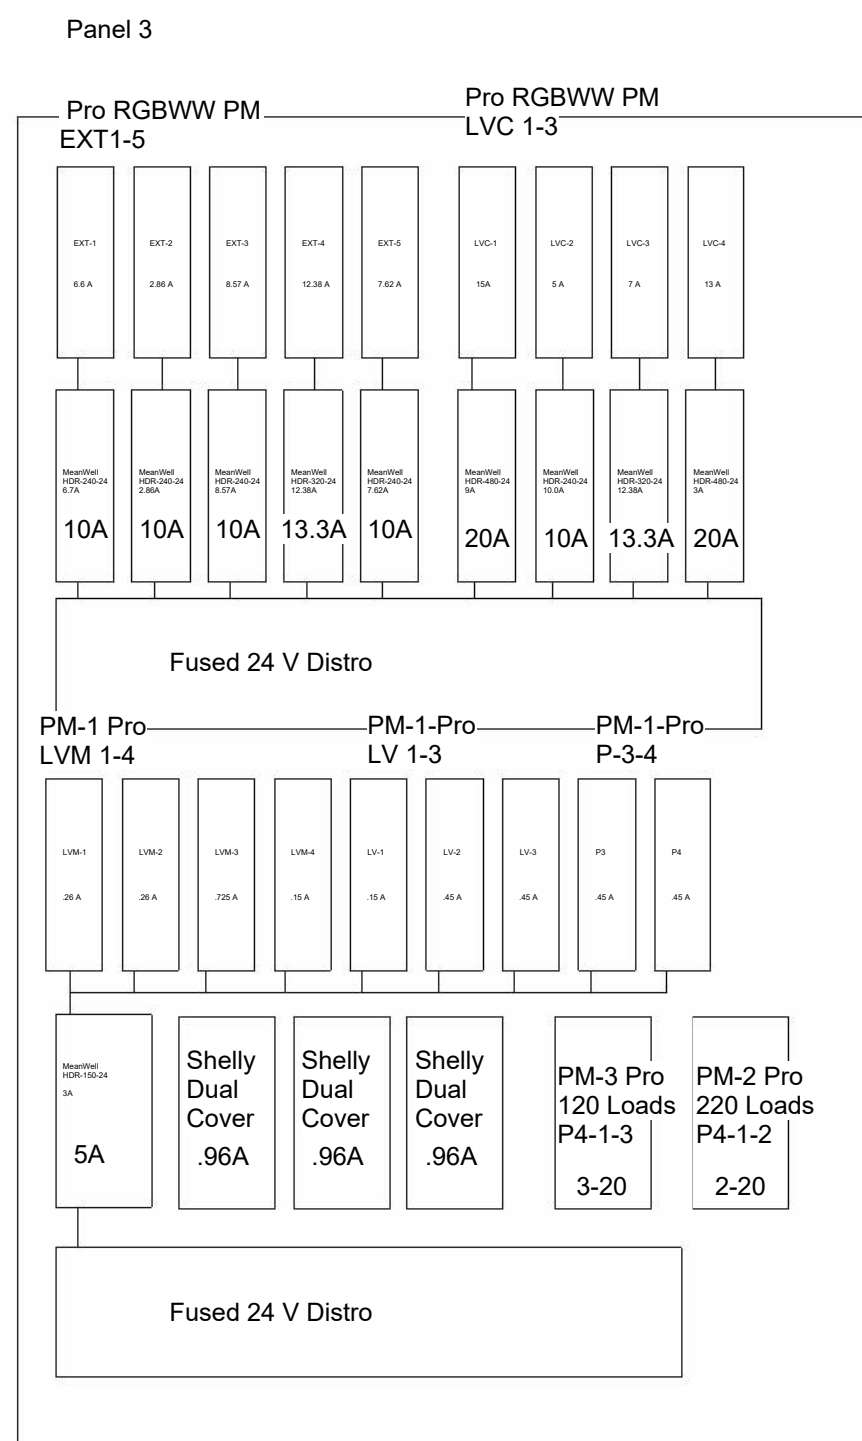
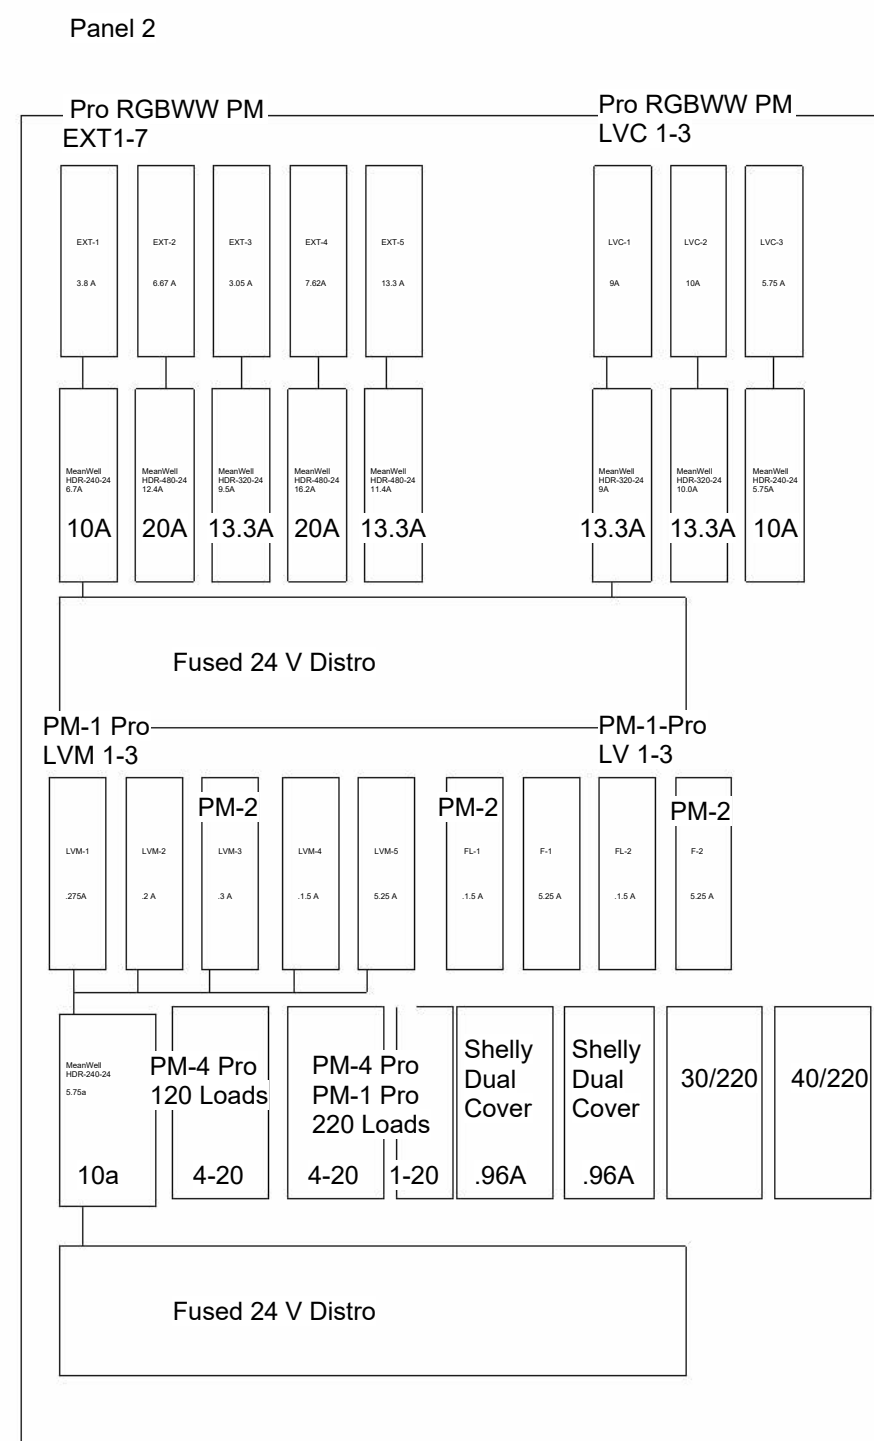


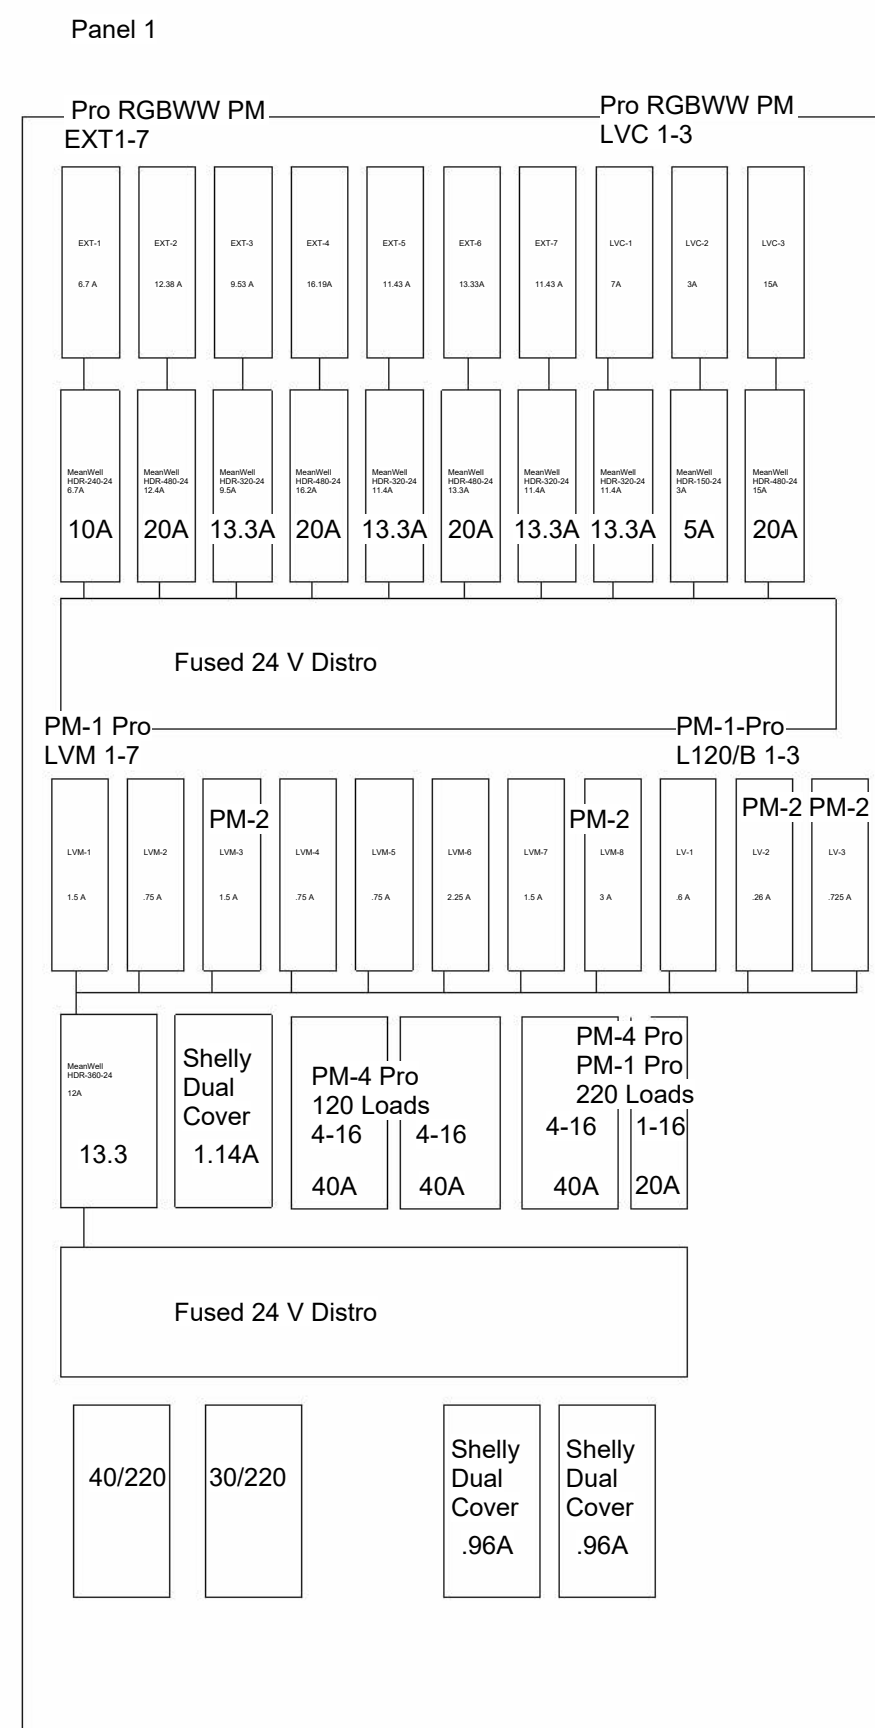


Runs < 50 ft (15 m) → 14 AWG.

50–100 ft (15–30 m) → 12 AWG.

> 100 ft (30 m) → 10 AWG or relocate transformer.

Use separate feeds for high-draw zones (P1-EXT-4, P1-EXT-6 ≈ 20 A each).

If multiple loads share one transformer, home-run each branch instead of daisy-chaining.

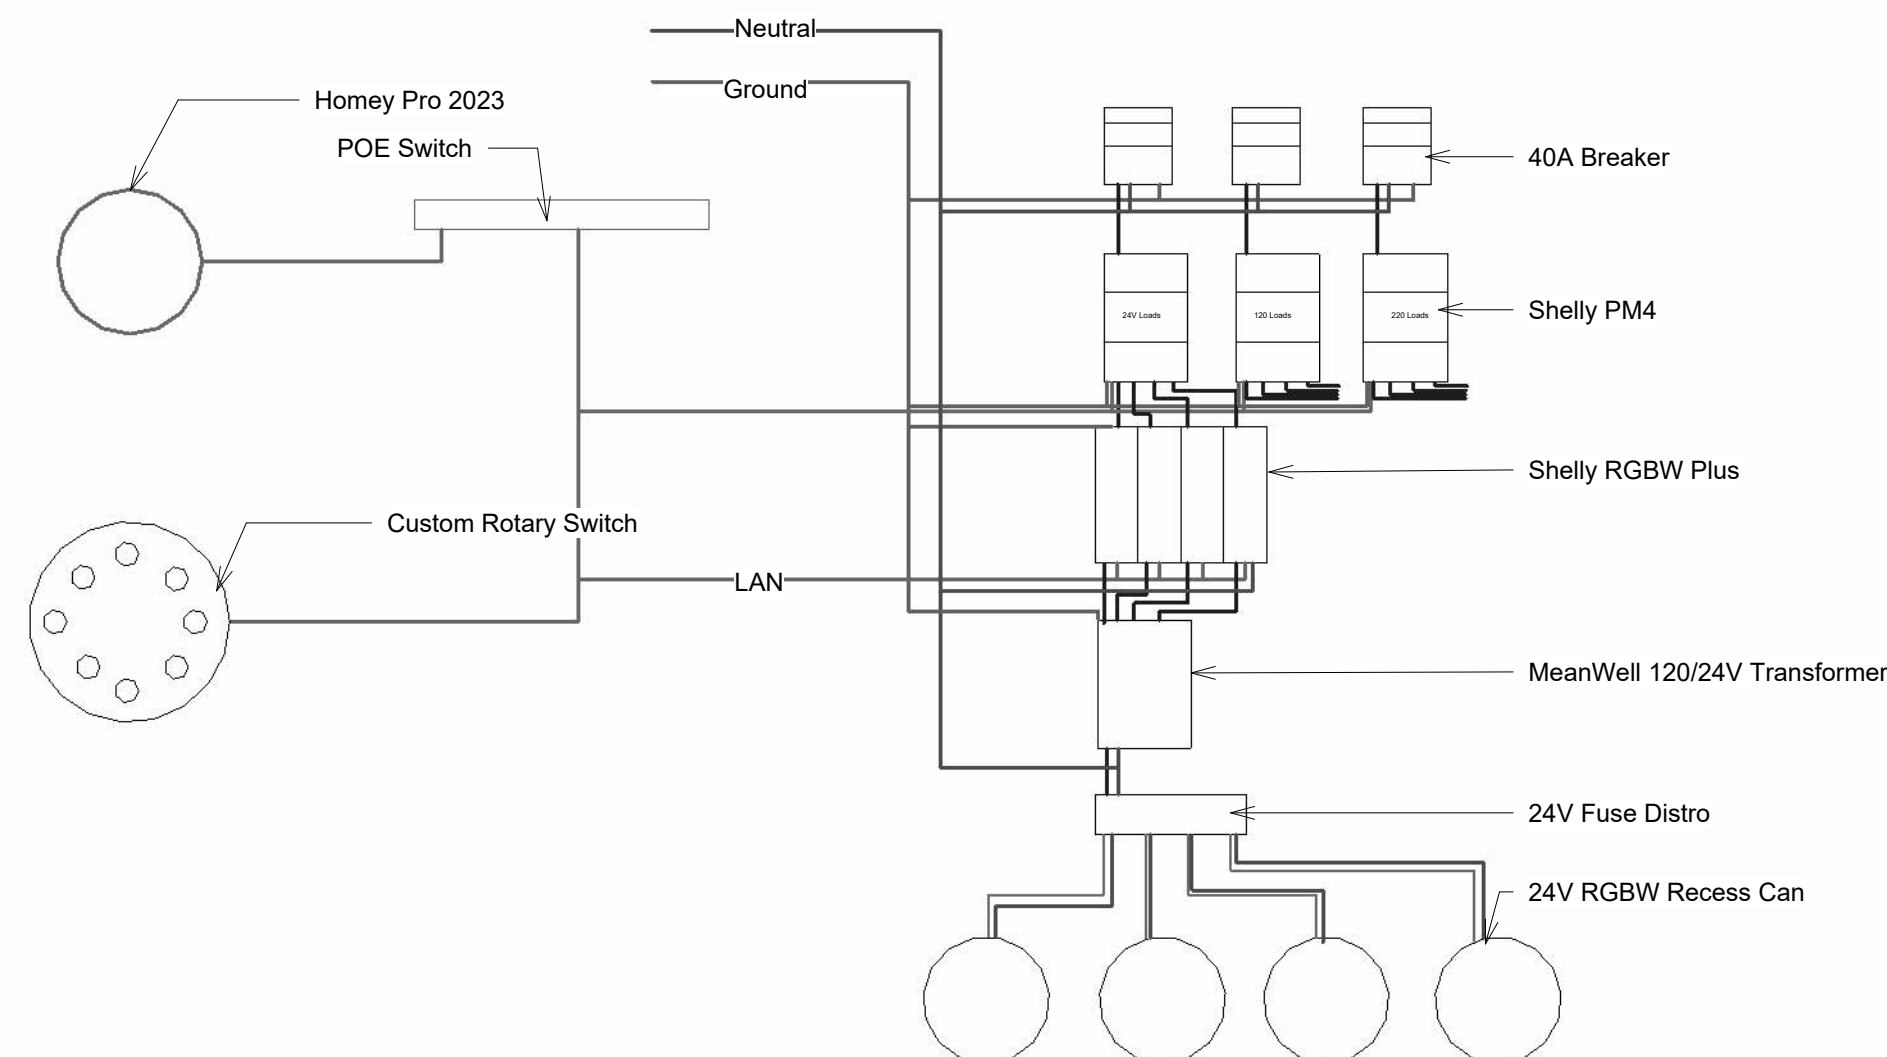

Consultant Craig Engel
Firm RAC Development
Address 1267 N. 1390 W . St. George UT
Phone (435) 229-7360
Fax
e-mail racinc19@gmail.com

Consultant
Firm
Address
Phone
Fax
e-mail

Consultant
Firm
Address
Phone
Fax
e-mail

Consultant
Firm
Address
Phone
Fax
e-mail

Consultant
Firm
Address
Phone
Fax
e-mail

[illegible]

Mr. & Mrs. Rodriguez
Oak Valley Estates #5
Panels

Project number	Project Number
Date	Issue Date
Drawn by	Author
Checked by	Checker

E104

Scale	1/4" = 1'-0"
-------	--------------