
01. CABINET AND DOOR MOUNTING LAYOUT


LAB12 / HPK-25 / CONVEYOR SC10-3 / EDUCATIONAL DRAFT - NOT FOR INSTALLATION

BACKPLATE / INTERNAL VIEW

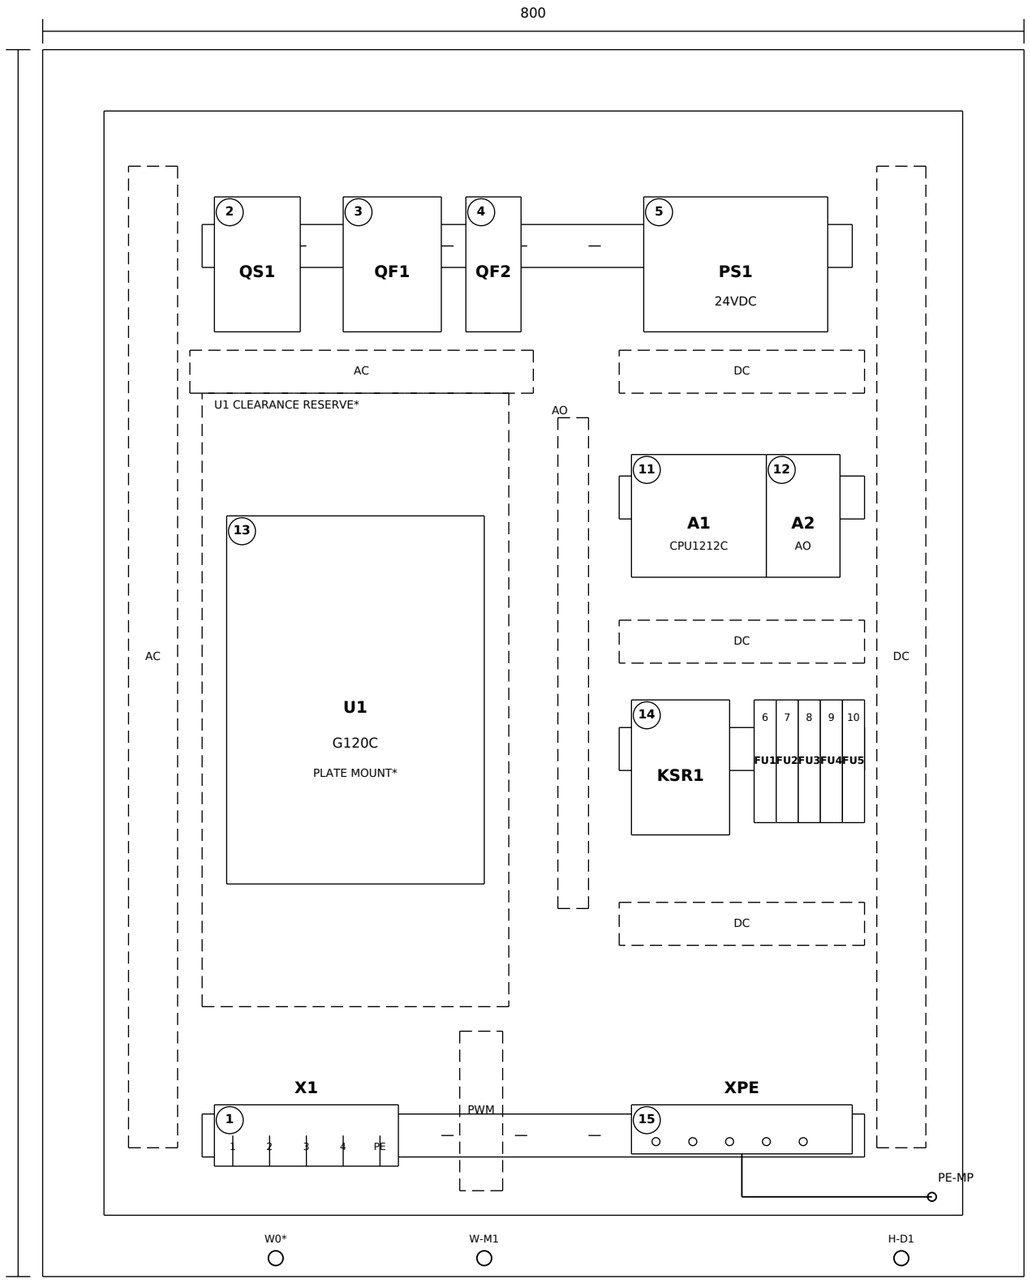

CABINET 800W x 1000H x 300D

DOOR / FRONT VIEW

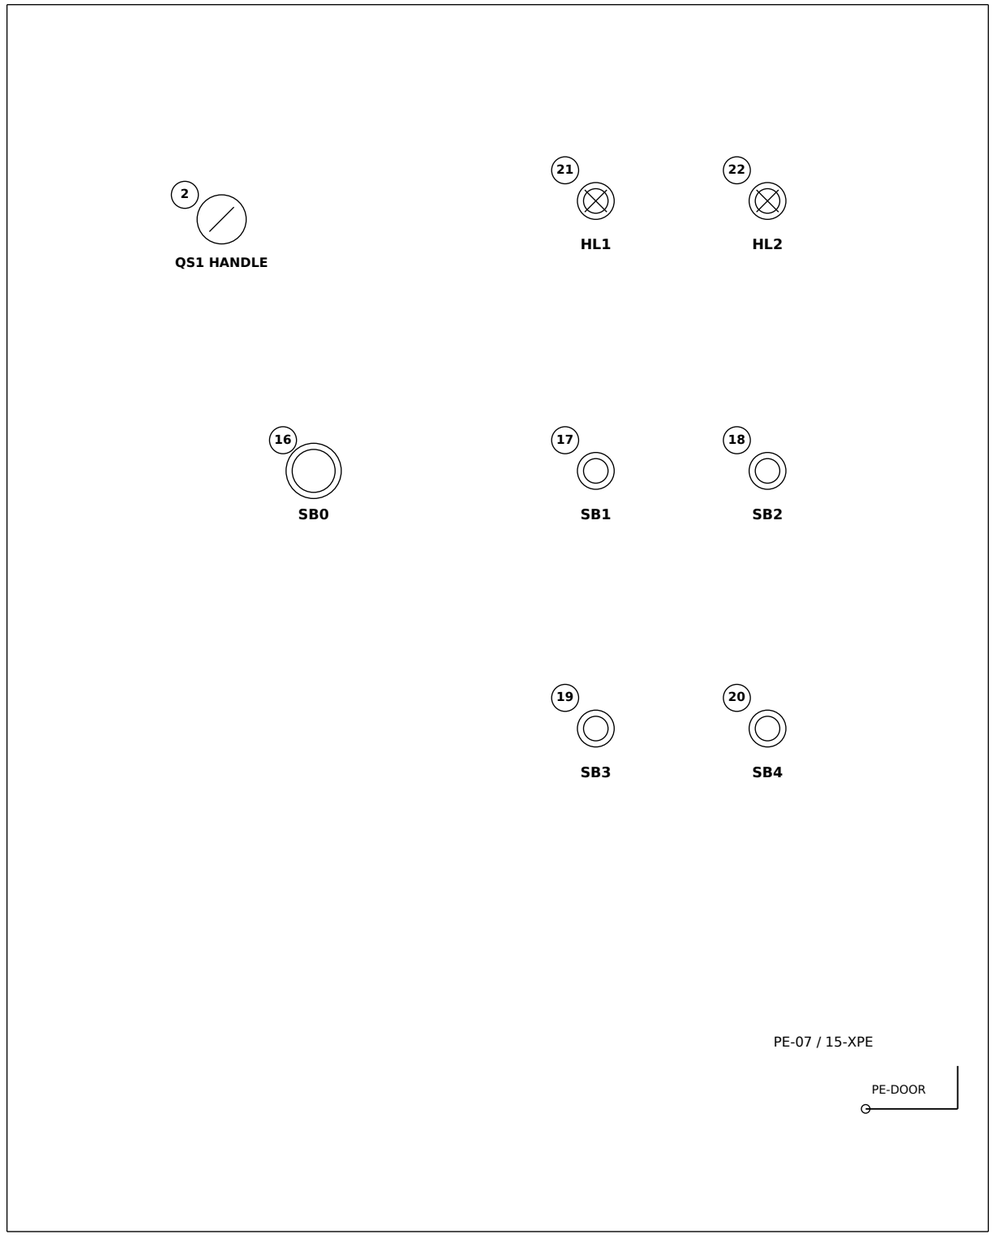

DOOR DEVICES / H-D1 FLEXIBLE HARNESS

* PROPOSED ENVELOPES / CLEARANCES ONLY; NO DRILLING OR THERMAL VALIDATION.

TS35 = 35MM RAIL PROFILE; POWER / PWM / CONTROL / AO ROUTES ARE SEPARATED.


HPK25-SC10-3-E4	**DRAFT 12-01**	**28.10.2026**	**1/3 / A3 / 1:5***
DESIGNED: TIS VLADYSLAV	GROUP: _____	CHECKED: _____	MM / IEC

02. E4 POWER CONNECTIONS AND DC BRANCH ADDRESSES

LAB12 / HPK-25 / CONVEYOR SC10-3 / EDUCATIONAL DRAFT - NOT FOR INSTALLATION

POWER: DIRECT METHOD. CONTROL: ADDRESS METHOD / SHEET 3 AND TE4.

X1: 3~ 400/230VAC / 50HZ / 3L+N+PE (N ASSUMED)

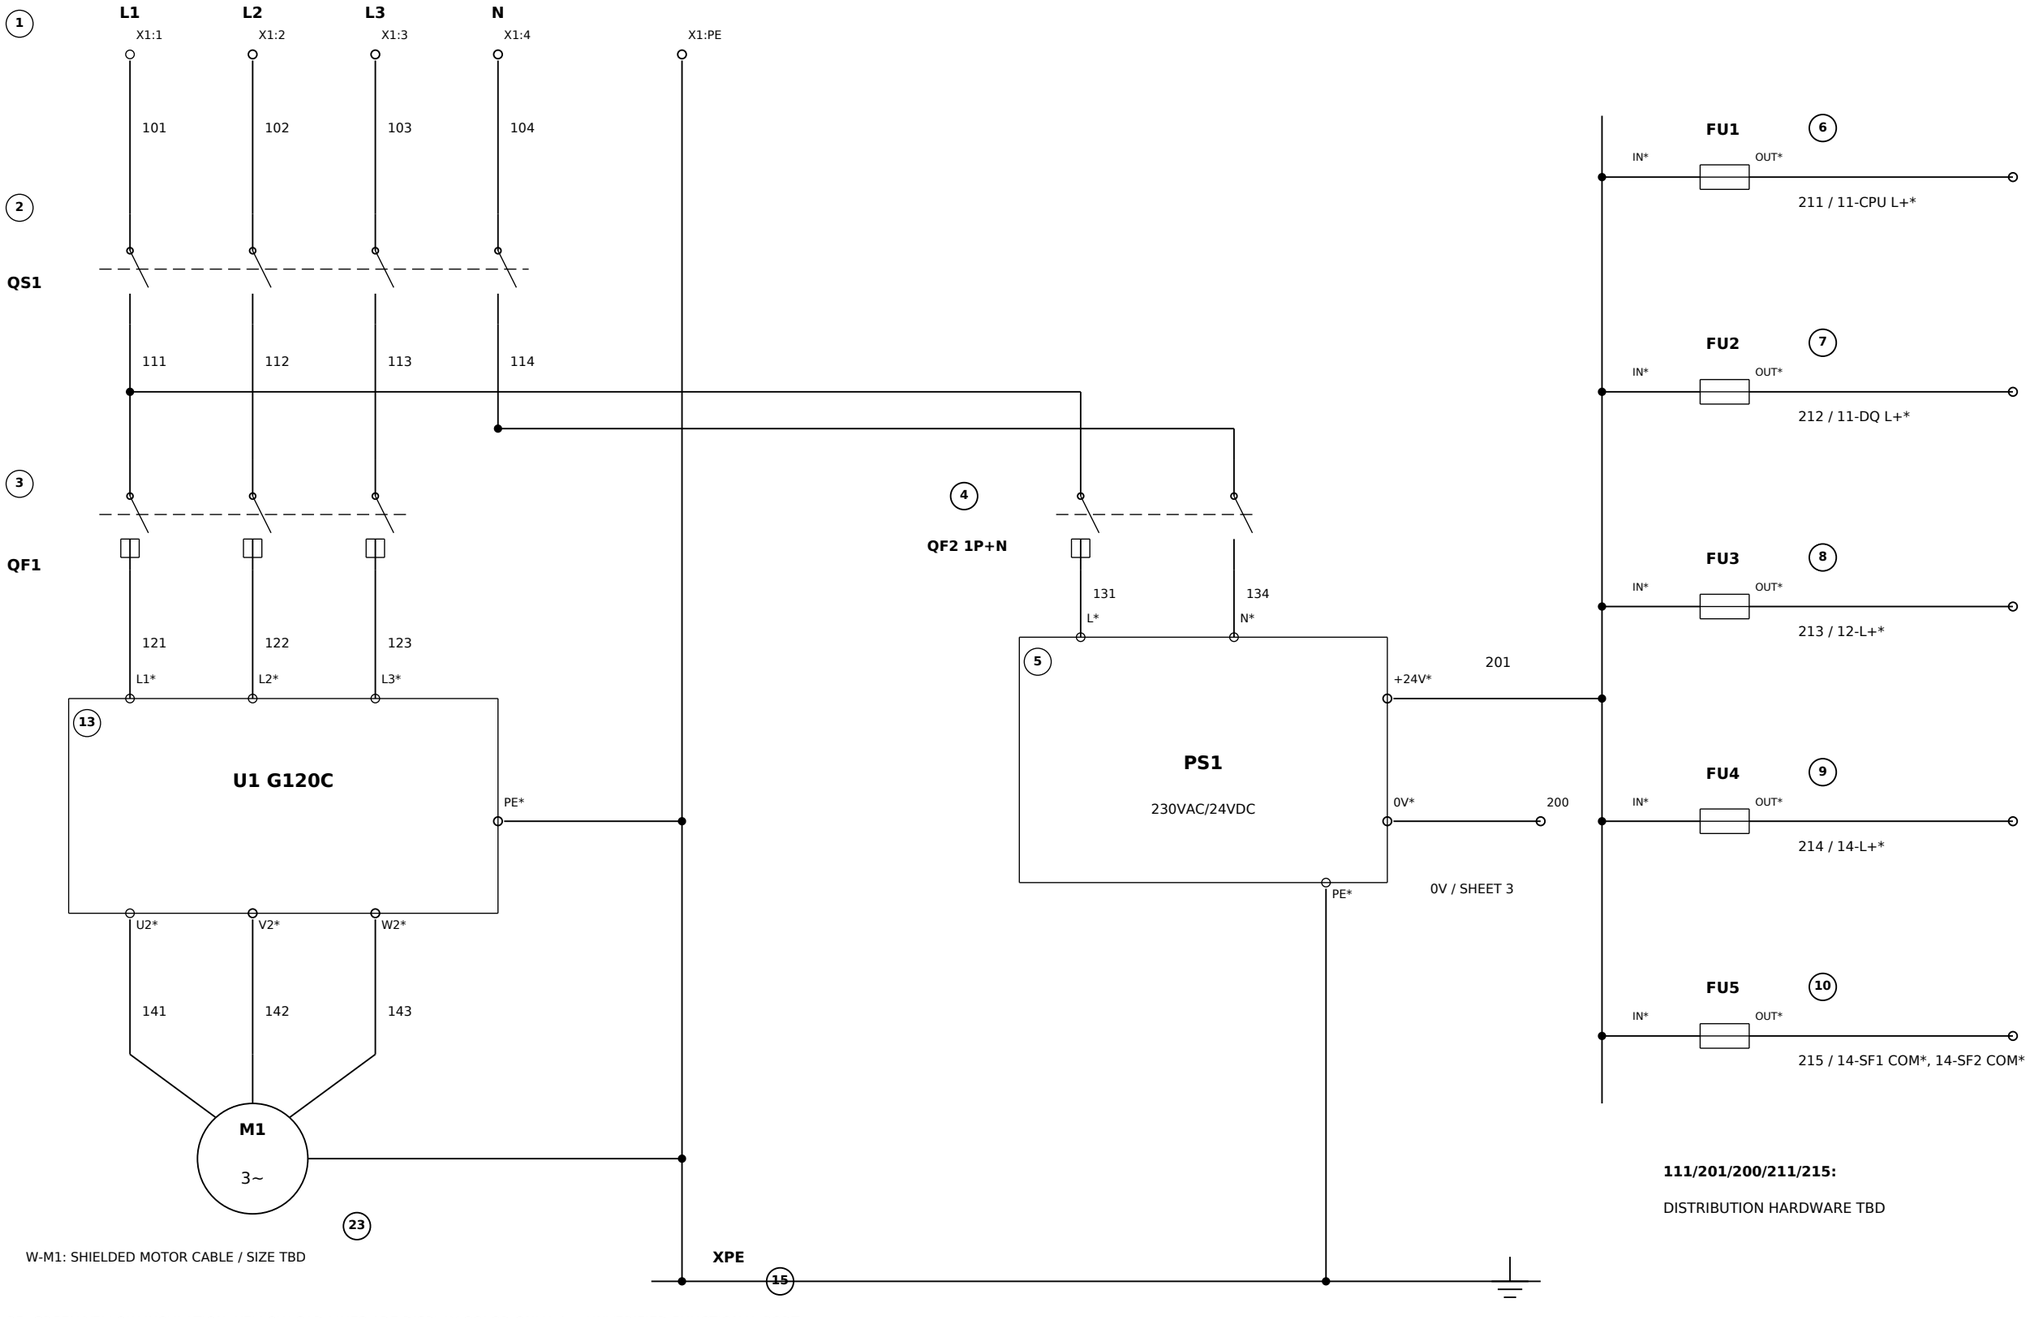

111/201/200/211/215:

DISTRIBUTION HARDWARE TBD

PE: GREEN/YELLOW INSULATION. YELLOW CAD LINES ARE DISPLAY COLOR ONLY. * = UNVERIFIED FUNCTIONAL PORT.

HPK25-SC10-3-E4	**DRAFT 12-01**	**28.10.2026**	**2/3 / A3 / NTS**
DESIGNED: TIS VLADYSLAV	GROUP: _____	CHECKED: _____	MM / IEC

03. E4 CONTROL WIRING / ADDRESS TABLES / DOOR HARNESS

LAB12 / HPK-25 / CONVEYOR SC10-3 / EDUCATIONAL DRAFT - NOT FOR INSTALLATION

END MARK = REMOTE APPARATUS NUMBER - PORT. EXAMPLE: 17-14 = SB1 CONTACT 14. SEE TE4 FOR EACH SEGMENT.

(11) A1

CPU M*	200 / 5-0V*
DQ M*	200 / 5-0V*
DI M*	200 / 5-0V*
CPU L+*	211 / 6-OUT*
DQ L+*	212 / 7-OUT*
I0.0*	301 / 17-14*
I0.1*	302 / 18-22*
I0.2*	303 / 20-14*
I0.3*	304 / 14-AUX NO*
I0.4*	305 / 13-DO NO*
Q0.0*	401 / 13-DI ON/OFF1*
Q0.1*	402 / 21-+*
Q0.2*	403 / 22-+*
Q0.3*	404 / 13-DI RESET*

(12) A2

M*	200 / 5-0V*
L+*	213 / 8-OUT*
CH0 V+*	501 / 13-AI0+*
CH0 M*	502 / 13-AI0-*

(13) U1

L1*	121 / 3-L1 OUT*
L2*	122 / 3-L2 OUT*
L3*	123 / 3-L3 OUT*
U2*	141 / 23-U1*
V2*	142 / 23-V1*
W2*	143 / 23-W1*
PE*	PE / 15-PE
DICOM*	200 / 5-0V*
STO reference*	200 / 5-0V*
DO COM*	211 / 6-OUT*
DO NO*	305 / 11-I0.4*
DI ON/OFF1*	401 / 11-Q0.0*
DI RESET*	404 / 11-Q0.3*
AI0+*	501 / 12-CH0 V+*
AI0-*	502 / 12-CH0 M*
STO A*	611 / 14-SF1 NO*
STO B*	612 / 14-SF2 NO*

(14) KSR1

M*	200 / 5-0V*
AUX COM*	211 / 6-OUT*
L+*	214 / 9-OUT*
SF1 COM*	215 / 10-OUT*
SF2 COM*	215 / 10-OUT*
AUX NO*	304 / 11-I0.3*
TEST1*	600 / 16-11*
INPUT1*	601 / 16-12*
TEST2*	602 / 16-21*
INPUT2*	603 / 16-22*
RESET SRC*	604 / 19-13*
RESET IN*	605 / 19-14*
SF1 NO*	611 / 13-STO A*
SF2 NO*	612 / 13-STO B*

H-D1: DOOR HARNESS / FLEXIBLE CONDUCTORS / STRAIN RELIEF / SEPARATE PE BOND

(16) SB0

PORT NET / REMOTE END

11* 600 / 14-TEST1*

12* 601 / 14-INPUT1*

21* 602 / 14-TEST2*

22* 603 / 14-INPUT2*

(17) SB1

PORT NET / REMOTE END

13* 211 / 6-OUT*

14* 301 / 11-I0.0*

(18) SB2

PORT NET / REMOTE END

21* 211 / 6-OUT*

22* 302 / 11-I0.1*

(19) SB3

PORT NET / REMOTE END

13* 604 / 14-RESET SRC*

14* 605 / 14-RESET IN*

(20) SB4

PORT NET / REMOTE END

13* 211 / 6-OUT*

14* 303 / 11-I0.2*

(21) HL1

PORT NET / REMOTE END

-* 200 / 5-0V*

+* 402 / 11-Q0.1*

(22) HL2

PORT NET / REMOTE END

-* 200 / 5-0V*

+* 403 / 11-Q0.2*

CTRL: H07V-K CU 0.75MM2*; AO: SHIELDED PAIR, SIZE TBD; POWER/PE SIZES TBD. LENGTHS: AFTER ROUTING.

* FUNCTIONAL PORTS / PROPOSED WIRE CHOICE, NOT VERIFIED MANUFACTURER TERMINALS. NETS 43 / SEGMENTS 68.

SE10-1 / ACTUAL STO RELAY / FOOTPRINTS / THERMAL CLEARANCES / MULTI-WIRE DISTRIBUTION: NOT FINALIZED.

HPK25-SC10-3-E4	**DRAFT 12-01**	**28.10.2026**	**3/3 / A3 / NTS**
DESIGNED: TIS VLADYSLAV	GROUP: _____	CHECKED: _____	MM / IEC