


Confusion Matrices: Baseline Ensemble (Calibrated Probs, Held-Out n=86)

(A) Threshold = 0.41
TN=19, FP=4, FN=4, TP=59
Precision=0.9365, Recall=0.9365



(B) Threshold = 0.38
TN=17, FP=6, FN=3, TP=60
Precision=0.9091, Recall=0.9524

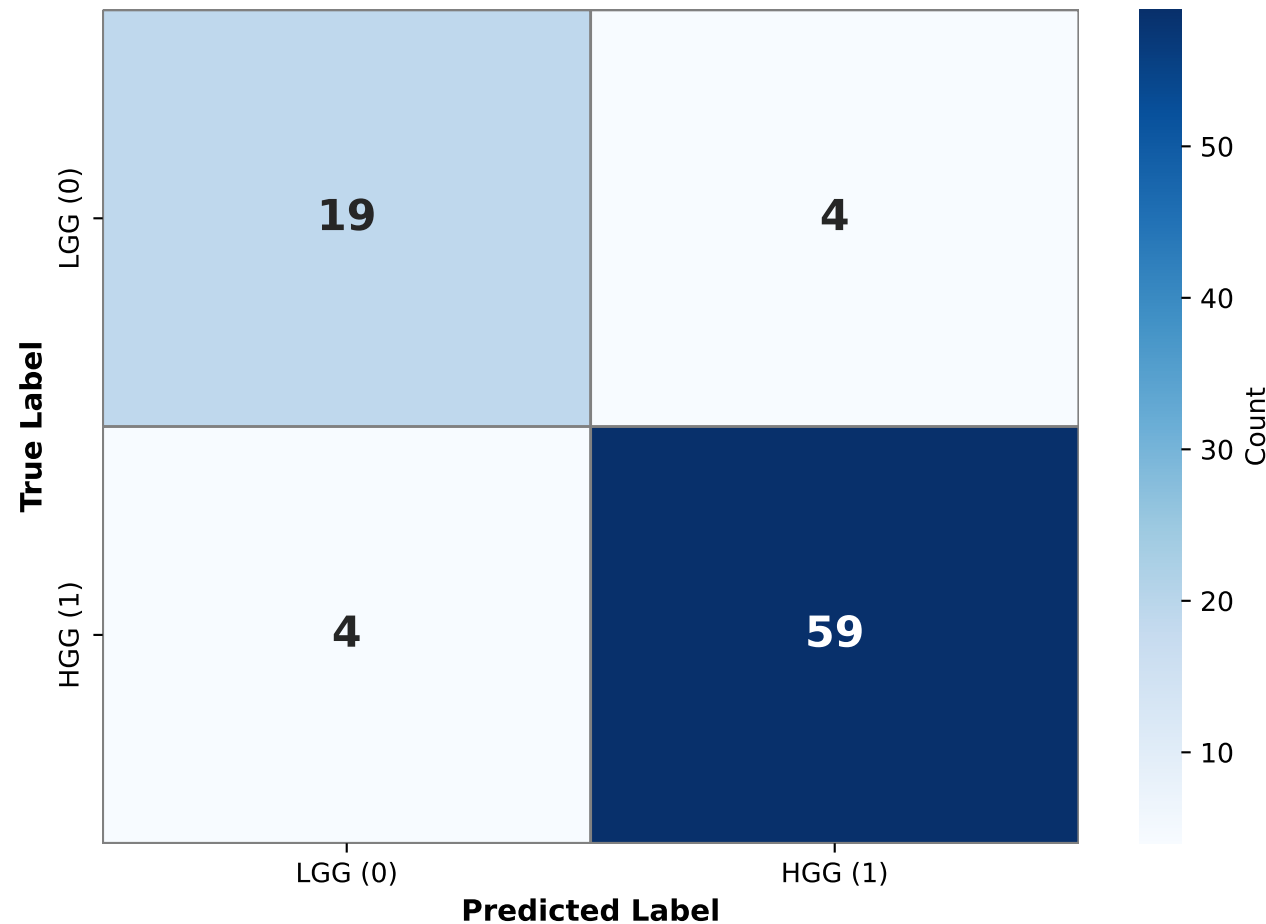