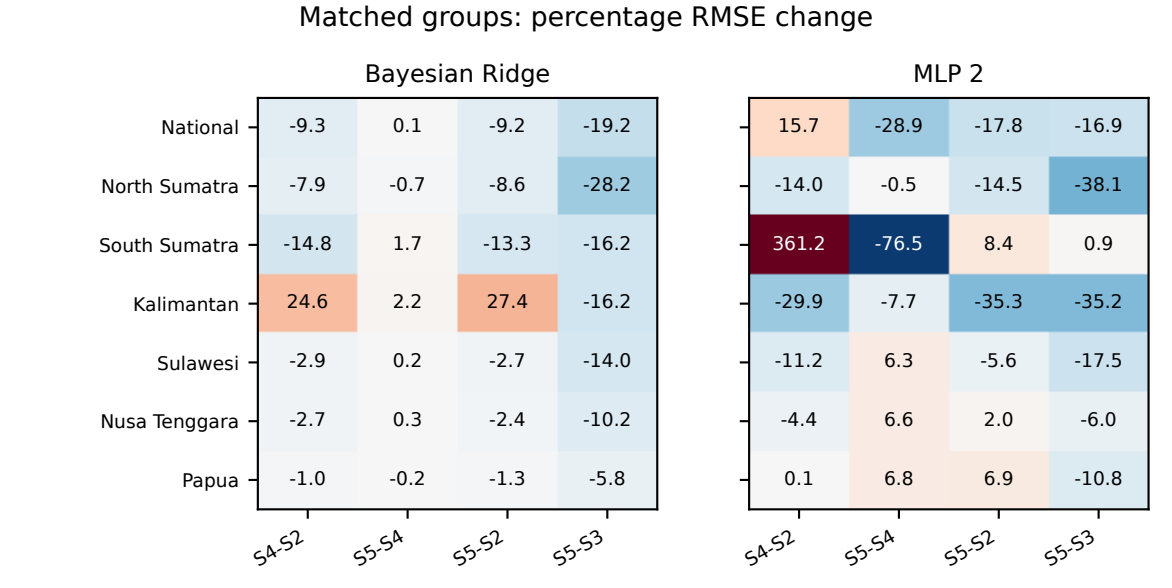

Negative: lower RMSE; colors saturate beyond +/-80%; complete procedures